DEPARTMENT OF ENVIRONMENT AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: ___
COUNTY: ___


SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: Lakeland Luxury — APPLICATION DATE ___
ADDRESS: ___ — DATE EVALUATED: ___
PROPOSED FACILITY: 4 BR SFD — PROPOSED DESIGN FLOW (.1949): 480 GPD — PROPERTY SIZE: ___
LOCATION OF SITE: LOT 10 — PROPERTY RECORDED: ___
WATER SUPPLY: ☒ Private ☐ Public ☒ Well ☐ Spring ☐ Other ___
EVALUATION METHOD: ☐ Auger Boring ☒ Pit ☐ Cut — TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1 (13)	L 6-10%	0-22	Mo,sbk,c	Fr,ss,sp	(Red)	F-c-Sap Inclus,			0.30
		22-38	wk,sbk,c	Fr,ss,sp	(Red)				
		38-50	wk,sbk,cl	Fr,ss,sp	(Red)	M-Sap. Inclus,			
2		0-6	gr sl	fr nsnp	Br				.3
		6-30	moskbk	fr ss sp	Red				
		30-50	wk sbk cl	frss sp	m-Sap				
3	15%	0-3	gr sl	fr nsnp	Br				.3
		3-21	mo sbk c	fr ss sp	Red				
		24-28	wk sbk cl	frsssp	c-m Sap				
		28-50	Mass. L/ Sl Sap frss np		fr				
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): ___
SITE CLASSIFICATION (.1948): ___
EVALUATED BY: ___
OTHER(S) PRESENT: ___
COMMENTS: ___

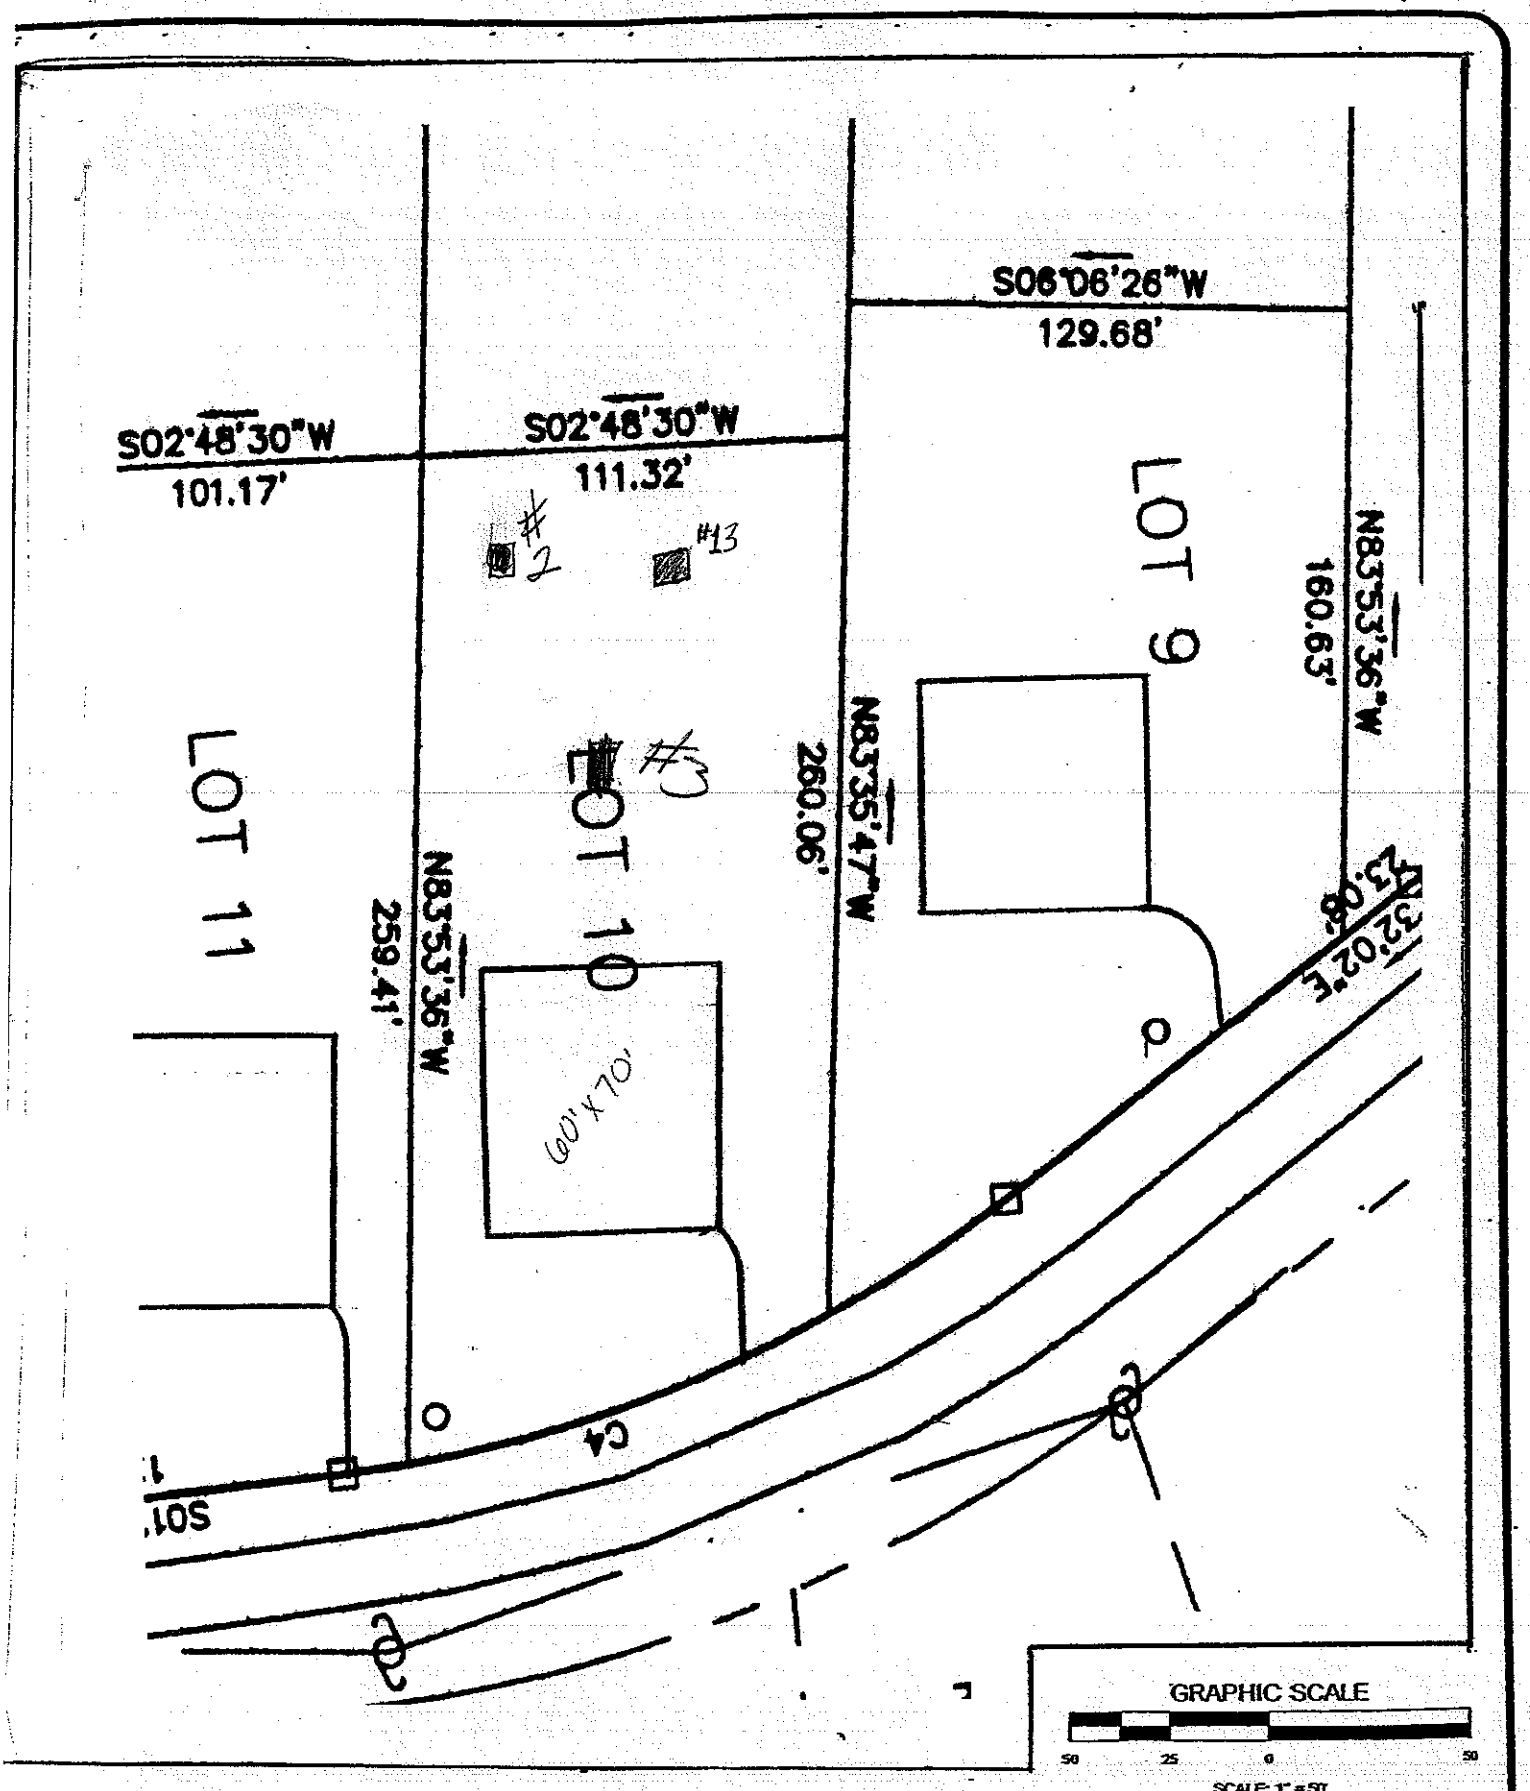

LE:	AS SHOWN
E:	10/03/07
WN BY:	PLM
JECT NO:	588-07-051

S&ME
WWW.SMEINC.COM

PRELIMINARY

FIGURE NO.

DEPARTMENT OF ENVIRONMENT AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: ___
COUNTY: ___

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM


OWNER: Lakeland Luxury
ADDRESS: ___
PROPOSED FACILITY: 4 BR SFD
PROPOSED DESIGN FLOW (.1949): 480 GPD
LOCATION OF SITE: LOT 11
WATER SUPPLY: ☒ Private ☐ Public ☒ Well ☐ Spring ☐ Other ___
EVALUATION METHOD: ☐ Auger Boring ☒ Pit ☐ Cut

APPLICATION DATE ___
DATE EVALUATED: ___
PROPERTY SIZE: ___
PROPERTY RECORDED: ___
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1 (14)	L 6-10% 90%	0-5	wk, sbk, scl	Fr, SS, sP	(Red-Brwn)	F-C-Sap	Inclus.		0.30
		5-33	Mo, sbk, C	Fr, ss, sp	(Red)				
		33-46	wk, sbk, cl	Fr, ss, sp	(Red)				
		46-52	wk, sbk, cl	+ SL Sap Mix					
2 (OP 19)		0-18	w, sbk, cl	Fr, ss, sp	w/ C-Sap.				0.3+
		18-48	w, sbk, cl	+ Sap.					
3		0-8	gr scl	fr ss sp	Br	C-cobble			.3 to 42"
		8-42	mosbkc	fr ss sp	Red	f-gravel/cobble			
		42-48	wk sbkcl	+ sap	c-sap				.25 > 42"
				fi/fr ss	sp				
4		0-8	g sl	fr ss np	Br				.3
		8-28	mosbkc	fr sss p	Red	f-Rock band			
		28-38	wk sbkcl	fr sss p	"	c+m sap			
		38-55	L/sl sap	fr ns np	sl inc.				

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): ___
SITE CLASSIFICATION (.1948): ___
EVALUATED BY: ___
OTHER(S) PRESENT: ___
COMMENTS: ___

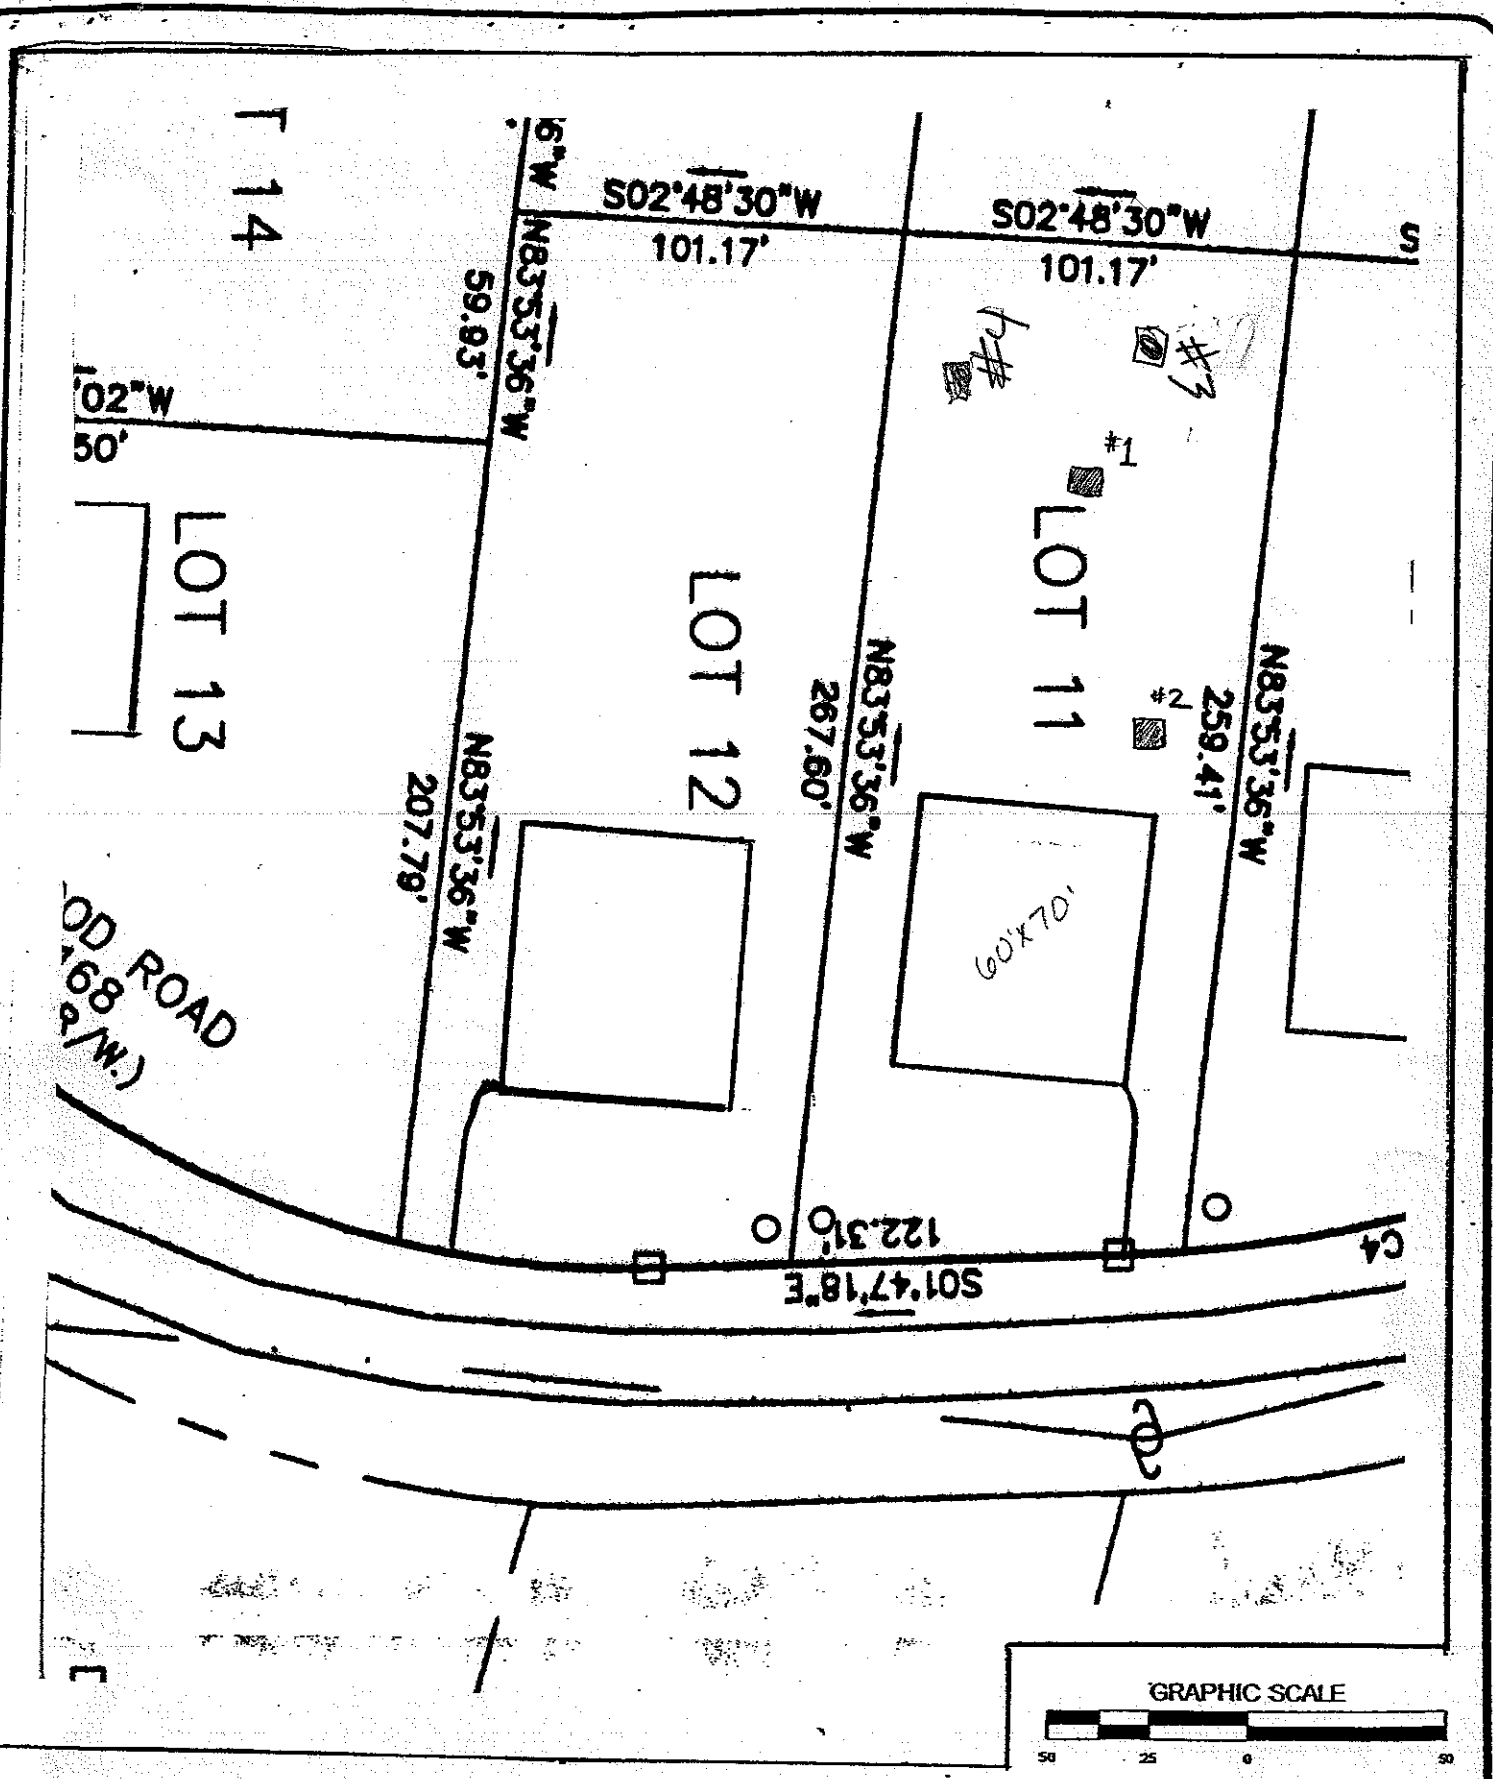

LE:	AS SHOWN
E:	10/03/07
WN BY:	PLM
JECT NO:	588-07-051

S&ME
WWW.SMEINC.COM

PRELIMINARY

FIGURE NO.