4437351871

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Eureka Mason DATE 6-30-76 PERMIT NO. 171

PHONE: Business 873-4382 Home

LOCATION 150 W TL on 1180 T Rd on 1227 13 mi on 2nd S.R. No.

SUBDIVISION NAME Lake Norman LOT NO. 40 SECTION OR BLOCK NO. 2

House ( ) Mobile Home (✓) Business ( ) Other

No. Bedrooms 3 No. Bathrooms 2

Garbage Disposal Unit Yes ( ) No (✓)

Auto. Dishwasher Yes ( ) No (✓)

Auto. Wash. Machine Yes (✓) No ( )

Site Suitable Yes (✓) No ( )

Lot Area 1 acre


Character & Porosity of Soil Clay loam Fair

Percolation Rate 5 in 1 Days

Topography 2% Slope

Depth to Water Table 6' to 6'

Rock or other impervious formations None

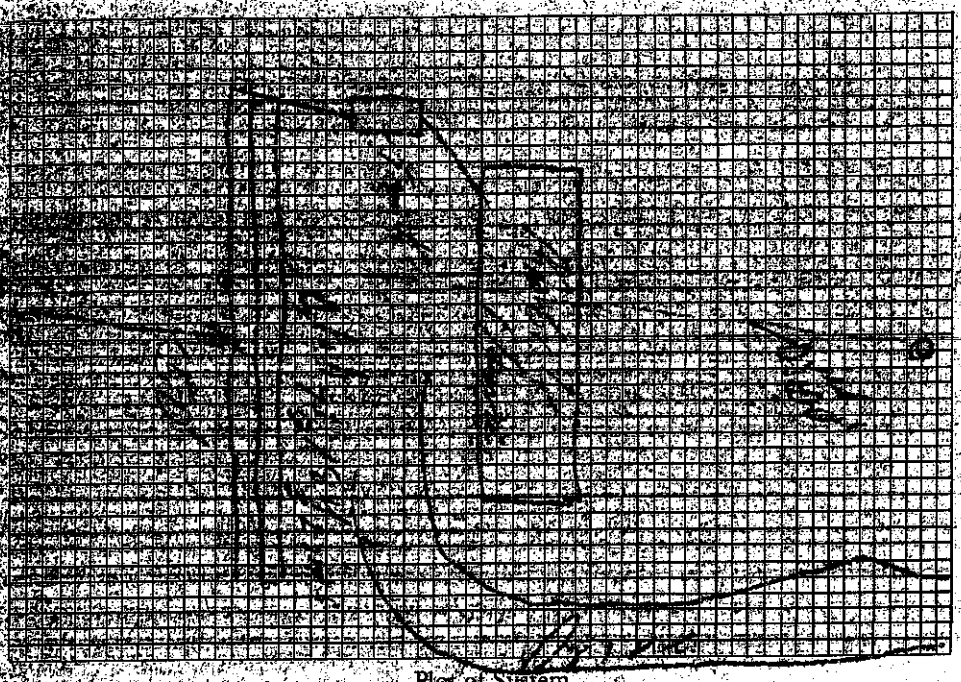

Plot of System

Size of Tank 1000 Gals.

Nitrification Field:

No. of Lines 3

Sq. Ft. 225 Linear Ft. 250

Depth of Stone in Lines 12"

Water Supply: Individual (✓)

Public ( )

Installed by Eureka Septic Tank

IMPROVEMENTS PERMIT BY [signature]

COMMENTS:

CERTIFICATE OF COMPLETION BY [signature] DATE 6-30-76

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Bruce Mason DATE 7-12-96 PERMIT NO. 233

PHONE: Business 873-4382 Home

LOCATION 150 West TL on 1180 Then TR on 1021 1½ mi on left S. R. No.

SUBDIVISION NAME Lake Norman LOT NO. 40 SECTION OR BLOCK NO. 10

House ( ) Mobile Home (✓) Business ( ) Other

No. Bedrooms 3 No. Bathrooms 2

Garbage Disposal Unit Yes ( ) No (✓)

Auto. Dishwasher Yes (✓) No ( )

Auto. Wash. Machine Yes (✓) No ( )

Sump Pump Yes ( ) No (✓)

Lot Area 2 Acres


Character & Porosity of Soil Clay loam Porosity Fair

Percolation Rate 5 gal 3 borings

Topography 25% Slope

Depth to Water Table 6+ ft. to lake level

Rock or other impervious formations None

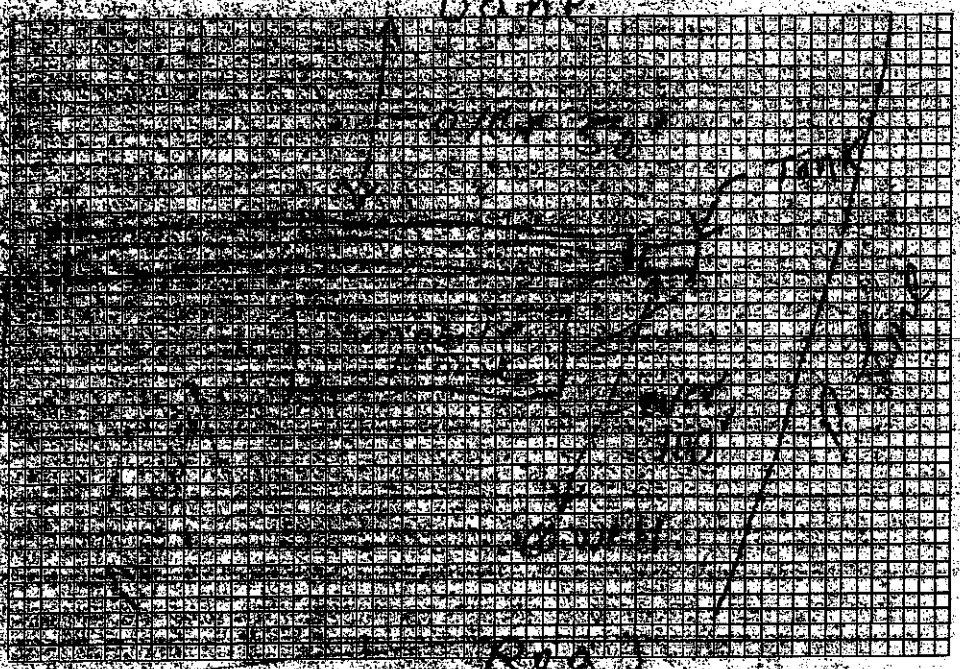

Plot of System

Size of Tank 1000 Gals.

Nitrification Field:
No. of Lines 3
Sq. Ft. 625 Linear Ft. 550

Depth of Stone in Lines 18"

Water Supply: Individual (✓)
Public ( )

Installed by

IMPROVEMENTS PERMIT BY L. C. Moore

COMMENTS: Set Mobile Home 70' back from high water mark of lake

CERTIFICATE OF COMPLETION BY DATE

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold