
C:\DrawingFiles\Custom Plans\Wyndham\44 Edgewater\1stFloorPlan.dwg, 01/12/2005 11:03:43 AM

CABINET BLOCKING NOTES	
VANITY BASE BATH CABINETS	30" CENTER ABOVE FINISHED FLOOR
KITCHEN BASE CABINETS	34 1/2" CENTER ABOVE FINISHED FLOOR
BOTTOM OF WALL UPPER	54" CENTER ABOVE FINISHED FLOOR
TOP OF WALL UPPER 30" CABINET	84" CENTER ABOVE FINISHED FLOOR
TOP OF WALL UPPER 36" CABINET	90" CENTER ABOVE FINISHED FLOOR
TOP OF WALL UPPER 42" CABINET	96" CENTER ABOVE FINISHED FLOOR

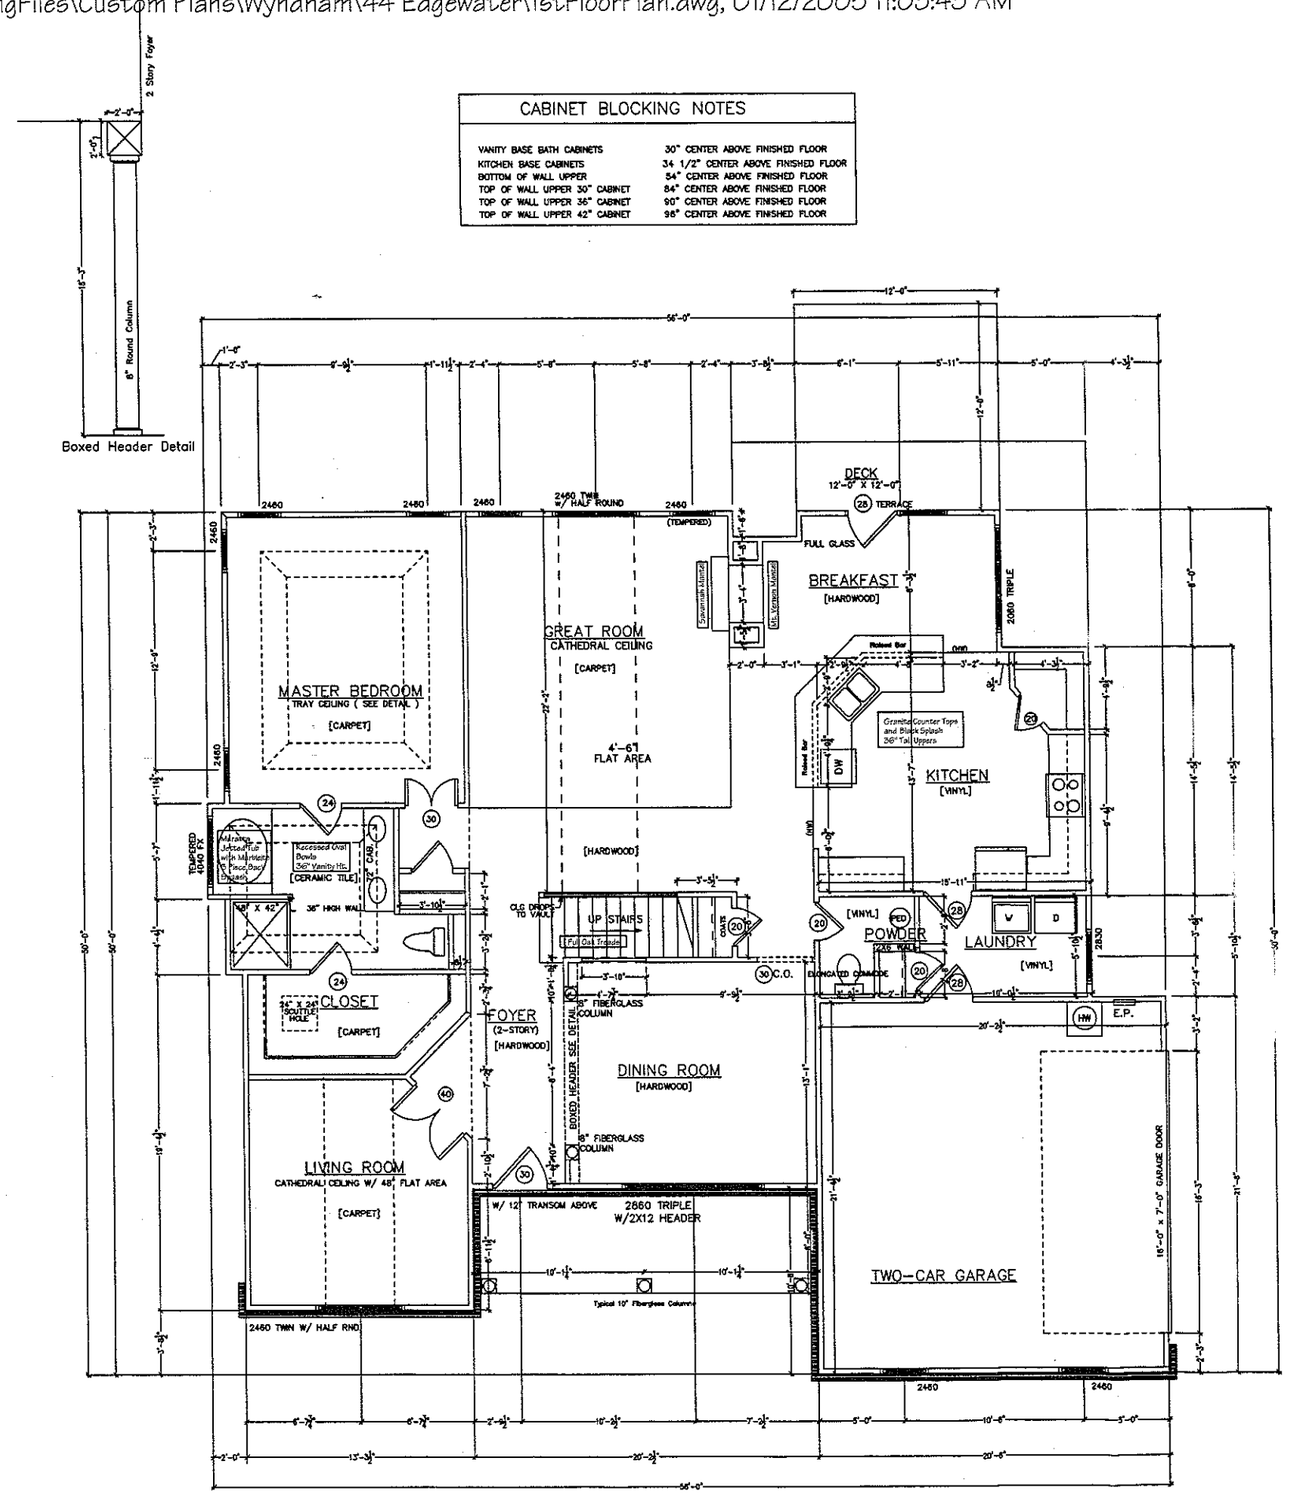

FRAMING CONSTRUCTION - OTHER THAN ROOF


1. CRAWLSPACE GIRDERS AND BAND WITH 4" CURTAIN WALL AND PIER CONSTRUCTION SHALL BE 2-2X12 @2 S.P.F., UNLESS OTHERWISE NOTED
2. ALL EXTERIOR STUD WALLS SHALL BE 2X4'S @ 16" O.C. UNLESS OTHERWISE NOTED. ALL INTERIOR WALLS SHALL BE 2X4'S @ 16" O.C. (SEE PLAN FOR 2X6 INTERIOR WALL). ALL LUMBER CAN BE #2 S.P.F. UNLESS NOTED OTHERWISE
3. STEEL BEAMS MUST HAVE 8- 2X4 STUD JACKS UNDER EACH AND SUPPORT UNLESS OTHERWISE NOTED
4. WOOD GIRDER BEAMS MUST HAVE 3- 2X4 STUD JACKS UNDER EACH AND SUPPORT UNLESS OTHERWISE NOTED
5. MASONRY LINTELS:
   (a) FOR SPANS UP TO 6'-0" USE 3 1/2" X 3 1/2" X 1/4" STEEL ANGLES
   (b) FOR SPANS FROM 6'-0" TO 9'-0" USE 5" X 3 1/2" X 5/16" STEEL ANGLES
   (c) FOR SPANS FROM 9'-0" TO 14'-0" USE 3 PAIR OF 8 GAUGE WIRE IN FIRST 3 COURSES OF BRICK ON A 8" X 5 1/2" X 5/16" STEEL ANGLE. LAP ALL 8 GAUGE WIRE SPACES 12" MINIMUM. TEMPORARY SUPPORT STEEL ANGLE BEFORE LAYING MASONRY FOR 3 DAYS FOLLOWING INSTALLATION OF MASONRY
6. ALL BRICK OVER LOWER ROOFS MUST HAVE ANGLE WITH STOPS LAQ SCREWED TO STUDS ABOVE IN ACCORDANCE WITH DETAIL
7. ALL WORK I-JOISTS AND OPEN JOISTS MUST BE BRACED IN ACCORDANCE WITH MANUFACTURERS DIRECTIONS PLUS DETAILS SHOWN ON PLANS. LOAD-BEARING PARTITIONS UNDER CEILING JOISTS OR COLUMN SUPPORTS MUST BE SOLID BLOCKED THROUGH FLOOR TO CARRY LOADS TO SUPPORTING MEMBERS AND BEAMS TO FOUNDATION. ALL POINT LOADS MUST BE CARRIED DOWN THROUGH LOAD BEARING WALLS. ALL POINT LOADS MUST BE CARRIED TO FOUNDATIONS WITH BLOCKING AND/OR BEAMS
8. ALL RAFTER BRACES MUST HAVE 2-STUDS FIRM PLATED TO FOUNDATION OR WEAR BELOW THEM AT ALL FLOORS. NO BRACES ON CEILING PLATE WITHOUT STUDS DIRECTLY UNDER THEM
9. WHERE PARTITIONS FALL BETWEEN FLOOR TRUSSES 2X4 LADDERS @ 16" O.C. MUST BE PLACED PERPENDICULAR TO THE TRUSSES TO SUPPORT THE PLYWOOD DECKING
10. ON ALL OPEN WEB FLOOR TRUSSES OVER 10'-0" SPAN A MINIMUM SINGLE LINE OF 2X4'S SHALL BE NAILED TO DIAGONAL MEMBERS OR VERTICAL MEMBERS AT APPROXIMATE MID-SPAN AS A LATERAL DISTRIBUTION MEMBER IF LINE OF TIE MEMBER IS NOT CONTINUOUS, LAP ALL OFF-LINE MEMBERS TO ONE SPACE.
11. WHERE CEILING JOISTS ARE PARALLEL TO EXTERIOR WALLS AND RAFTERS BEAR ON STUD WALL TOP PLATE ADJACENT TO CEILING JOISTS, BRACE RAFTERS AND TOP PLATE TO 2X6 NOGS 4'-0" LONG MINIMUM ON 8'-0" CENTERS ALONG LENGTH OF CEILING JOISTS. BRACES SHOULD BE AT APPROXIMATELY AT 60 DEGREE ANGLE
12. ALL 2- STORY OPEN FAMILY ROOMS, LIVING ROOM, WITH 3 OR MORE ADJACENT OPENINGS AND A SPACING BETWEEN OPENINGS OF 3 FEET OR LESS MUST USE A 3 1/2" X 3 1/2" X 1/4" STEEL ANGLE VERTICALLY FROM FLOOR TO TOP PLATE LAGGED TO 2X6 STUDS WITH 3/8"X3" LAGS @ 24" O.C. VERTICALLY AND LAGGED TO FLOOR AND TOP PLATE WITH (1) 3/4" X 3" LAG THROUGH A 1/4" PLATE AT THE TOP AND BOTTOM. MULTIPLE OPENINGS WITH 3'-0" OR LESS SPACE BETWEEN ROUGH OPENINGS SHALL HAVE ATLEAST ONE STEEL ANGLE VERTICALLY IN EACH MULLION SPACE. THE SHEATHING ON THIS STEEL REINFORCED PARTITION SHALL BE 1/2" PLYWOOD, NO OTHER SHEATHING WILL BE PERMITTED.
13. HEADERS SHALL BE AS SHOWN UNLESS OTHERWISE NOTED:

(a) INTERIOR

(1) SPANS UP TO	3'-6"	4-2X6's	NO JACK
(2) SPANS 3'-7" TO	5'-0"	4-2X8's	1 JACK
(3) SPANS 5'-1" TO	6'-6"	4-2X10's	2 JACK
(4) SPANS 6'-7" OR MORE			AS PLAN

(b) EXTERIOR

(1) SPANS UP TO	3'-6"	4-2X6's	NO JACK
(2) SPANS 3'-7" TO	5'-0"	4-2X8's	1 JACK
(3) SPANS 5'-1" TO	6'-6"	4-2X10's	2 JACK
(4) SPANS 6'-7" OR MORE			AS PLAN

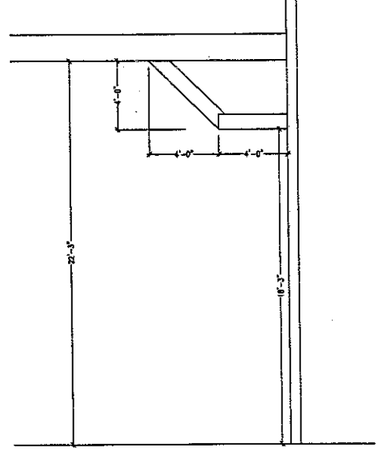

TRAY CEILING DETAIL

AREA CALCULATIONS

First Floor Heated: 1864 sf
Second Floor Heated: 905 sf
Garage: 436 sf
Porch: 108 sf
Deck: 144 sf
TOTAL AREA 3313 sf

HBLOCK DEVELOPMENT CORPORATION
300 MCGILL AVENUE N.W.
CONCORD, NC
(704) 788-4818 FAX (704) 784-3720

LOT #44
EDGEWATER PARK

FIRST FLOOR
FLOOR PLAN

DATE: 12/20/2004
PLAN: WYNDHAM
SCALE: 1/4"=1'-0"
DRAWN BY: WCO
ESTIMATED BY: TM
CHECKED BY: MN