9637551698

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Laura Parker DATE 11/24/87 PERMIT NO.

PHONE: Business Home

LOCATION 150 W. TL Dobbie Rd. TR Whippoorwill 1st lot on left

SUBDIVISION NAME L and T LOT NO. 1167 SECTION OR BLOCK NO. 10 S. R. No.

Future Temp

House (✓) Mobile Home ( ) Business ( ) Other

No. Bedrooms 3 No. Bathrooms 2


Garbage Disposal Unit Yes (✓) No ( )
Auto. Dishwasher Yes (✓) No ( )
Auto. Wash. Machine Yes (✓) No ( )
Site Suitable Yes ( ) No ( )

Lot Area ~2 ACRE

Character & Porosity of Soil Clay
Percolation Rate ~.4 gpd / ft²
Topography 10 - 25%
Depth to Water Table 4'+
Rock or other impervious formations None Observed

Drainageway

___ Basement with Plumbing ___ Basement without Plumbing ___ No Basement

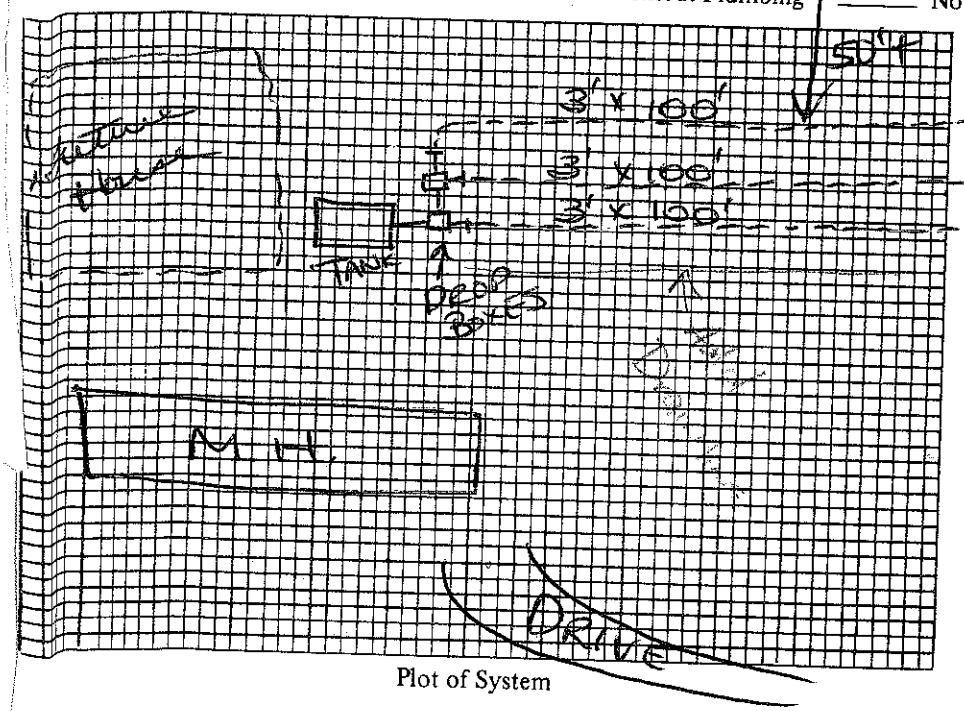

Plot of System

Size of Tank 1250 Gals.

Nitrification Field:
No. of Lines 3
Sq. Ft. 900 Linear Ft. 300

Depth of Stone in Lines 12"

Water Supply: Individual (✓)
Public ( )

Installed by Kenneth Gilreath

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed:

IMPROVEMENTS PERMIT BY DRH, RS

COMMENTS: See file for comments (KKG)

CERTIFICATE OF COMPLETION BY DATE 11/24/87

EXISTING SYSTEM CHECKED BY: DATE

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold