08809

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Thomas Casey DATE June 17, '88 PERMIT NO. _____

PHONE: Business _____ Home _____

LOCATION 150 W. to 1180 (Doolie Rd.) ~2nd lot on Rt past 1221 (Whippoorwill) S. R. No. _____

SUBDIVISION NAME Cat Lake Norman LOT NO. 168 SECTION OR BLOCK NO. 10

Future Temp

House (✓) Mobile Home (✓) Business ( ) Other _____

No. Bedrooms 4 No. Bathrooms 3

Garbage Disposal Unit Yes (✓) No ( )

Auto. Dishwasher Yes (✓) No ( )

Auto. Wash. Machine Yes (✓) No ( )

Site ~~Suitable~~ PS Yes (✓) No ( )

Lot Area 1.9 Ac

Character & Porosity of Soil Clay


Percolation Rate ~35

Topography 4-10%

Depth to Water Table 6'+

Rock or other impervious formations none obs.

_____ Basement with Plumbing _____ Basement without Plumbing _____ No Basement

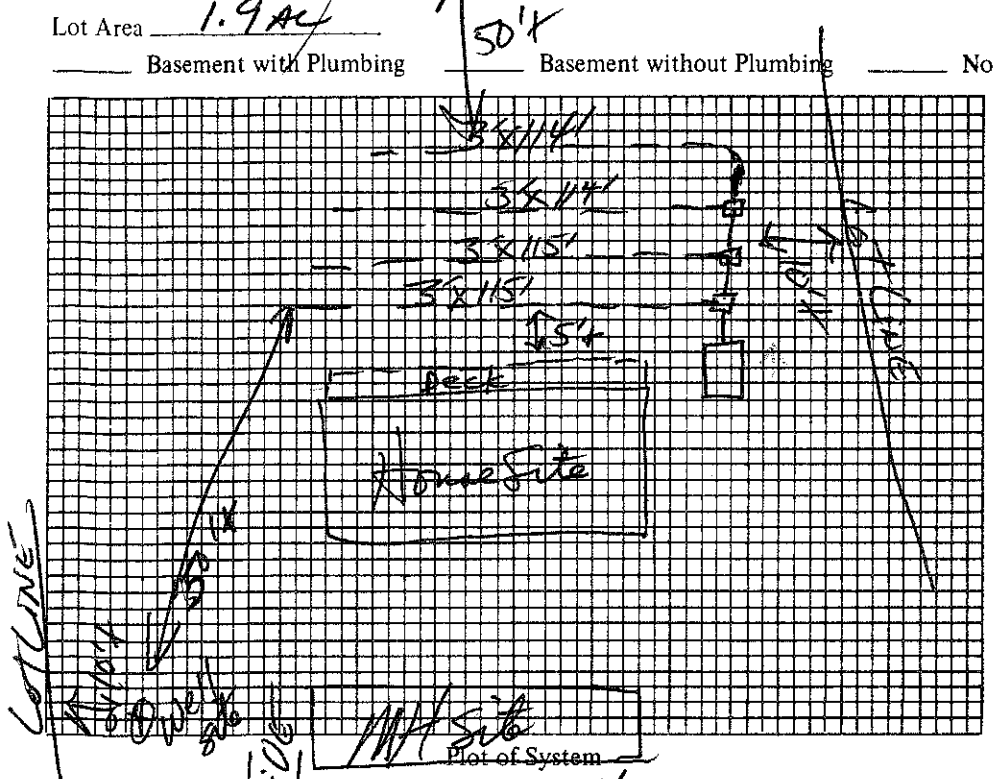

Size of Tank 1500 Gals.

Nitrification Field:

No. of Lines 4

Sq. Ft. 137 Linear Ft. 457

Depth of Stone in Lines 12"

Water Supply: Individual (✓)

Public ( )

Installed by Denver Plumbing

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY DRH

COMMENTS: TPO Drive

CERTIFICATE OF COMPLETION BY J. M. Jenson, R.S. DATE June 17, '88

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

08809 3-3

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System — G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Thomas Casey DATE May 24, '88 PERMIT NO. ____

PHONE: Business ____ Home ____

LOCATION 150 W. JL 1180 (Doolie Rd.) 2nd lot on Rt. past 1221 (Whippoorwill) S. R. No. ____

SUBDIVISION NAME CL&T LAKE NORMAN LOT NO. 1168 SECTION OR BLOCK NO. 10

Future Temp.

House (✓) Mobile Home (✓) Business ( ) Other ____

No. Bedrooms 4 No. Bathrooms 3

Garbage Disposal Unit Yes (✓) No ( )

Auto. Dishwasher Yes (✓) No ( )

Auto. Wash. Machine Yes (✓) No ( )

Site ~~Suitable~~ PS Yes (✓) No ( )

Lot Area 1.9 Ac

Character & Porosity of Soil clay


Percolation Rate ~.35

Topography 4-10%

Depth to Water Table 4'+

Rock or other impervious formations none obs.

✓ Basement with Plumbing ____ Basement without Plumbing ____ No Basement

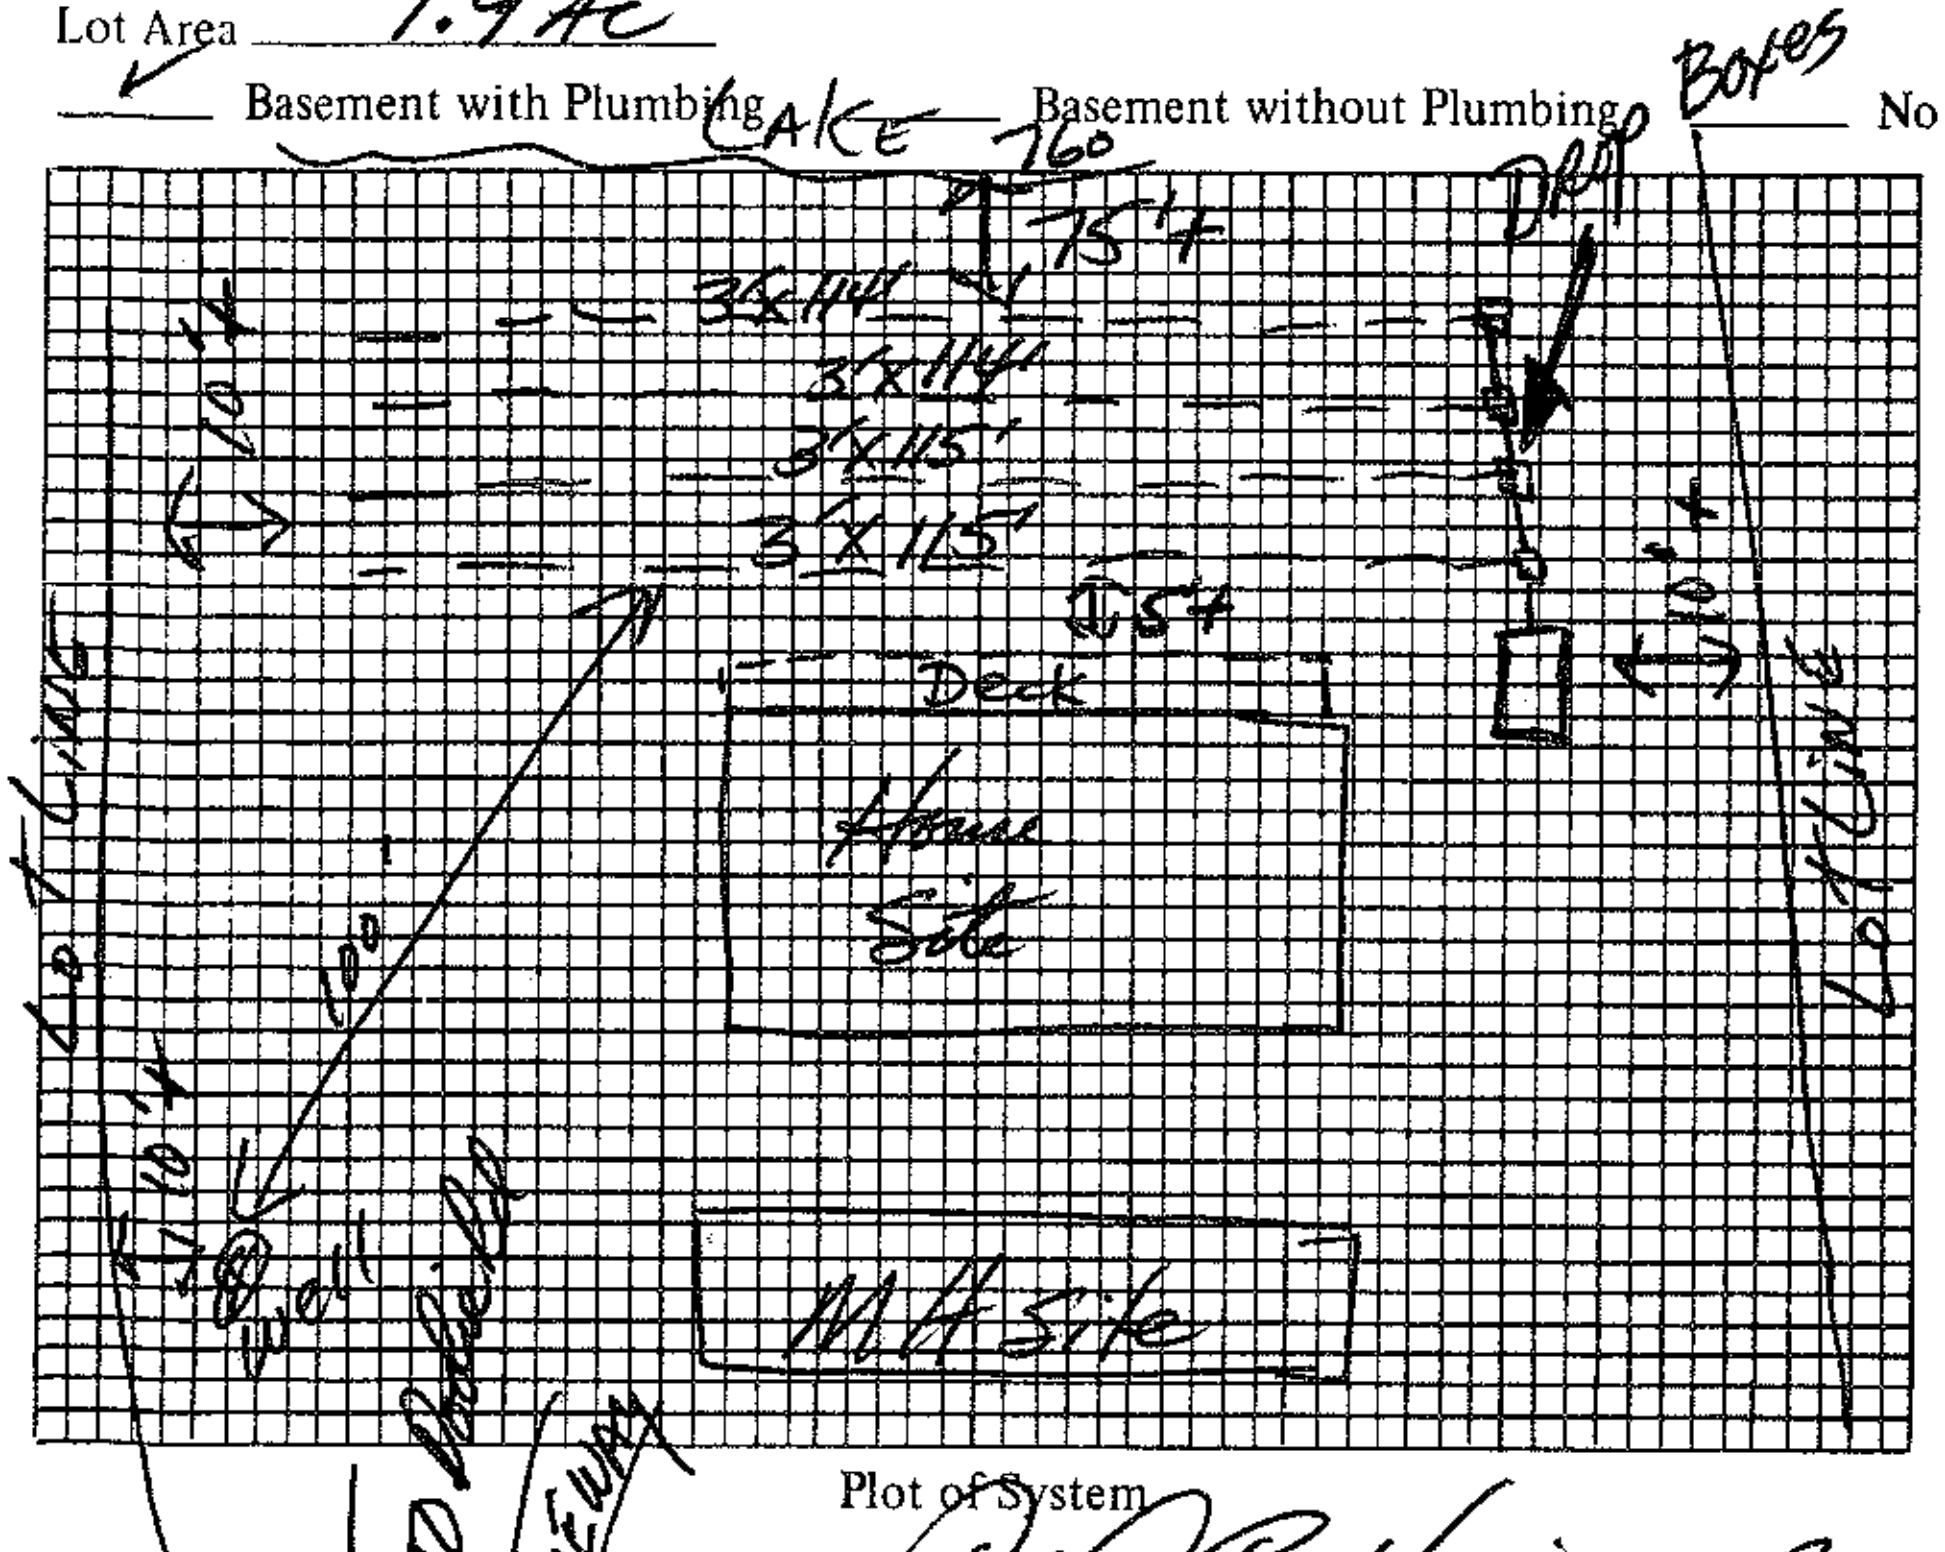

Size of Tank 1500 Gals.

Nitrification Field:

No. of Lines 4

Sq. Ft. 1371 Linear Ft. 457

Depth of Stone in Lines 12"

Water Supply: Individual (✓)

Public ( )

Installed by ____

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: × Stanley A Braun

Plot of System

IMPROVEMENTS PERMIT BY David R Hinson, R.S.

COMMENTS: Install drainfield on contour and with 18" cover over stone. May use flow dividers if desired. Future repair next to street (pumped)

CERTIFICATE OF COMPLETION BY ____ DATE ____

EXISTING SYSTEM CHECKED BY: ____ DATE ____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold