4638-07-3339

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Richard Camery DATE 5/13/88 PERMIT NO. _____

PHONE: Business _____ Home _____

LOCATION 1303 N TL 1300 (Fern Hill Rd.) near end on left (just past 2nd Broadview Lane) S. R. No. _____

SUBDIVISION NAME CL&T Lake Norman LOT NO. 1009 SECTION OR BLOCK NO. 15


House (X) Mobile Home ( ) Business ( ) Other _____

No. Bedrooms 3 No. Bathrooms 2

Garbage Disposal Unit	Yes ( )	No (✓)	Character & Porosity of Soil	P.S. Clay	
Auto. Dishwasher	Yes (✓)	No ( )	Percolation Rate	~.4 gpd/ft²	
Auto. Wash. Machine	Yes (✓)	No ( )	Topography	P.S. near Road 9-8%	
Site Suitable	Yes (✓) well	No ( )	Depth to Water Table	4'+	
			Rock or other impervious formations	none obs.	

Lot Area 1 ACRE +

_____ Basement with Plumbing _____ Basement without Plumbing _____ No Basement 1000gal P.T.

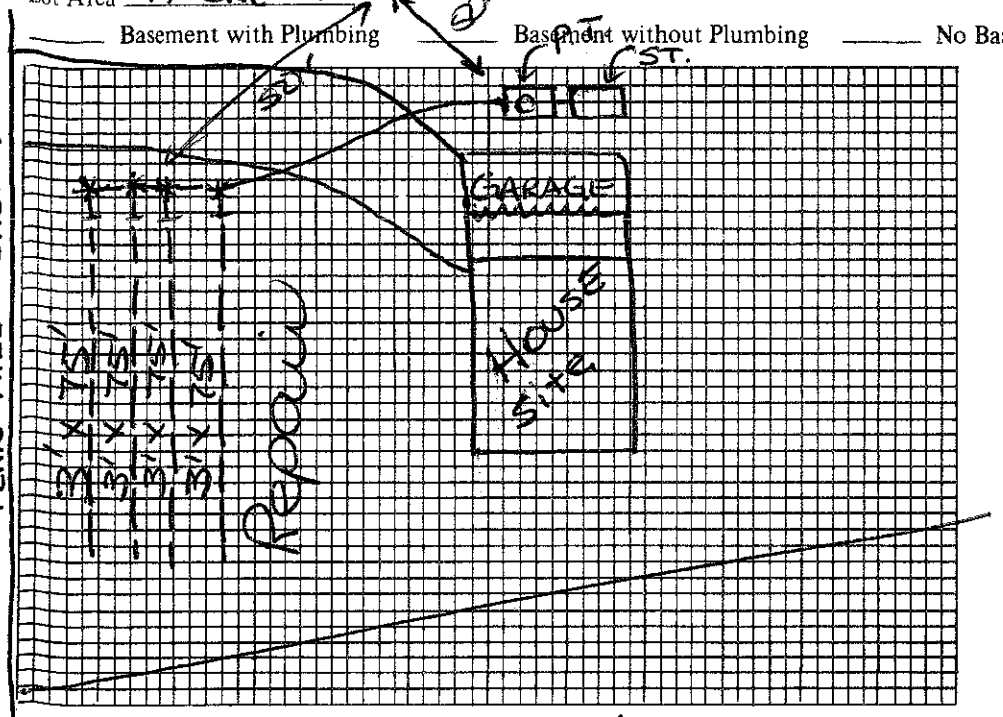

Plot of System NTS.

Size of Tank 1000 Gals.

Nitrification Field:
No. of Lines 4
Sq. Ft. 900 Linear Ft. 300
Depth of Stone in Lines 12"

Water Supply: Individual (X)
Public ( )

Installed by Larry Beam

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY DRH

COMMENTS: Hinson ckd system. Pierce ckd Alarm 5/13/88

CERTIFICATE OF COMPLETION BY Andrew C. Green DATE 5/13/88

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold