
Acknowledgement Of
Plans Submittal ONLY!
Maria Dolan Date 5/30/06
Date

SERIAL # X MODULAR
SERIAL # X HUD CODE

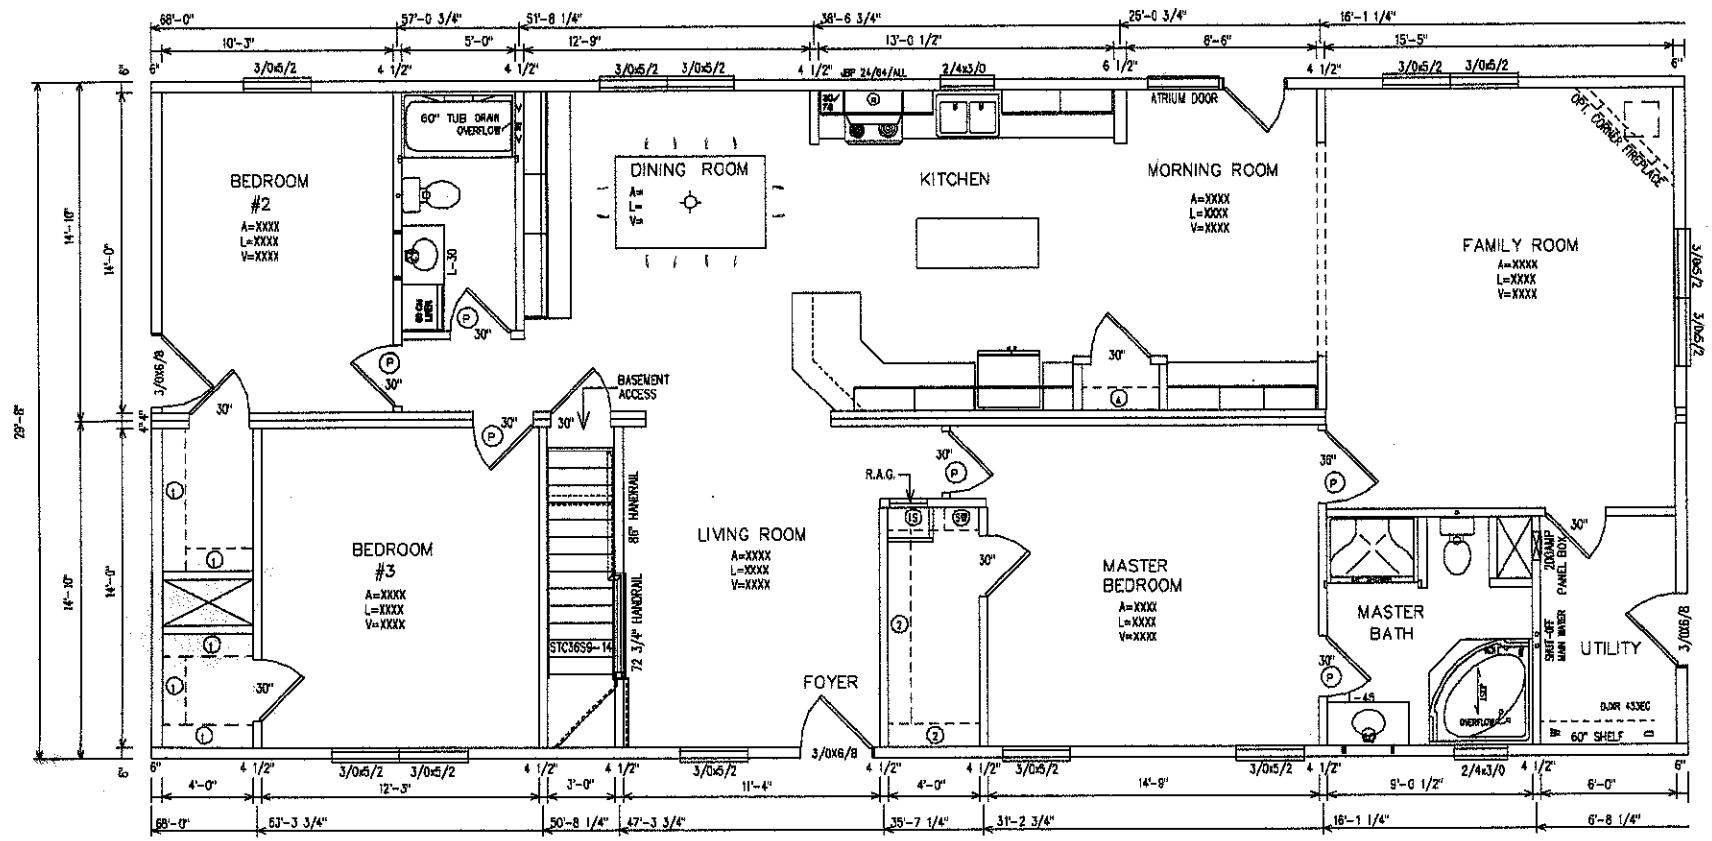

EGRESS NOTE :
EGRESS WINDOWS MUST HAVE A MINIMUM NET CLEAR OPENING OF 5.7 SQ. FT. (5.0 SQ. FT. AT GRADE LEVEL). THE MINIMUM CLEAR WIDTH SHALL BE 20 INCHES, THE MINIMUM CLEAR HEIGHT SHALL BE 24 INCHES. THE SILL HEIGHT SHALL NOT EXCEED 44 INCHES ABOVE THE FLOOR. ALL MUST BE OPERABLE FROM THE INSIDE WITHOUT THE USE OF SEPERATE TOOLS.

FLAMESPREAD NOTE :
ALL WALL AND CEILING FINISHES MUST HAVE A FLAMESPREAD CLASSIFICATION OF LESS THAN 200. THE SMOKE DENSITY DEVELOPMENT RATING SHALL NOT BE GREATER THAN 450. ALL SMOKE DETECTORS ARE PROVIDED WITH A BATTERY BACKUP.

STANDARD
TOTAL GLASS R.O.=

(15) =SHELF & ROD W/SHOE RACK UNDERNEATH			
(1) =1 SHELF	(2) =2 SHELVES		
(4) =4 SHELVES	(5B) =SWEATER SHELVES		
⊕ = DUCT CONNECTOR			
(6) =20"X25"RAG/DOOR	(7) =20"X25"RAG/WALL		
(8) =2"X10" OVER DOOR	(24) =24X42 MIRROR		
(5B) =58X42 MIRROR	(72) =72X42 MIRROR		

FLOOR PLAN LEGEND

E EGRESS WINDOW	T THERMOSTAT		
ELECTRICAL PANEL	S SMOKE DETECTOR		
A 22"x 30" ATTIC ACCESS	P PRIVACY LOCK		
R STEREO	SG SAFTEY GLAZED		

8'-0" FLAT THRU-OUT STD.
9'-0" FLAT THRU-OUT OPT.
8'-0" CATH. THRU-OUT OPT.

PLELIM LOG	
DATE	NAME
3/15/06	DWO

PRELIMINARY
JOB # 10900
DATE 3/15/06

THIS PLAN IS FOR PRELIMINARY PURPOSES ONLY. THIS PLAN IS SUBJECT TO REVISION DURING FINAL ENGINEERING REVIEW.

R-ANELL HOUSING GROUP, LLC
P.O. Box 428 Denver, N.C. 28037

TITLE:		DATE: 3/15/06	DRAWN BY: DWO	JOB NUMBER: 10900
DESCRIPTION: R-ANELL		SCALE: 3/16"=1'-0"	FILE NUMBER: XXXX	DRAWING NUMBER: