15026

IREDELL COUNTY HEALTH DEPARTMENT

IMPROVEMENT PERMIT AND CERTIFICATE OF COMPLETION / OPERATIONS PERMIT

OWNER OR CONTRACTOR Richard Kraushaar DATE 8/11/92 PERMIT NO. IP-13-A-10

PHONE: Business 563-7488 Home

LOCATION END OF NORMANDY RD. TL OFF PERTH RD

S.R. No.

SUBDIVISION NAME NORMANDY HILL LOT NO. 10 SECTION OR BLOCK NO.

House ☑ Mobile Home ☐ Business ☐ Other

No. Bedrooms 3 No. Bathrooms 2.5

Garbage Disposal Unit Yes ☑ No ☐

Auto. Dishwasher Yes ☑ No ☐

Auto. Wash. Machine Yes ☑ No ☐

Lot Area ~ 20,600 FT²

Soil Characteristics P - SC


Application Rate P - .4 (wk gran, SF)

Topography P - 3-5%

Depth to Water Table S >48"

Rock or other impervious formations S - None found

Basement with Plumbing ✓ (1/2) Basement without Plumbing No Basement ✓ Crawl Space

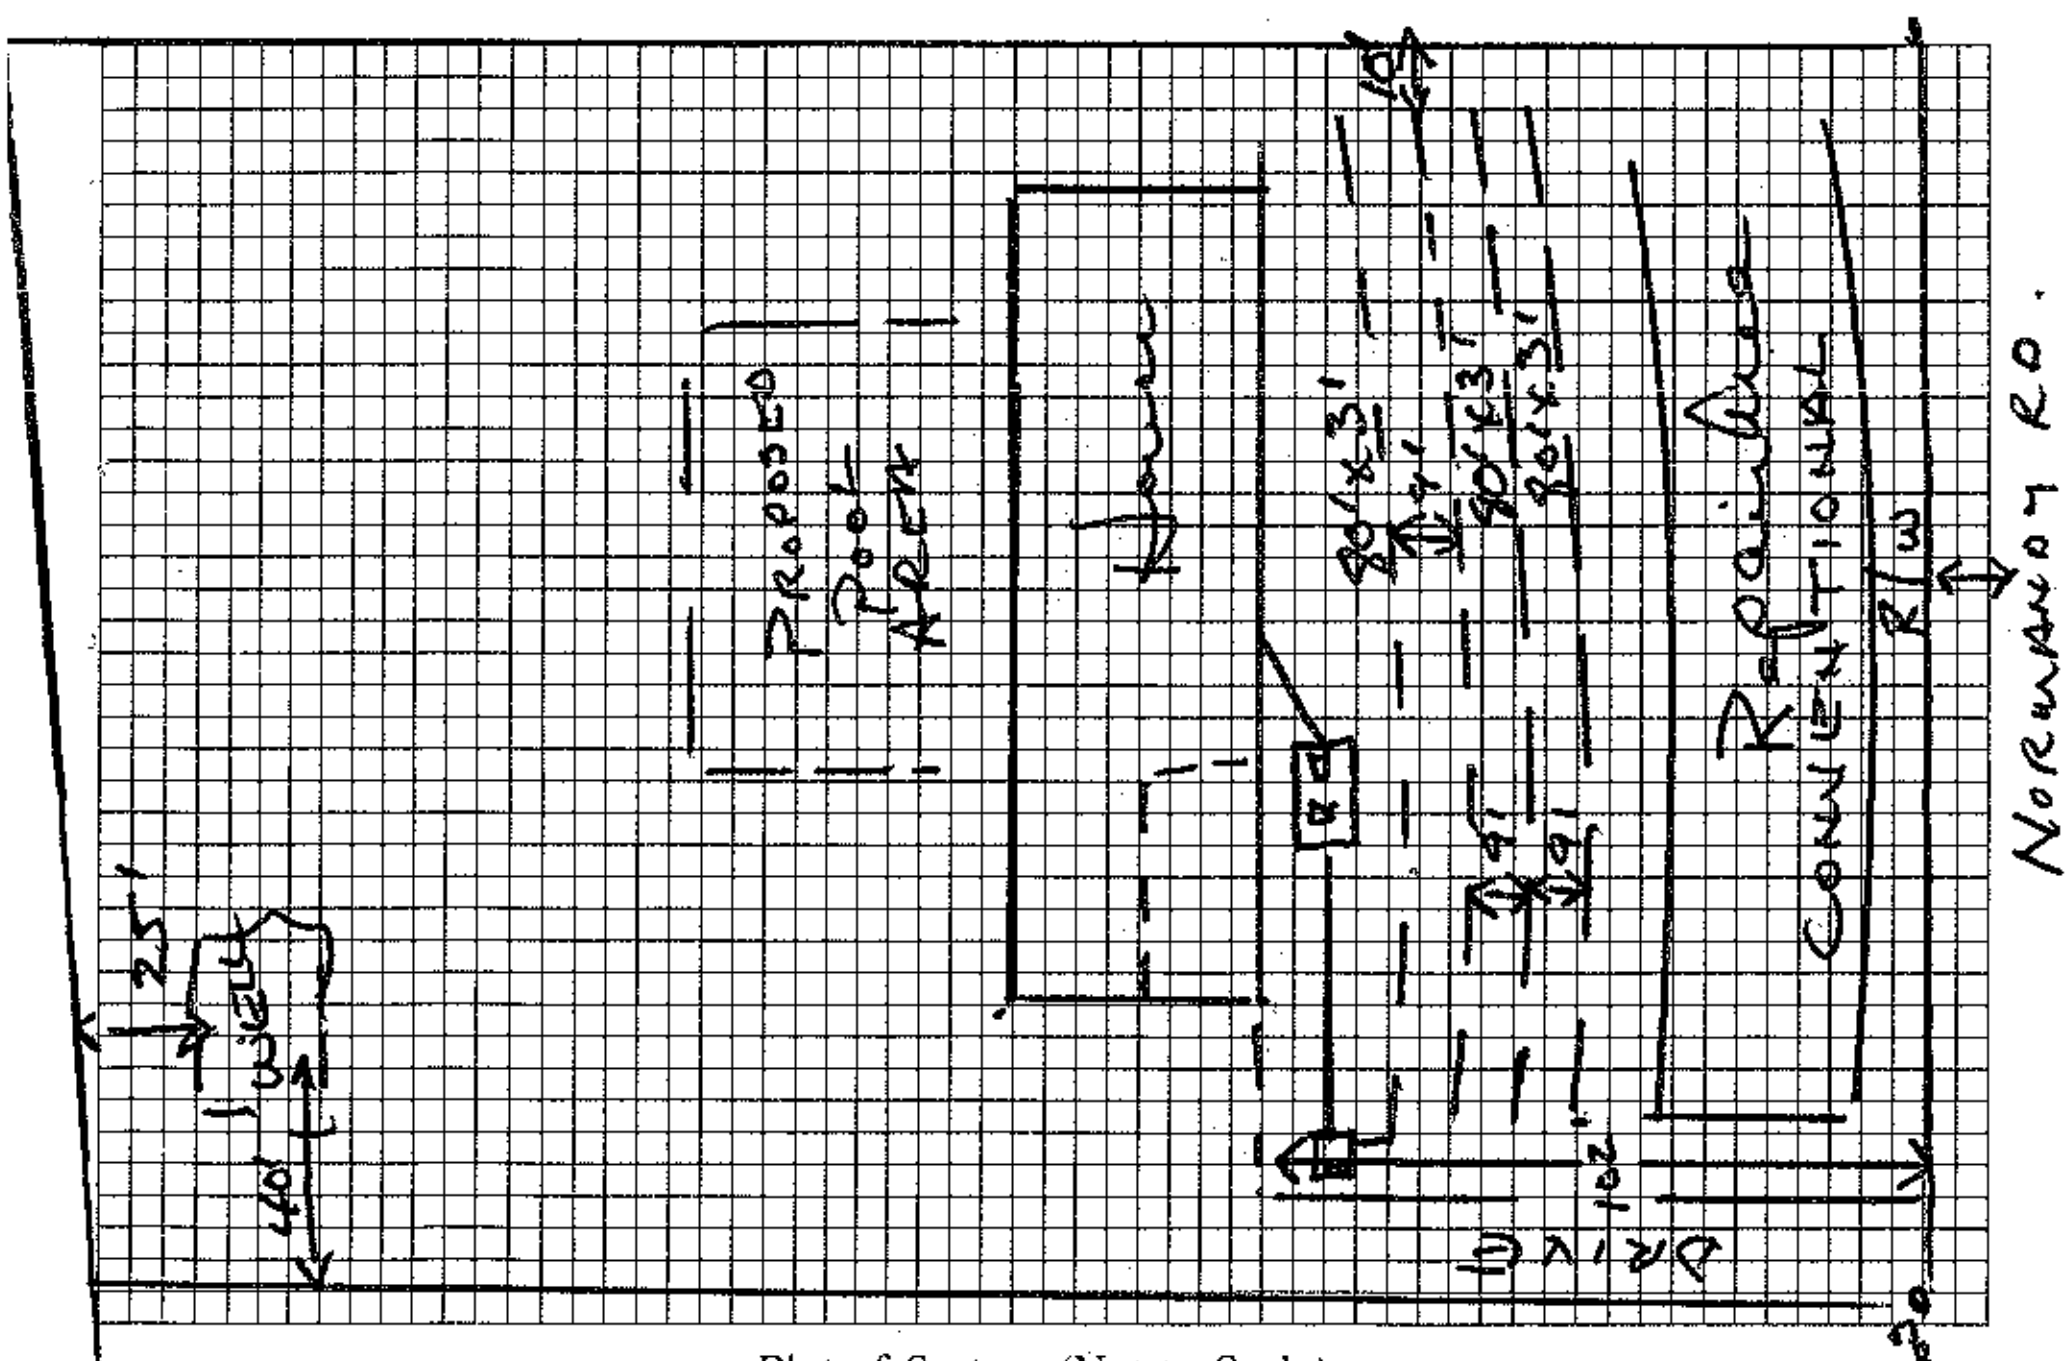

Plot of System (Not to Scale)

Size of Tank 1250 Gals.

Nitrification Field:

No. of Lines 4 @ 80' x 3'

Sq. Ft. 960 Linear Ft. 320

Depth of Stone in Lines 12"

Water Supply: Individual ☑ NOT DRILLED YET

Public ☐

Installed by

I understand and agree to install a septic tank system as specified on this Improvement Permit.

Signed: X [signature]

(IMPROVEMENT PERMIT IS VALID FOR 60 MONTHS FROM DATE OF ISSUE.)

IMPROVEMENT PERMIT BY Wesley Sparks RS.

COMMENTS

CERTIFICATE OF COMPLETION BY DATE

EXISTING SYSTEM CHECKED BY DATE

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS

Permit is VOID if any unauthorized changes are made in installation of system, and/or if any unapproved changes are made to the site, and/or if any false information is supplied toward securing Improvement Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold