07266 4638435364

# IREDELL COUNTY HEALTH DEPARTMENT

## (SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Hubert R. Hass Jr. DATE Mar 23, 88 PERMIT NO. ____

PHONE: Business ____ Home ____

LOCATION 150 W TR 1303 (Perth Rd) TR 1428 (Normandy Rd) 1 1/4 miles on lt S. R. No. ____

SUBDIVISION NAME CL & T LAKE NORMAN LOT NO. 120 SECTION OR BLOCK NO. 11

House (✓) Mobile Home ( ) Business ( ) Other Addition to existing system

No. Bedrooms 3 No. Bathrooms 3

Garbage Disposal Unit Yes ( ) No (✓)

Auto. Dishwasher Yes (✓) No ( )

Auto. Wash. Machine Yes (✓) No ( )

Site ~~Suitable~~ PS Yes (✓) No ( )

Lot Area Existing 1/2-3/4 Ac

Character & Porosity of Soil clay


Percolation Rate .4

Topography 2-4%

Depth to Water Table 4'+

Rock or other impervious formations none obs

____ Basement with Plumbing ____ Basement without Plumbing ✓ No Basement

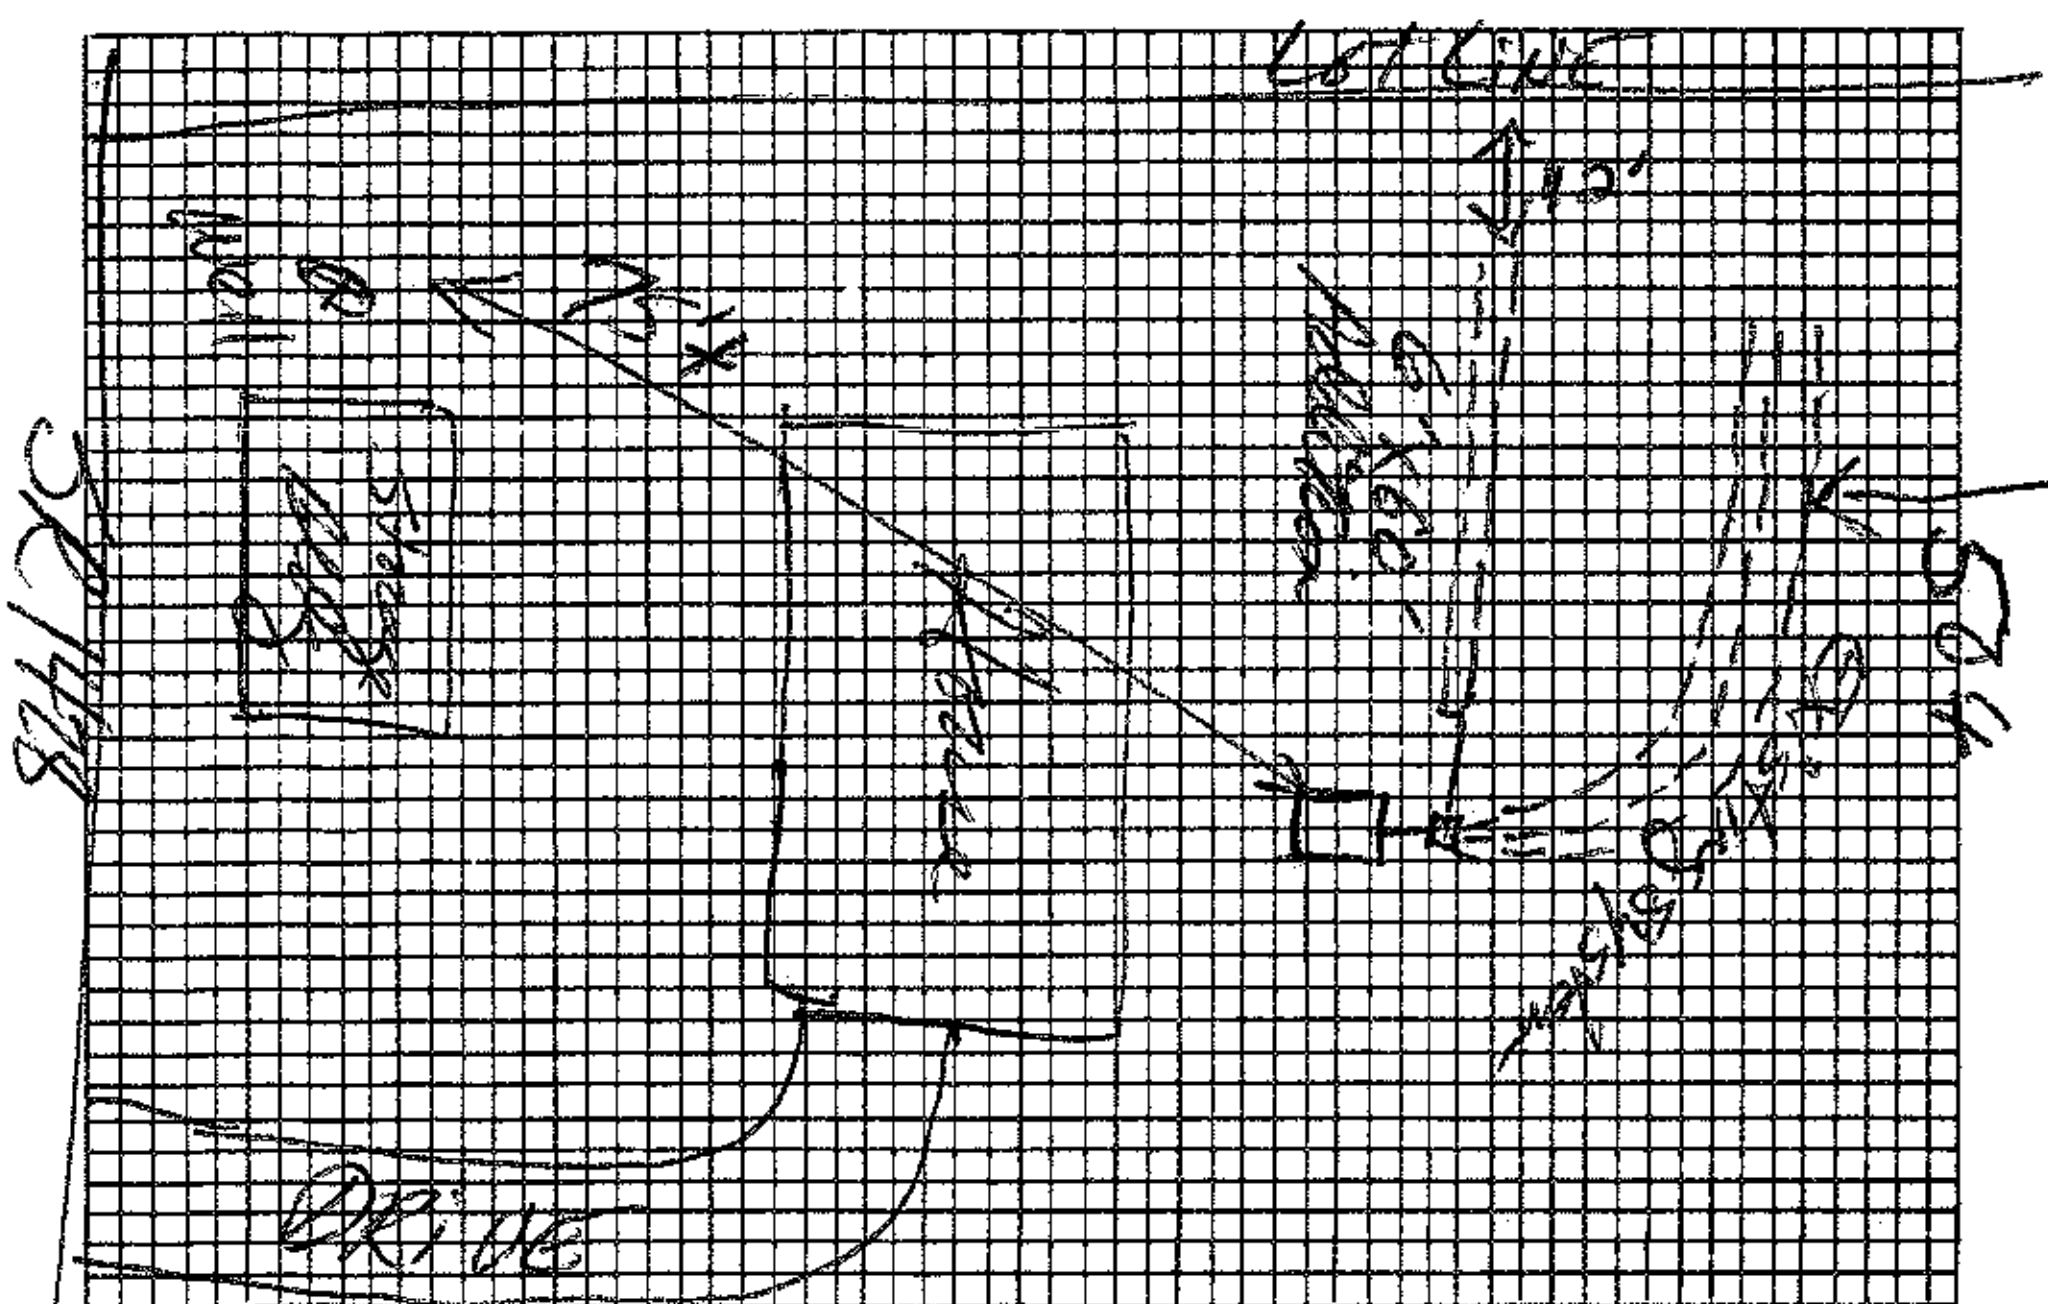

Plot of System

Size of Tank Existing (1000) Gals.

Nitrification Field:

No. of Lines 1 (6'x60 Bed)

Sq. Ft. 360 Linear Ft. 120

Depth of Stone in Lines 12"

Water Supply: Individual (✓)

Public ( )

Installed by DL Parker Mecklenburg Co.

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: ____

IMPROVEMENTS PERMIT BY [signature]

COMMENTS: ____

CERTIFICATE OF COMPLETION BY [signature], RS DATE 3-23-88

EXISTING SYSTEM CHECKED BY: ____ DATE ____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

07266

# IREDELL COUNTY HEALTH DEPARTMENT

## (SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Hubert R. Hess Jr. DATE 8-26-87 PERMIT NO. _____

PHONE: Business _____ Home _____

LOCATION 1393 N. TR 1428 (Normandy Road) ~ 1/4 miles on Rt. S. R. No. _____

SUBDIVISION NAME CLOT Lake Norman LOT NO. 120 SECTION OR BLOCK NO. 11

House (✓) Mobile Home ( ) Business ( ) Other Repair Addition Lake

No. Bedrooms 3 No. Bathrooms 3

| | | | |
|---|---|---|---|
| Garbage Disposal Unit | Yes ( ) | No (✓) | |
| Auto. Dishwasher | Yes (✓) | No ( ) | |
| Auto. Wash. Machine | Yes (✓) | No ( ) | |
| Site Suitable | Yes ( ) | No ( ) | |

Character & Porosity of Soil _____

Percolation Rate _____


Topography _____

Depth to Water Table _____

Rock or other impervious formations _____

Lot Area EXISTING Existing lines

_____ Basement with Plumbing _____ Basement without Plumbing ___✓___ No Basement

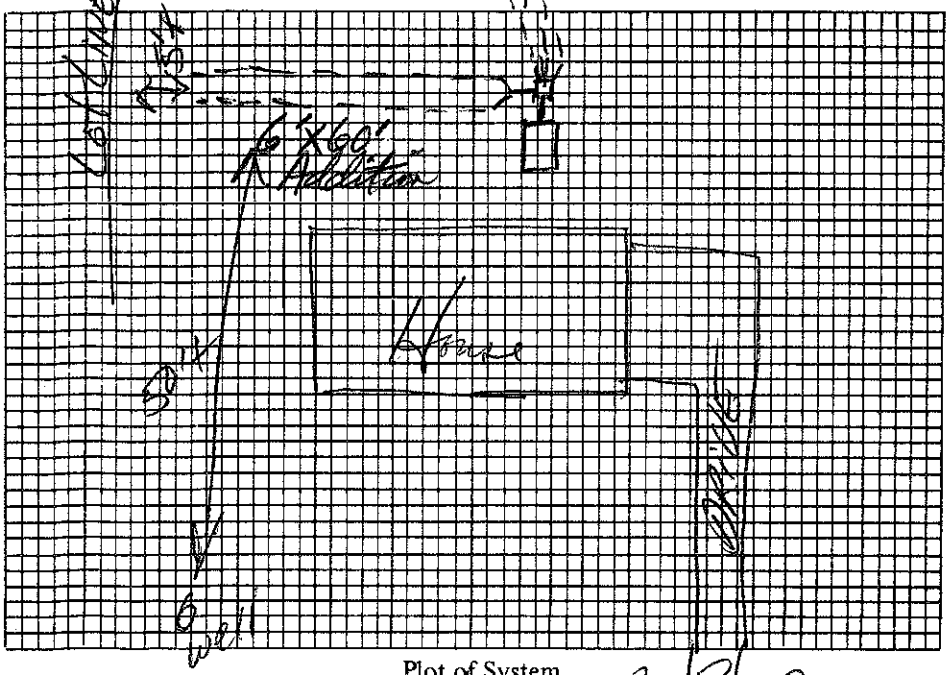


Plot of System

Size of Tank Existing Gals.

Nitrification Field:

No. of Lines 1 (6"x60' Bed)

Sq. Ft. 360 Linear Ft. 120

Depth of Stone in Lines 12"

Water Supply: Individual (✓)

Public ( )

Installed by _____

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: H. Ross Hess Jr

IMPROVEMENTS PERMIT BY Normandy Road Daniel R. Hinson, RS.

COMMENTS: Addition of drainfield to bring up to minimum required for 3 bedroom structure.

CERTIFICATE OF COMPLETION BY _____ DATE _____

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold