DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM


OWNER: Stumpy Creek LLC APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: 6-4-98
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____
LOCATION OF SITE: Lot 49 Scott Hunter Landing PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other ☐
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

Need more pits sp some @ more sp

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-3	gr-brn sl	fr					PS .03 @ 33"
		3-33	sbk rc/cl	fi-fr sp-ss sp-se sp					
		33-60	wk sbk/str-massive	l-sl sp fr ss sp					
				Lots like gr sp sp @ 60"					
2		0-3	gr brn scl	fr					PS .03
		3-23	sbk rc	fi sp se sp					
		23-50	wk sbk rc/fr	fr ss sp se sp					
3		0-21	sbk r cl	fr ss sp					
		21-46	massive cl sp se sp	fi/fr cl sp		(4)			
			maybe weak sbk ~60"						
4	7-6-98	0-46	sbk rc/cl	fi sp ss sp se sp					PS .03

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____
EVALUATED BY: _____
OTHER(S) PRESENT: _____

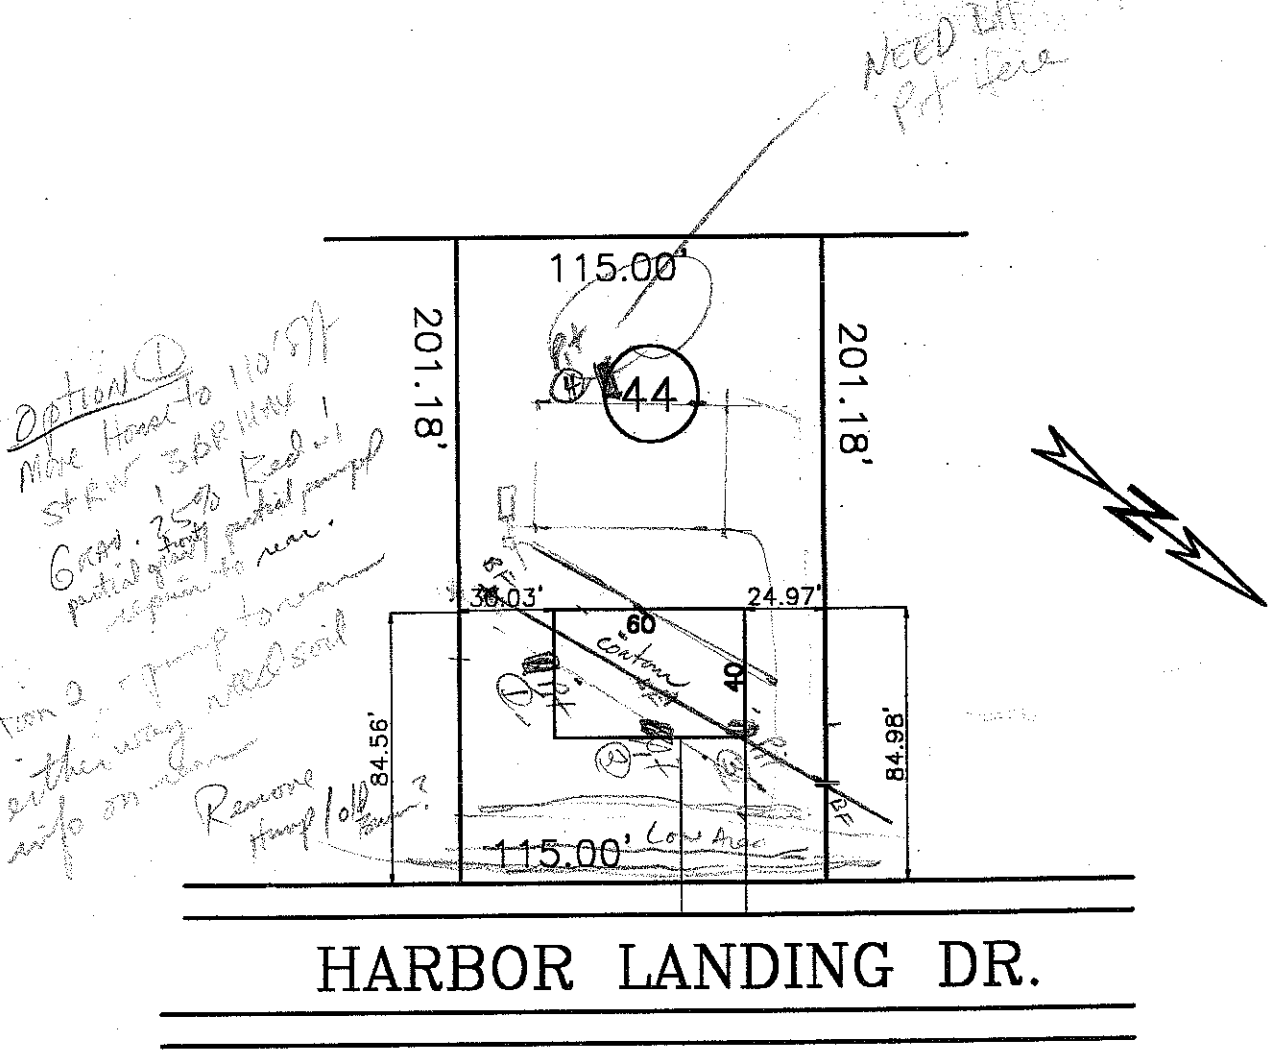

LOT #44
HARBOR LANDING

DAVIDSON TOWNSHIP
MARCH 16, 1998

IREDELL COUNTY, NC
SCALE: 1" = 60'