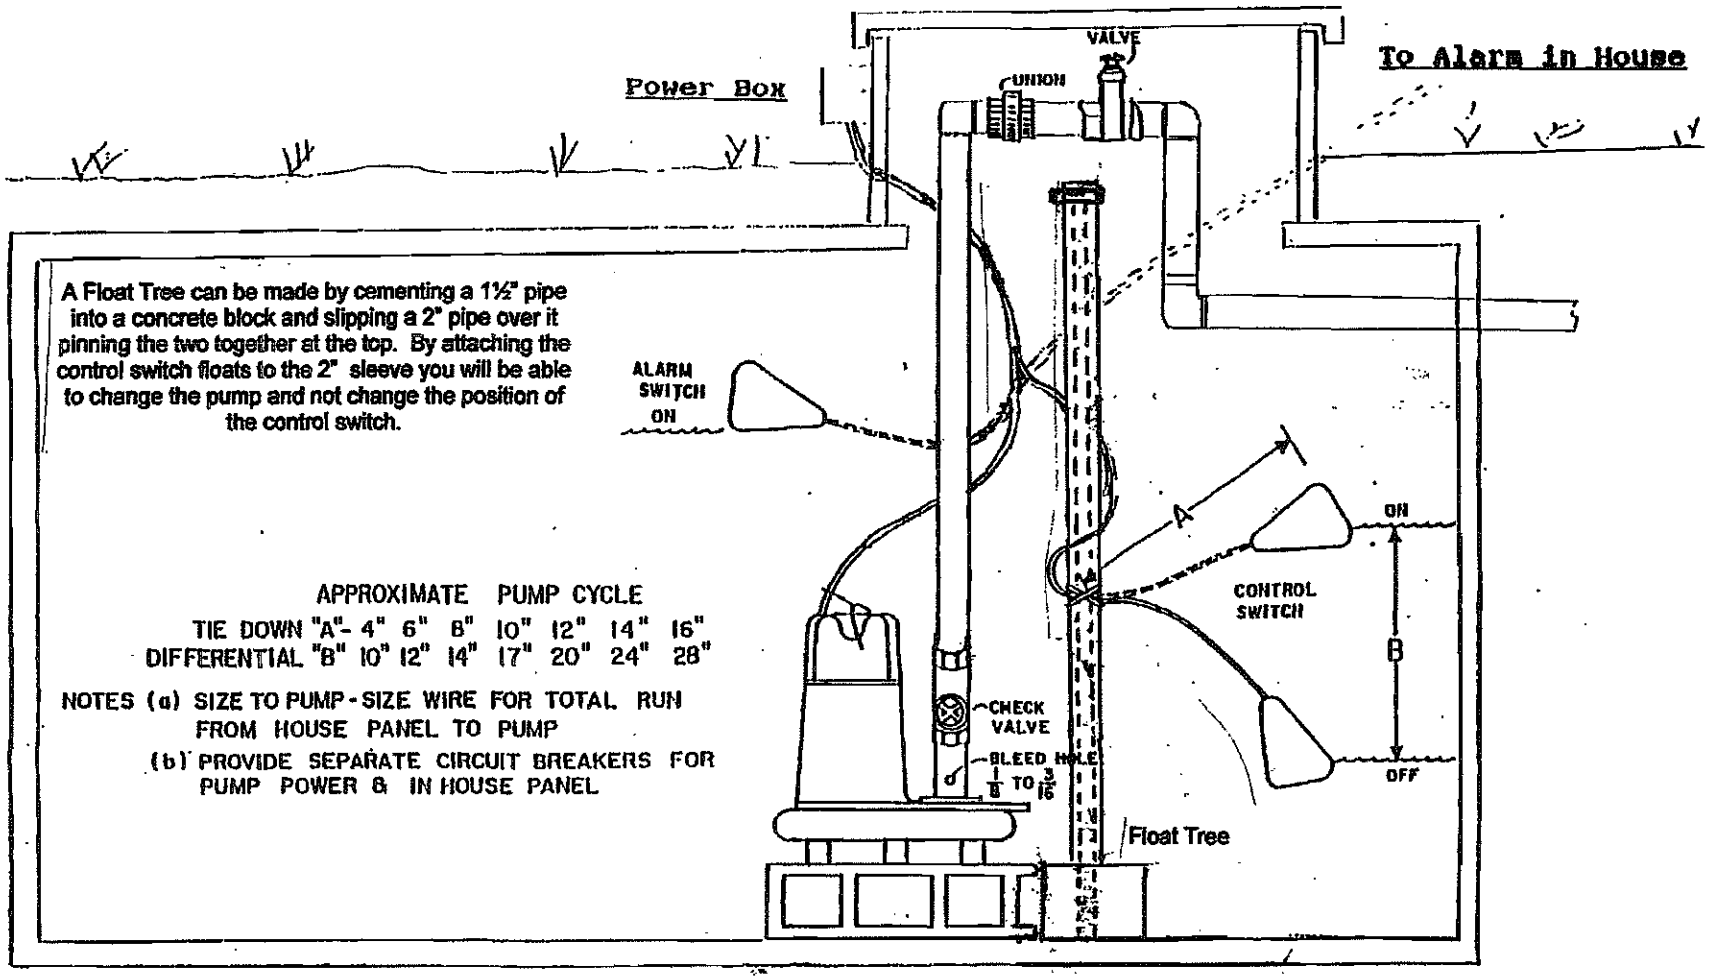

Power Box
VALVE
UNION
To Alarm in House
A Float Tree can be made by cementing a 1½" pipe into a concrete block and slipping a 2" pipe over it pinning the two together at the top. By attaching the control switch floats to the 2" sleeve you will be able to change the pump and not change the position of the control switch.
ALARM SWITCH ON
ON
CONTROL SWITCH
OFF
A
B
CHECK VALVE
BLEED HOLE
1/8 TO 3/16
Float Tree
APPROXIMATE PUMP CYCLE
TIE DOWN "A"- 4" 6" 8" 10" 12" 14" 16"
DIFFERENTIAL "B" 10" 12" 14" 17" 20" 24" 28"
NOTES (a) SIZE TO PUMP - SIZE WIRE FOR TOTAL RUN FROM HOUSE PANEL TO PUMP
(b) PROVIDE SEPARATE CIRCUIT BREAKERS FOR PUMP POWER & IN HOUSE PANEL

T & J Panel
Wastewater Treatment System

Patent # 4013559

269 Marble Road
Statesville, NC 28625
704-924-8600 Fax 704-924-8681
On the web at **tjpanel.com**

