IREDELL COUNTY HEALTH DEPARTMENT

Addition to Construct 4639-00-6840

STATESVILLE 704-878-5305 MOORESVILLE 704-664-5261

IMPROVEMENT PERMIT / ~~CERTIFICATE OF COMPLETION~~ / OPERATION PERMIT / ~~EXISTING SYSTEM INSPECTION~~

PROPERTY DESCRIPTION NO. 068194 DATE 8/9/97 TAX MAP NO. 4693900684O Watershed: ☒ Yes ☐ No

OWNER OR CONTRACTOR Westgate Circle Co. (BOB RICHARDSON) PHONE: Business _____ Home 910-768-7289

ADDRESS PO Box 24533 Winston-Salem, NC 27114

LOCATION North N Fern Hill Rd, TR Riverbend, on (E) next to last lot

SUBDIVISION C L + T BLOCK / SECTION 15 LOT 968 LOT AREA 1.06 SITE CLASS. PS DESIGN FLOW 600 L.T.A.R. .3

Septic Tank: 1250 Gallons; STB _____ Date _____

Pump Tank: 1250 Gallons; PT _____ Date _____

Pump Make: _____ Model _____ Serial No. _____

Nitrification Field: No Fields 1 Square Feet 306 Linear Feet 153

No Lines 3 Trench Width 24" Max Trench Bottom Depth 36" Gravel Depth SAND.

☒ New System ☐ Repair System Type: I, II, III, (IV), V, VI

System Description: Addn - 16" PPBS

Repair System Description: SAME

Maintenance Agreement Required: ☒ Yes ☐ No

☒ House/Mod. Home No. Bedrooms 5

☐ Mobile Home No. Bathrooms 3

☐ Business No. Employees _____

☐ Other _____

☐ Slab ☐ Crawl Space ☒ Basement w/plumbing ☐ Basement wo/plumbing

Water Supply: ☒ Individual ☐ Community ☐ Public

Comments: Tanks are existing - adding 153 linear feet of 16" PPBS - Type IV distribution 3/16 hole per panel - turn hole up inside each panel (1) (2) (3) NEW LINES


Comments: David Baxter - 10/31/88 Typ IV 7 lines tot

Location of the proposed HOUSE addition does not appear to impact the existing on-site septic system or well.**NOTE: _____

Gene Casey REHS Date: 9-4-14

ICHD-Environmental Health Division

INITIAL SITE SKETCH

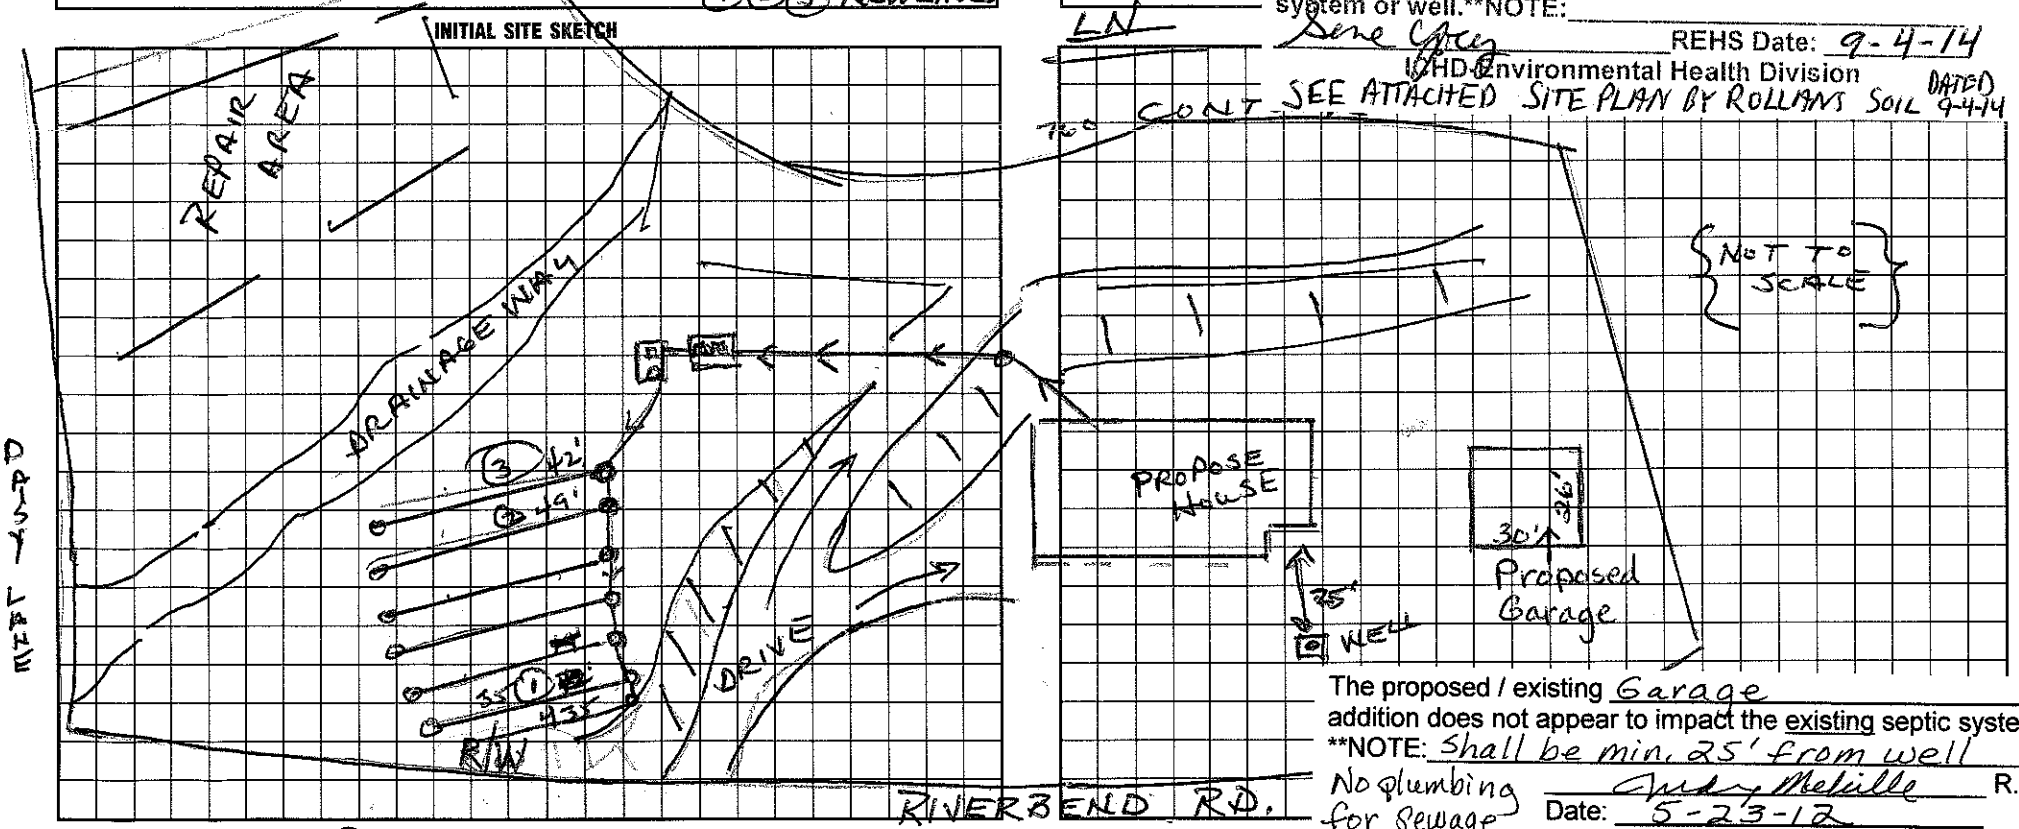

The proposed / existing Garage addition does not appear to impact the existing septic system.

**NOTE: Shall be min. 25' from well

No plumbing for sewage

Judy Melville R.S.

Date: 5-23-12

ICHD-Environmental Health Division

I understand that this permit can be suspended or revoked if any false information is supplied toward securing the permit/any unauthorized changes are m Improvement Permit is valid for 60 months from date of issuance.

Signed: K D Richards

Installed by: Bary Aughney

Improvement Permit by: Wesley Sparks R.S. date 8/9/97

Certificate of Completion by: Wesley Sparks R.S. date 7/1/99

System Inspection by: Wesley Sparks R.S. date 8/9/97

Operation Permit by: Wesley Sparks R.S. date 7/1/99

HEALTH DEPT. COPY: WHITE INSPECTION COPY (FINAL): GREEN OWNER COPY (FINAL): YELLOW INSPECTION COPY (INITIAL): PINK OWNER COPY (INITIAL): GOLD