09067

11:00

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR David Baxter DATE 9/30/88 PERMIT NO. 17 D

PHONE: Business _____ Home 664-7163

LOCATION 150 W. TR Perth TL Fern Hill TR Riverbend (SR# 1449) near end on L. S. R. No. 1449

SUBDIVISION NAME CL and T LOT NO. 968 SECTION OR BLOCK NO. 15

future present 3C-10-A-170 Fallstown

House (✓) Mobile Home (✓) Business ( ) Other _____

No. Bedrooms home: 3 No. Bathrooms 2

Garbage Disposal Unit Yes (✓) No ( )

Auto. Dishwasher Yes (✓) No ( )

Auto. Wash. Machine Yes (✓) No ( )

Site Suitable Yes (✓) No ( )

Character & Porosity of Soil Clayey (silty at 30")

Percolation Rate .35gpd/ft²

Topography ~ 1590


Depth to Water Table 4'+

Rock or other Impervious formations none observed

Lot Area 1.06 ACRE

_____ Basement with Plumbing _____ Basement without Plumbing ✓ No Basement present.

Pump Tank 1250

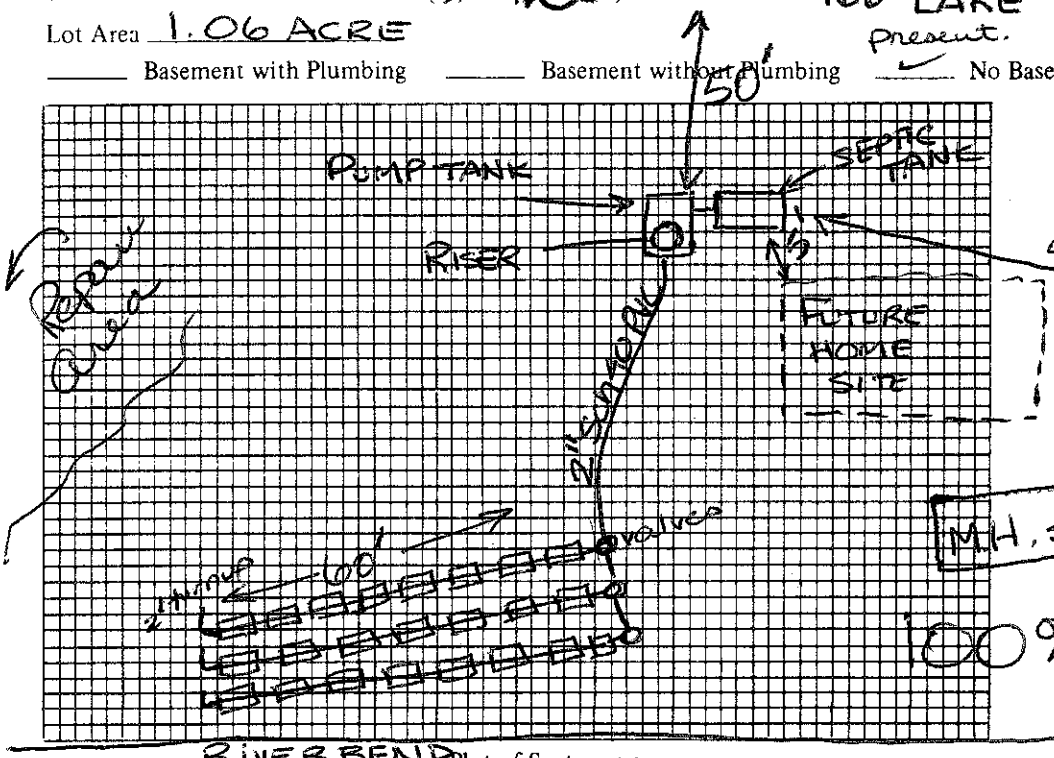

RIVERBEND Plot of System NTS

Size of Tank 1250 Gals.

Nitrification Field:
No. of Lines 3
Sq. Ft. _____ Linear Ft. 180' of 16"
Depth of Stone in Lines T&J Panel Syst
Water Supply: Individual ( ) Public ( ) well

Installed by _____

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed Robert L. Delonis

IMPROVEMENTS PERMIT BY Andre C. Price

(Pump alarm)

COMMENTS: Plan for development of a future home! Pump effluent through a 2" Sch. 40 PVC pipe to a series of 3 ball valves with reducers to 1/4" PVC w/ holes (2/panel) in the working lines. a 2' turnup is required at the end of each ditch in order to regulate pressure.

CERTIFICATE OF COMPLETION BY _____ DATE _____

EXISTING SYSTEM CHECKED BY: Read. TDH will be ~29 DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold