07426

IREDELL COUNTY HEALTH DEPARTMENT 4639-01-7552

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Brad Davis DATE Jan. 30, 89 PERMIT NO. _____

PHONE: Business _____ Home _____

LOCATION 1303 N. TL 1300 TR 1449 (Riverbend) TR 2nd Street (Cherokee) on left S. R. No. _____


SUBDIVISION NAME CL&T Lake Norman LOT NO. 966 SECTION OR BLOCK NO. 15

House (✓) Mobile Home ( ) Business ( ) Other _____

No. Bedrooms 4 No. Bathrooms 3

Garbage Disposal Unit	Yes (✓)	No ( )	Character & Porosity of Soil	clay loams.
Auto. Dishwasher	Yes (✓)	No ( )	Percolation Rate	2 & 3
Auto. Wash. Machine	Yes (✓)	No ( )	Topography	8-10% complex
Site ~~Suitable~~ PS	Yes (✓)	No ( )	Depth to Water Table	44
Lot Area 1 Ac+			Rock or other impervious formations	none obs.

___ Basement with Plumbing ___ Basement without Plumbing ___ No Basement

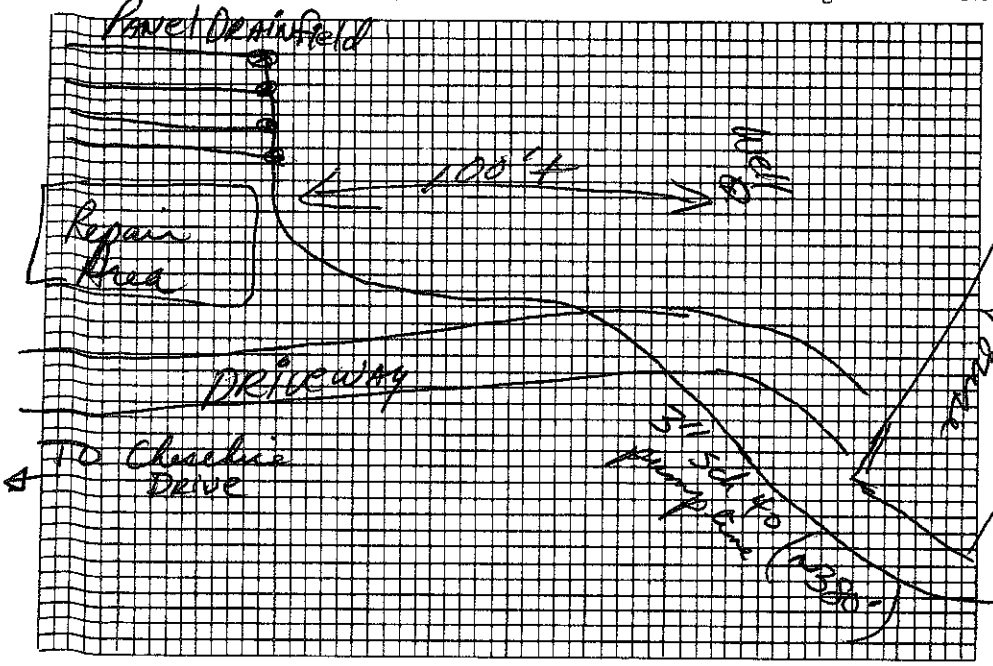

Plot of System

1500 pt

Size of Tank 1500 Gals.


Nitrification Field:
No. of Lines 4
Sq. Ft. _____ Linear Ft. 220' ±
Depth of Stone in Lines 16" ±

Water Supply: Individual (✓) panels
Public ( ) Progress-Ford

Installed by Bobby Wagley

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

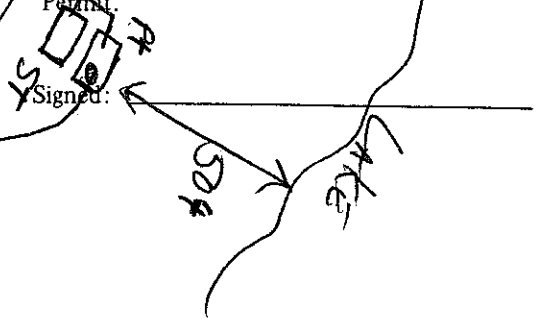

IMPROVEMENTS PERMIT BY _____

COMMENTS:
* Attention Building Inspection Dept. - Electrical hookup to pump & alarm needs to be changed to outside pump tank access riser.

CERTIFICATE OF COMPLETION BY Andre Pierce & David Hanson DATE 1-30-89

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold