DEPARTMENT OF ENVIRONMENT,
HEALTH, & NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH

SHEET____OF_____
PROPERTY I.D.#:_____
PROPERTY RECORDED:_____
COUNTY:_____

SOIL/SITE EVALUATION
FOR
ON-SITE WASTEWATER SYSTEM

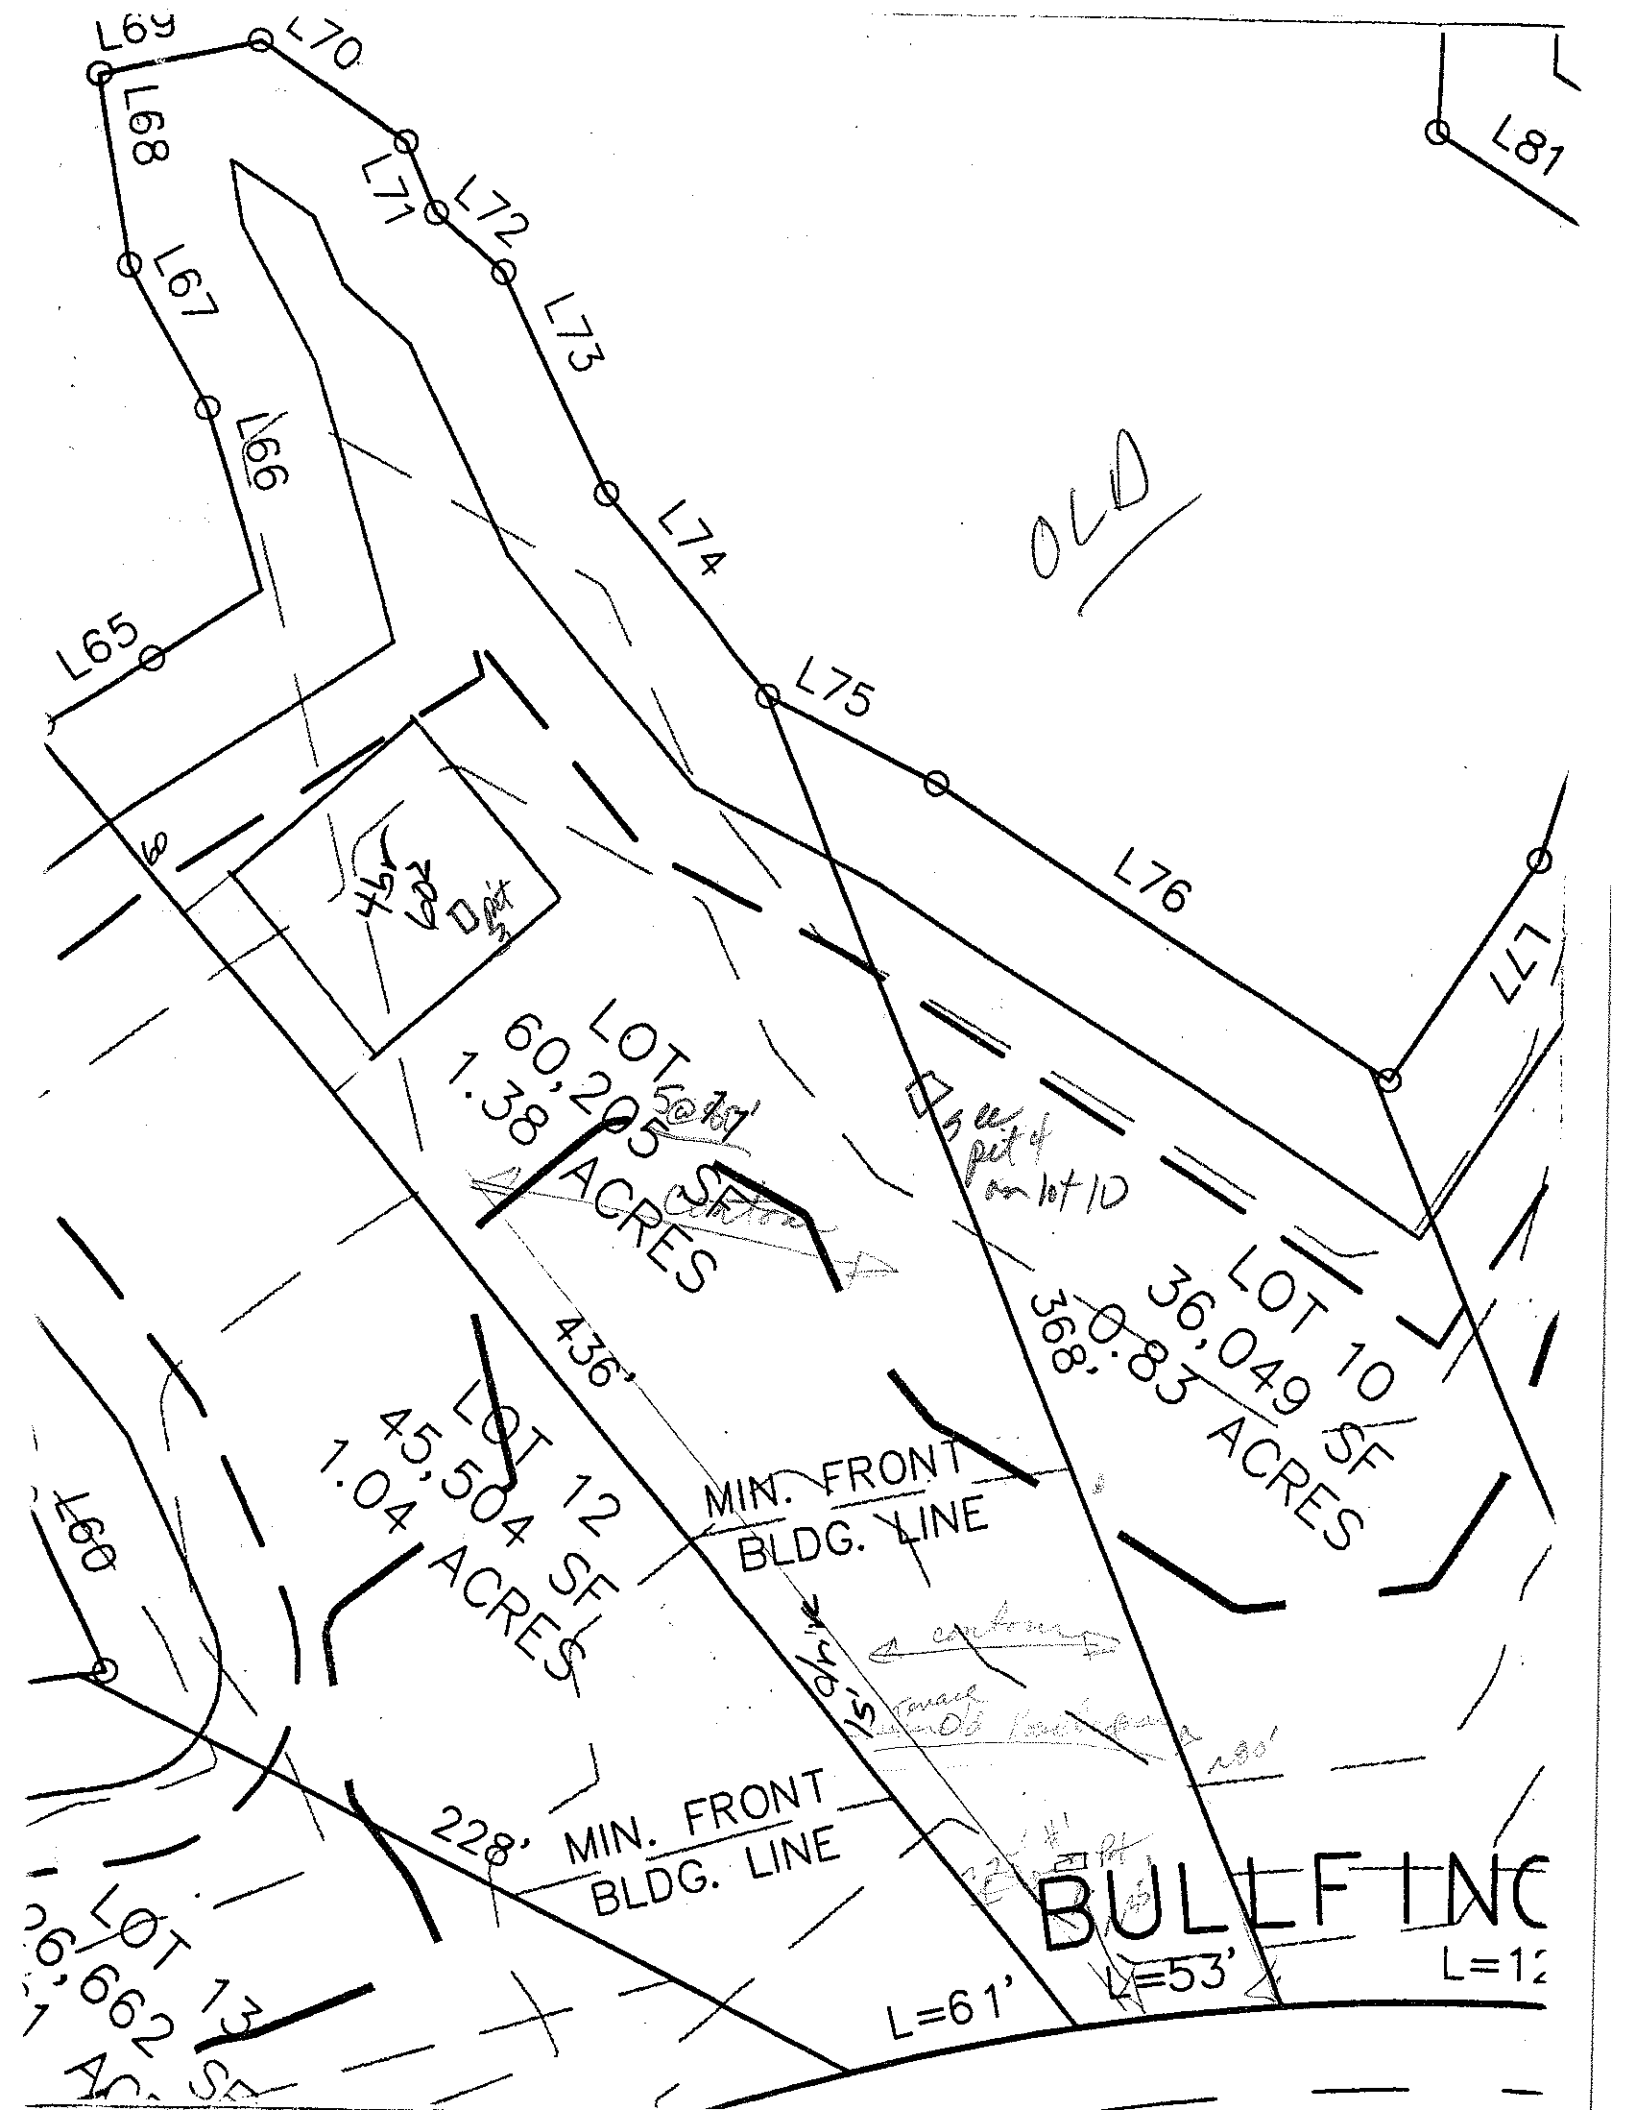
APPLICANT: CRI Lot 11 OWNER:__AGENT:__ PHONE:_____
ADDRESS:_____ APPLICATION DATE:_____ DATE EVALUATED: 11/23/04
_____ PROPOSED FACILITY: 480 gpd
_____ PROPERTY SIZE:_____
LOCATION OF SITE: Beacon Pt.
WATER SUPPLY: On-Site Well____Comm. Well✓Public____Other_____ EVAL. METHOD: Auger Boring____Pit____Cut____

PROFILE #	.1940 LANDSCP POS. (%)	HORIZON DEPTH (IN.)	.1941 STRUCTURE/TEXTURE	.1941 MINERALOGY/ CONSISTENCE	.1942 WETNESS COND.	.1944 RESTRICT HORIZONS	.1948 CLASS OF HORIZ	1943/ 1956 SAPRLT CLASS.	HORIZON LTAR
pit 1		0-3	cl	1:1					.4
		3-19	c SAB	"					.3
		19-40	cl WMSAB	"					.3
2 Auger Boring		0-3	CL	1:1					.4
		3-33	cl sab						
		33-42+	CL wksab	1:1					.3
3 OLD PIT		0-13	CL						.4
		13-36	C SAB						
		36-40+	CL wksab SAPR.						.3
4									
5									

AVAILABLE SPACE (.1945) PS SITE CLASSIFICATION (.1948): PS SITE LONG-TERM ACCEPTANCE RATE: .35

EVALUATED BY:_____ OTHER(S) PRESENT:_____

COMMENTS: Best lot yet — pump to conventional field


L69
L70
L68
L71
L72
L67
L73
L66
L74
L65
L75
L76
L77
L81
OLD
LOT 5
60,205 SF
1.38 ACRES
LOT 10
36,049 SF
0.83 ACRES
LOT 12
45,504 SF
1.04 ACRES
LOT 13
36,662 SF
436'
MIN. FRONT
BLDG. LINE
228' MIN. FRONT
BLDG. LINE
L=61'
L=53'
BULLF INC