DEPARTMENT OF ENVIRONMENT,
HEALTH, & NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH

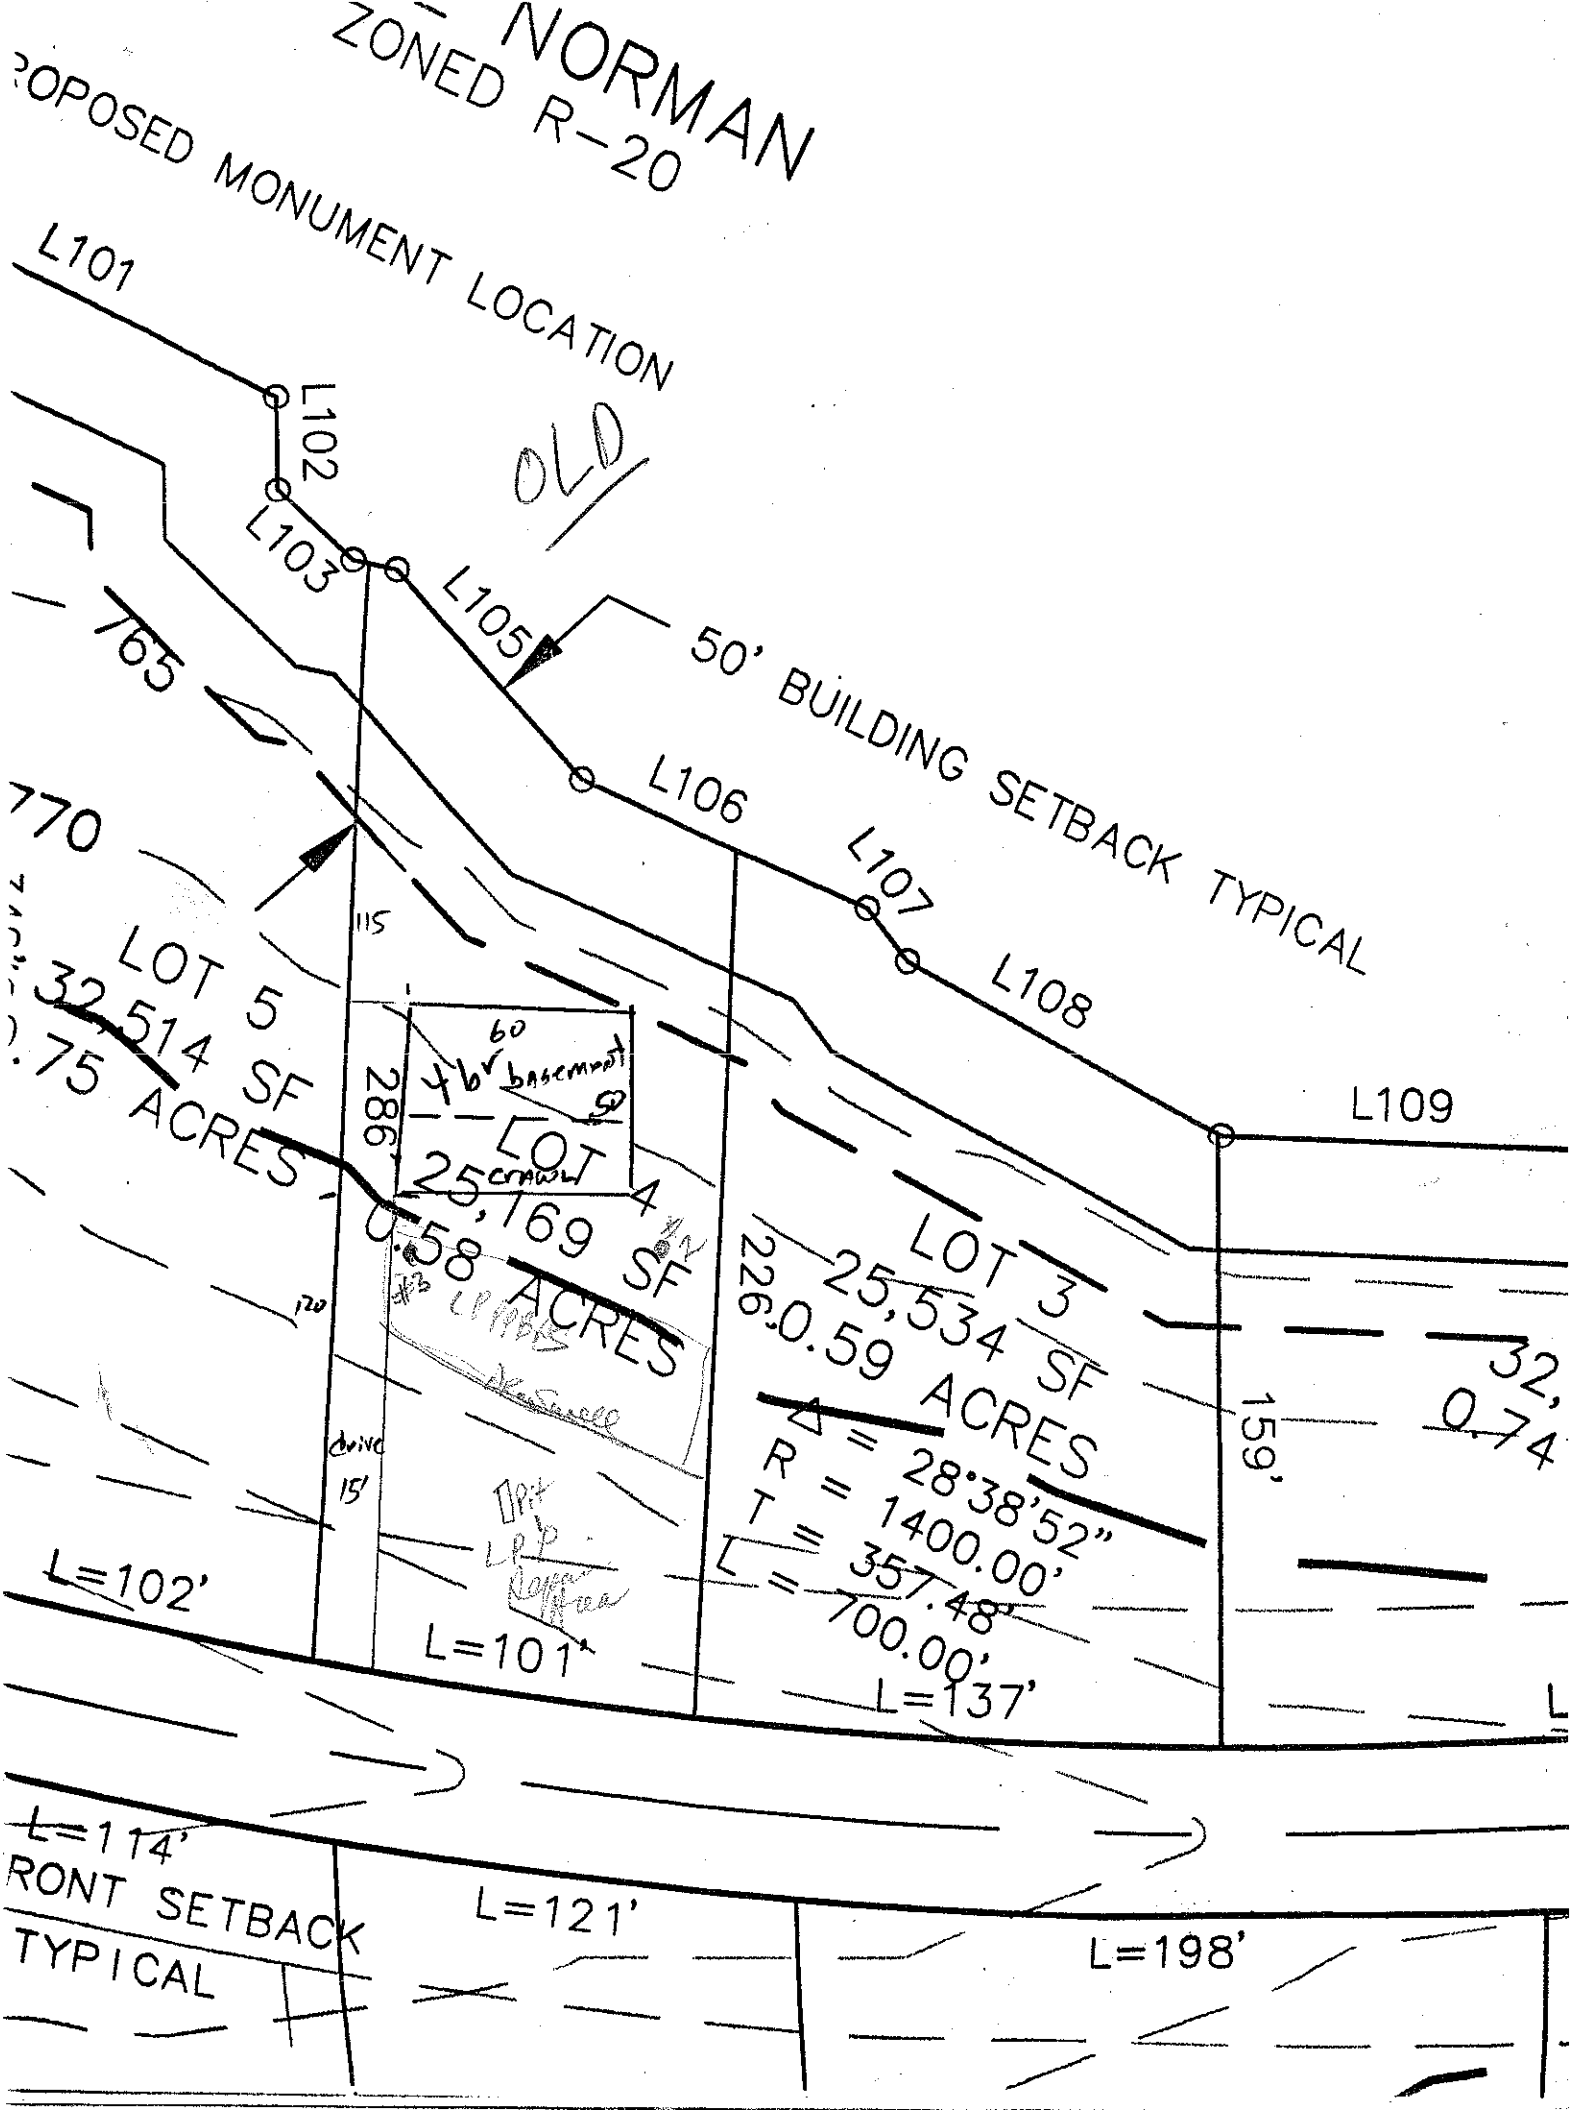
SHEET ____ OF ____
PROPERTY I.D.#: ____
PROPERTY RECORDED: ____
COUNTY: ____

SOIL/SITE EVALUATION
FOR
ON-SITE WASTEWATER SYSTEM

APPLICANT: CRL OWNER: __ AGENT: __ PHONE: ____
ADDRESS: ____ APPLICATION DATE: ____ DATE EVALUATED: ____
PROPOSED FACILITY: SFR 480 gpd
PROPERTY SIZE: ____
LOCATION OF SITE: Beacon Pointe lot 4
WATER SUPPLY: On-Site Well ___ Comm. Well ___ Public ___ Other ___ EVAL. METHOD: Auger Boring ✓ Pit ✓ Cut ___

PROFILE #	.1940 LANDSCP POS. (%)	HORIZON DEPTH (IN.)	.1941 STRUCTURE/TEXTURE	.1941 MINERALOGY/ CONSISTENCE	.1942 WETNESS COND.	.1944 RESTRICT HORIZONS	.1948 CLASS OF HORIZ	1943/ 1956 SAPRLT CLASS.	HORIZON LTAR
1 Auger		0-2	gr-scl	1:1 / vfr					.3 / .25
		2-4	gr-wksab scl	1:1 / fi					
		4-20	sab / c	1:1 / fi-vfi					
		20-44+	wksab / cl	1:1 / vfi – fragipan					
2 Auger		0-2	gr-sl	1:1 / vfr					.3
		2-5	gr-scl	1:1 / fr					
		5-12	sab-sc	1:1 / fi					
		12-21	sab-c	1:1 / vfi		Hard rock @ 42"			
		21-42	wksab / cl	1:1 / fi-vfi					
3 Auger		0-11	gr-sab scl	1:1 / fr-fi					.3
		11-28	sab-c	1:1 / vfi					
		28-41	wksab-cl	1:1 / fi		Hard rock @ 41"			
4									
5									

AVAILABLE SPACE (.1945) U SITE CLASSIFICATION (.1948): U SITE LONG-TERM ACCEPTANCE RATE: .3 initial
EVALUATED BY: Williams OTHER(S) PRESENT: T. Jacobs
COMMENTS: Site can be reclassified PS per rule .1956 modified system
@ 1957 FT – elevated BD PERC w/ LPP system


NORMAN
ZONED R-20
ROPOSED MONUMENT LOCATION
OLD
L101
L102
L103
L105
50' BUILDING SETBACK TYPICAL
L106
L107
L108
L109
763
770
LOT 5
32,514 SF
.75 ACRES
LOT 4
25,169 SF
0.58 ACRES
LOT 3
25,534 SF
0.59 ACRES
Δ = 28°38'52"
R = 1400.00'
T = 357.48'
L = 700.00'
L=137'
L=102'
L=101'
L=114'
L=121'
L=198'
159'
286'
115
120
60
4 br basement
crawl
32,
0.74
RONT SETBACK
TYPICAL