DEPARTMENT OF ENVIRONMENT,
HEALTH, & NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH

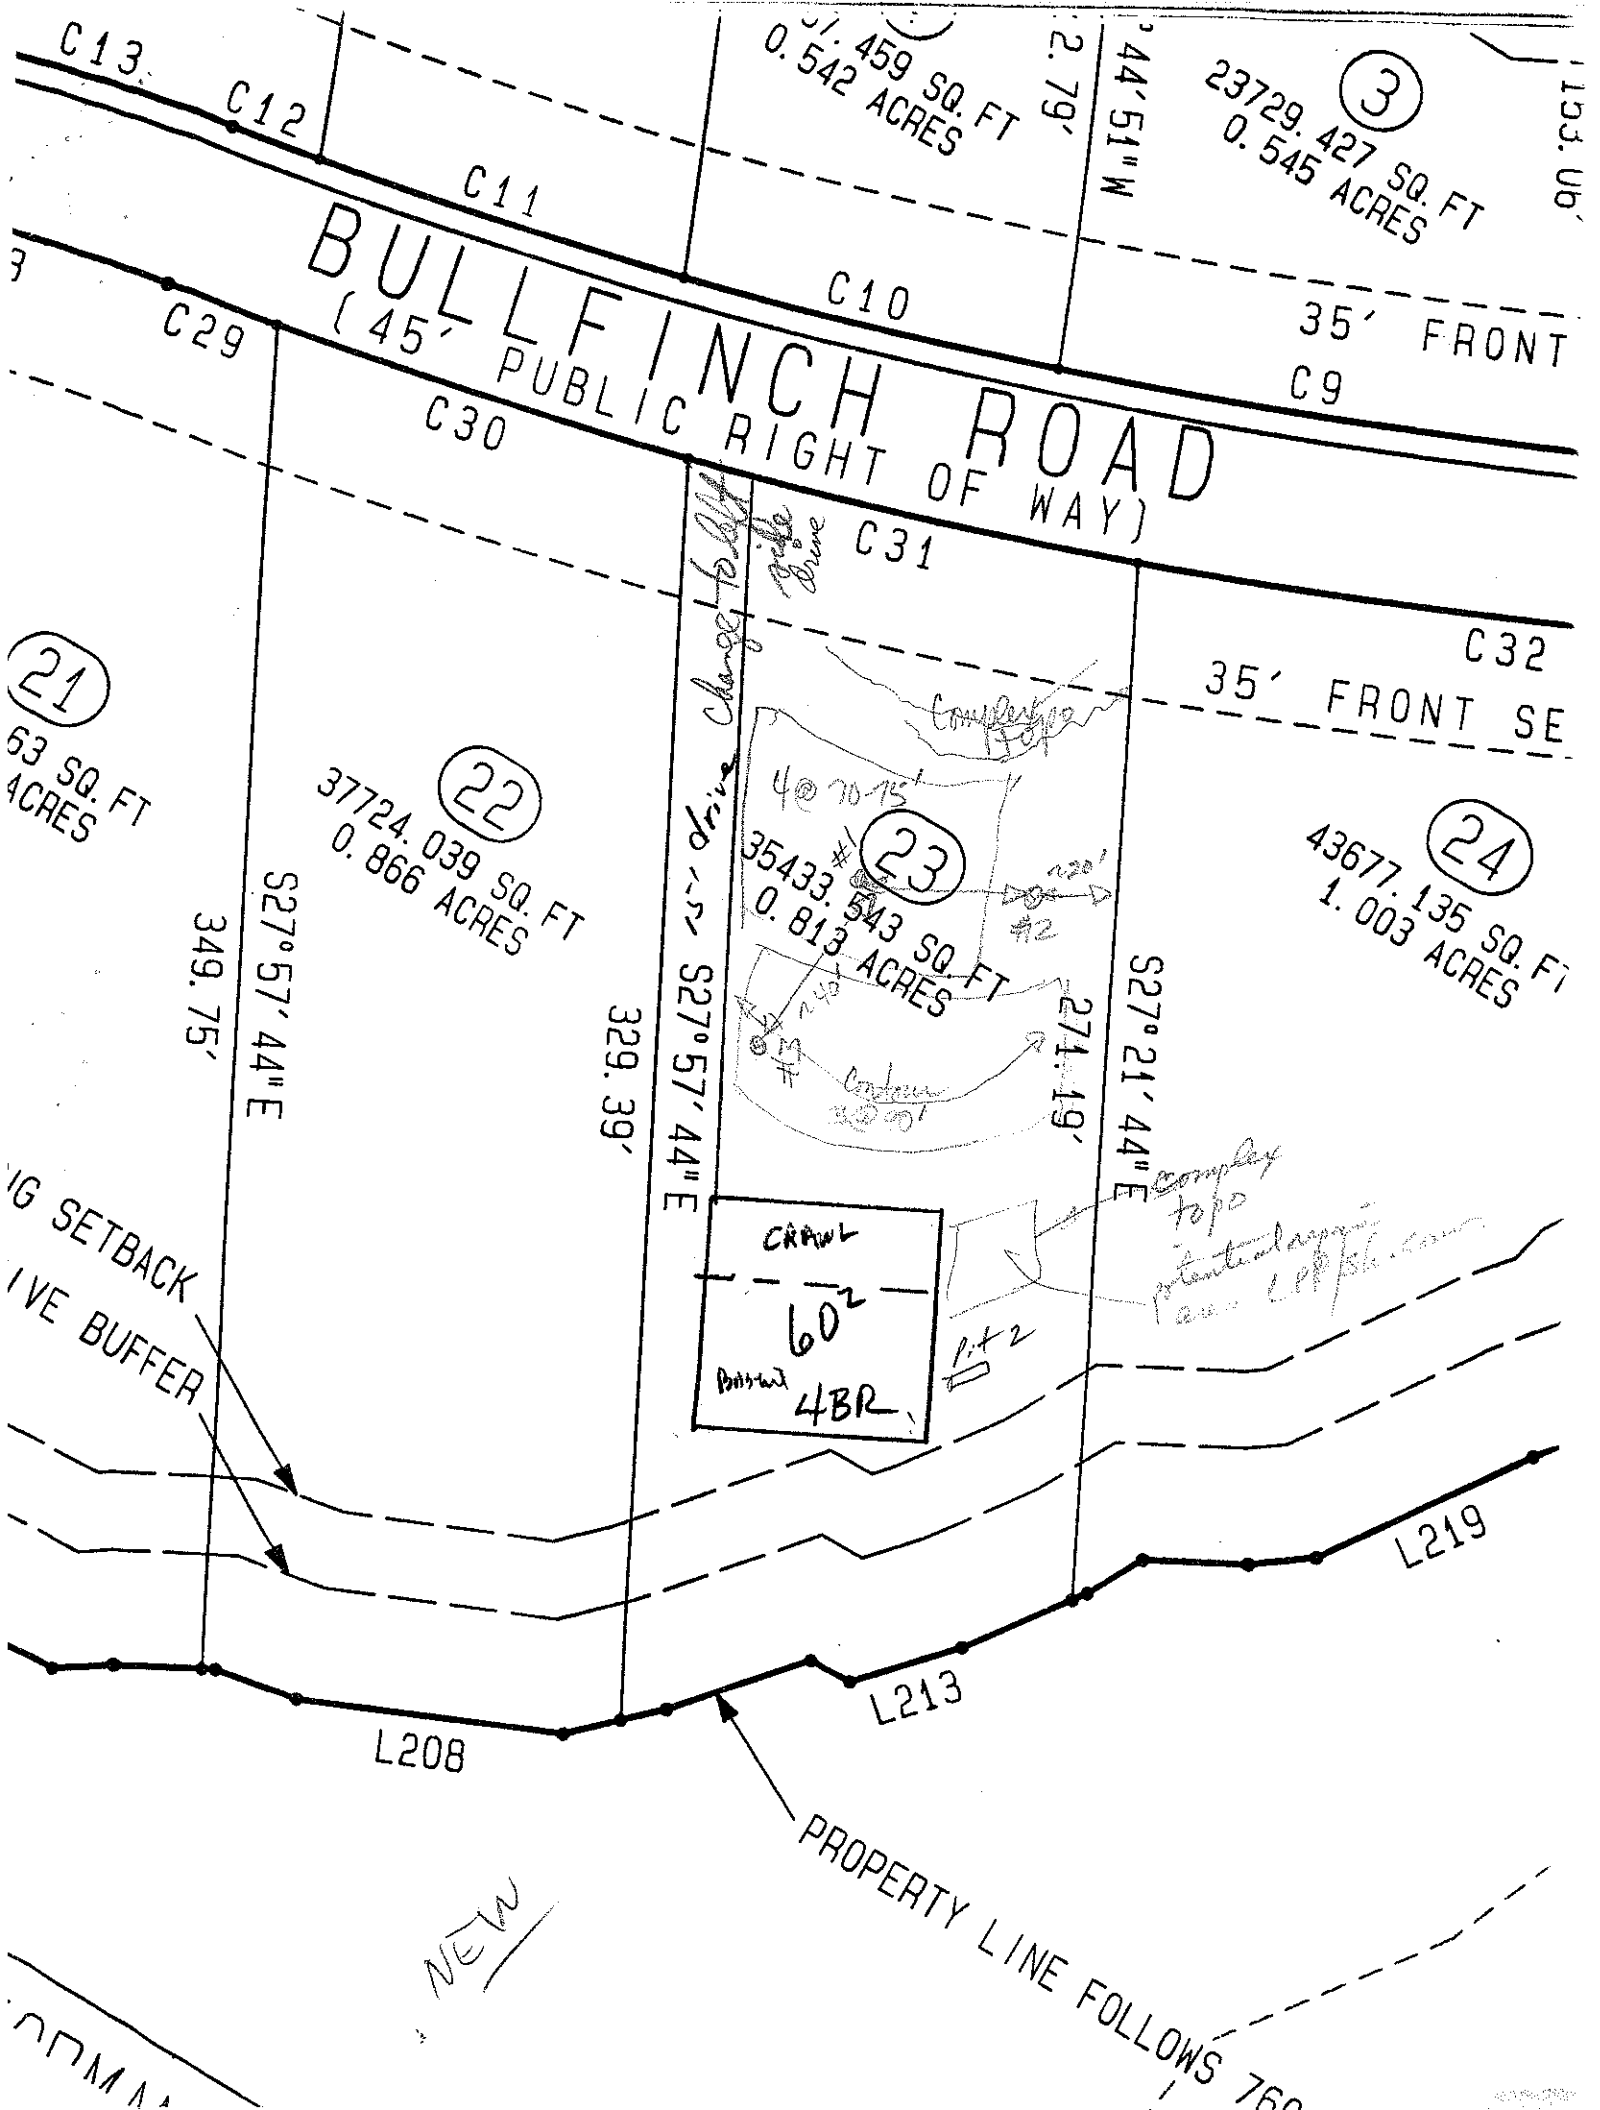
SHEET____OF_____
PROPERTY I.D.#:_____
PROPERTY RECORDED:_____
COUNTY:_____

SOIL/SITE EVALUATION
FOR
ON-SITE WASTEWATER SYSTEM

APPLICANT: CRI OWNER:__AGENT:__ PHONE:_____
ADDRESS:_____ APPLICATION DATE:_____ DATE EVALUATED: 12/1/94
PROPOSED FACILITY: 450 gpd / 4 bedroom SF Dwelling
PROPERTY SIZE:_____
LOCATION OF SITE: lot 23, Beacon Pt.
WATER SUPPLY: On-Site Well____Comm. Well✓Public____Other_____EVAL. METHOD: Auger Boring___Pit___Cut____

PROFILE #	.1940 LANDSCP POS. (%)	HORIZON DEPTH (IN.)	.1941 STRUCTURE/TEXTURE	.1941 MINERALOGY/ CONSISTENCE	.1942 WETNESS COND.	.1944 RESTRICT HORIZONS	.1948 CLASS OF HORIZ	1943/ 1956 SAPRLT CLASS.	HORIZON LTAR
1 Auger		0-7"	gr-sCL	1:1/vfr					.3
		7-30	SAB-C	1:1/fi-vfi					
		30-41	WKSAB/CL	1:1/fi					
		41-47	WK SAB/CL-sapmix	/fi-fr					
2 Auger		0-3	gr-sCL	1:1/vfr					.3
		3-14	WSAB-C	1:1/fi-vfi-sp					
		14-24	WKSAB-CL	1:1/fr					
		24-40	WK SAB-SCL	1:1/fr-vfr					
		40+	WKSAB-fscl/sapmix	1:1/vfr					
3 Auger		0-48"	WKSAB/CL micaceous	1:1/fr					.3
4									
5									

AVAILABLE SPACE (.1945): U SITE CLASSIFICATION (.1948): U* SITE LONG-TERM ACCEPTANCE RATE: .3
EVALUATED BY: [signature] OTHER(S) PRESENT: T Jacobs
COMMENTS: Site can be reclassified R upon 1996


BULLFINCH ROAD
(45' PUBLIC RIGHT OF WAY)
C13
C12
C11
C10
C9
C29
C30
C31
C32
35' FRONT
35' FRONT SE
459 SQ. FT
0.542 ACRES
44'51"W
2.79'
23729.427 SQ. FT
0.545 ACRES
3
21
63 SQ. FT
ACRES
22
37724.039 SQ. FT
0.866 ACRES
23
35433.543 SQ. FT
0.813 ACRES
24
43677.135 SQ. Fi
1.003 ACRES
S27°57'44"E
349.75'
329.39'
S27°57'44"E
271.19'
S27°21'44"E
drive
Charge to bill
Bridle
CRAWL
60²
4BR
4@ 70-75'
#1
#2
#3
#4
L208
L213
L219
PROPERTY LINE FOLLOWS
NEW
IG SETBACK
IVE BUFFER