DEPARTMENT OF ENVIRONMENT,
HEALTH, & NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH

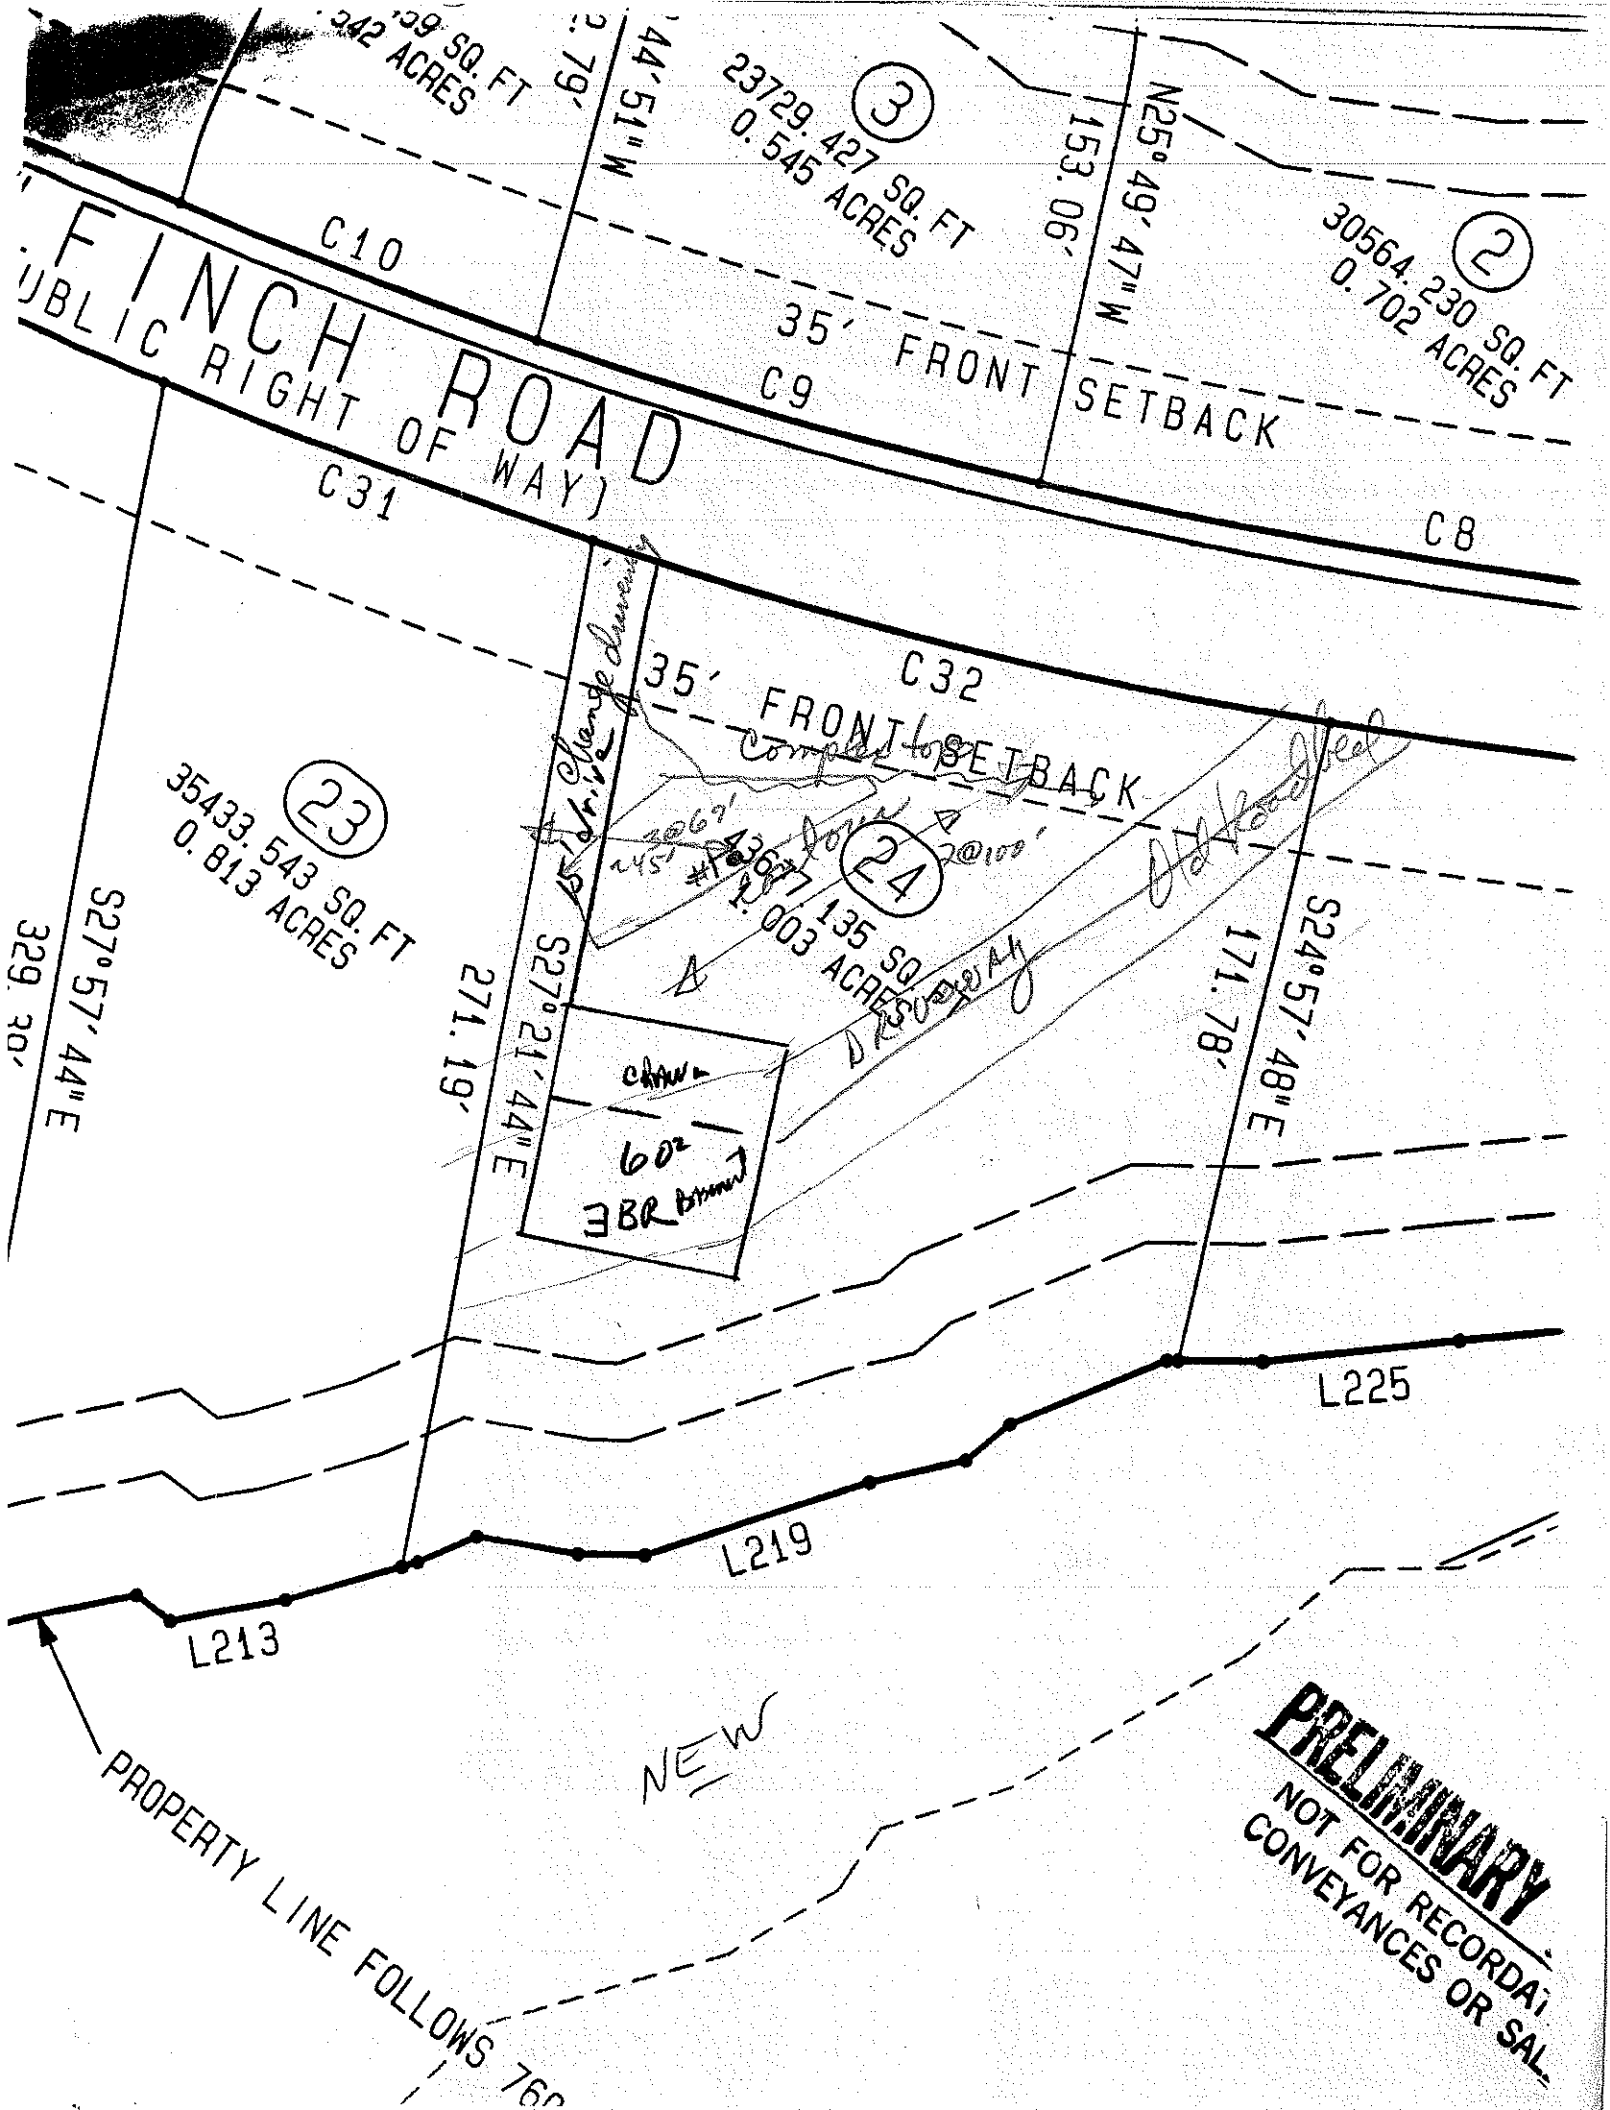
SHEET____OF____
PROPERTY I.D.#:_____
PROPERTY RECORDED:_____
COUNTY:_____

SOIL/SITE EVALUATION
FOR
ON-SITE WASTEWATER SYSTEM

APPLICANT: CRI OWNER:_AGENT:_ PHONE:_____
ADDRESS:_____ APPLICATION DATE:_____ DATE EVALUATED: 12/1/94
PROPOSED FACILITY: 3bd 2ba
PROPERTY SIZE:_____
LOCATION OF SITE: lot 24, Beacon Ht.
WATER SUPPLY: On-Site Well____Comm. Well___Public___Other_____ EVAL. METHOD: Auger Boring ✓ Pit___Cut___

PROFILE #	.1940 LANDSCP POS. (%)	HORIZON DEPTH (IN.)	.1941 STRUCTURE/TEXTURE	.1941 MINERALOGY/ CONSISTENCE	.1942 WETNESS COND.	.1944 RESTRICT HORIZONS	.1948 CLASS OF HORIZ	1943/ 1956 SAPRLT CLASS.	HORIZON LTAR
1 Auger		0-1	gr/ sc/	1°/					.3
		1-12	C / SAb	1°/					
		12-14	CL / micaceous MMSAb	1°/					
2 Aug Pit		0-36	WK SAb / CL	1:1					.3
		36+	well weathered SAP						
3									
4									
5									

AVAILABLE SPACE (.1945): U SITE CLASSIFICATION (.1948): U X SITE LONG-TERM ACCEPTANCE RATE:_____
EVALUATED BY: DLH OTHER(S) PRESENT:_____
COMMENTS: Site can be reclassified PS per 1956
UPWBPS


FINCH ROAD
PUBLIC RIGHT OF WAY
C10
C9
C8
C31
C32
35' FRONT SETBACK
35' FRONT SETBACK
3
2379. 427 SQ. FT
0. 545 ACRES
2
30564. 230 SQ. FT
0. 702 ACRES
23
35433. 543 SQ. FT
0. 813 ACRES
24
1. 003 ACRES
135 SQ.
153. 06'
N25° 49' 47" W
S44° 51" W
S27° 57' 44" E
271. 19'
S27° 21' 44" E
171. 78'
S24° 57' 48" E
329. 30'
L225
L219
L213
602
3BR
PROPERTY LINE FOLLOWS 76
NEW
PRELIMINARY
NOT FOR RECORDA
CONVEYANCES OR SAL