DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

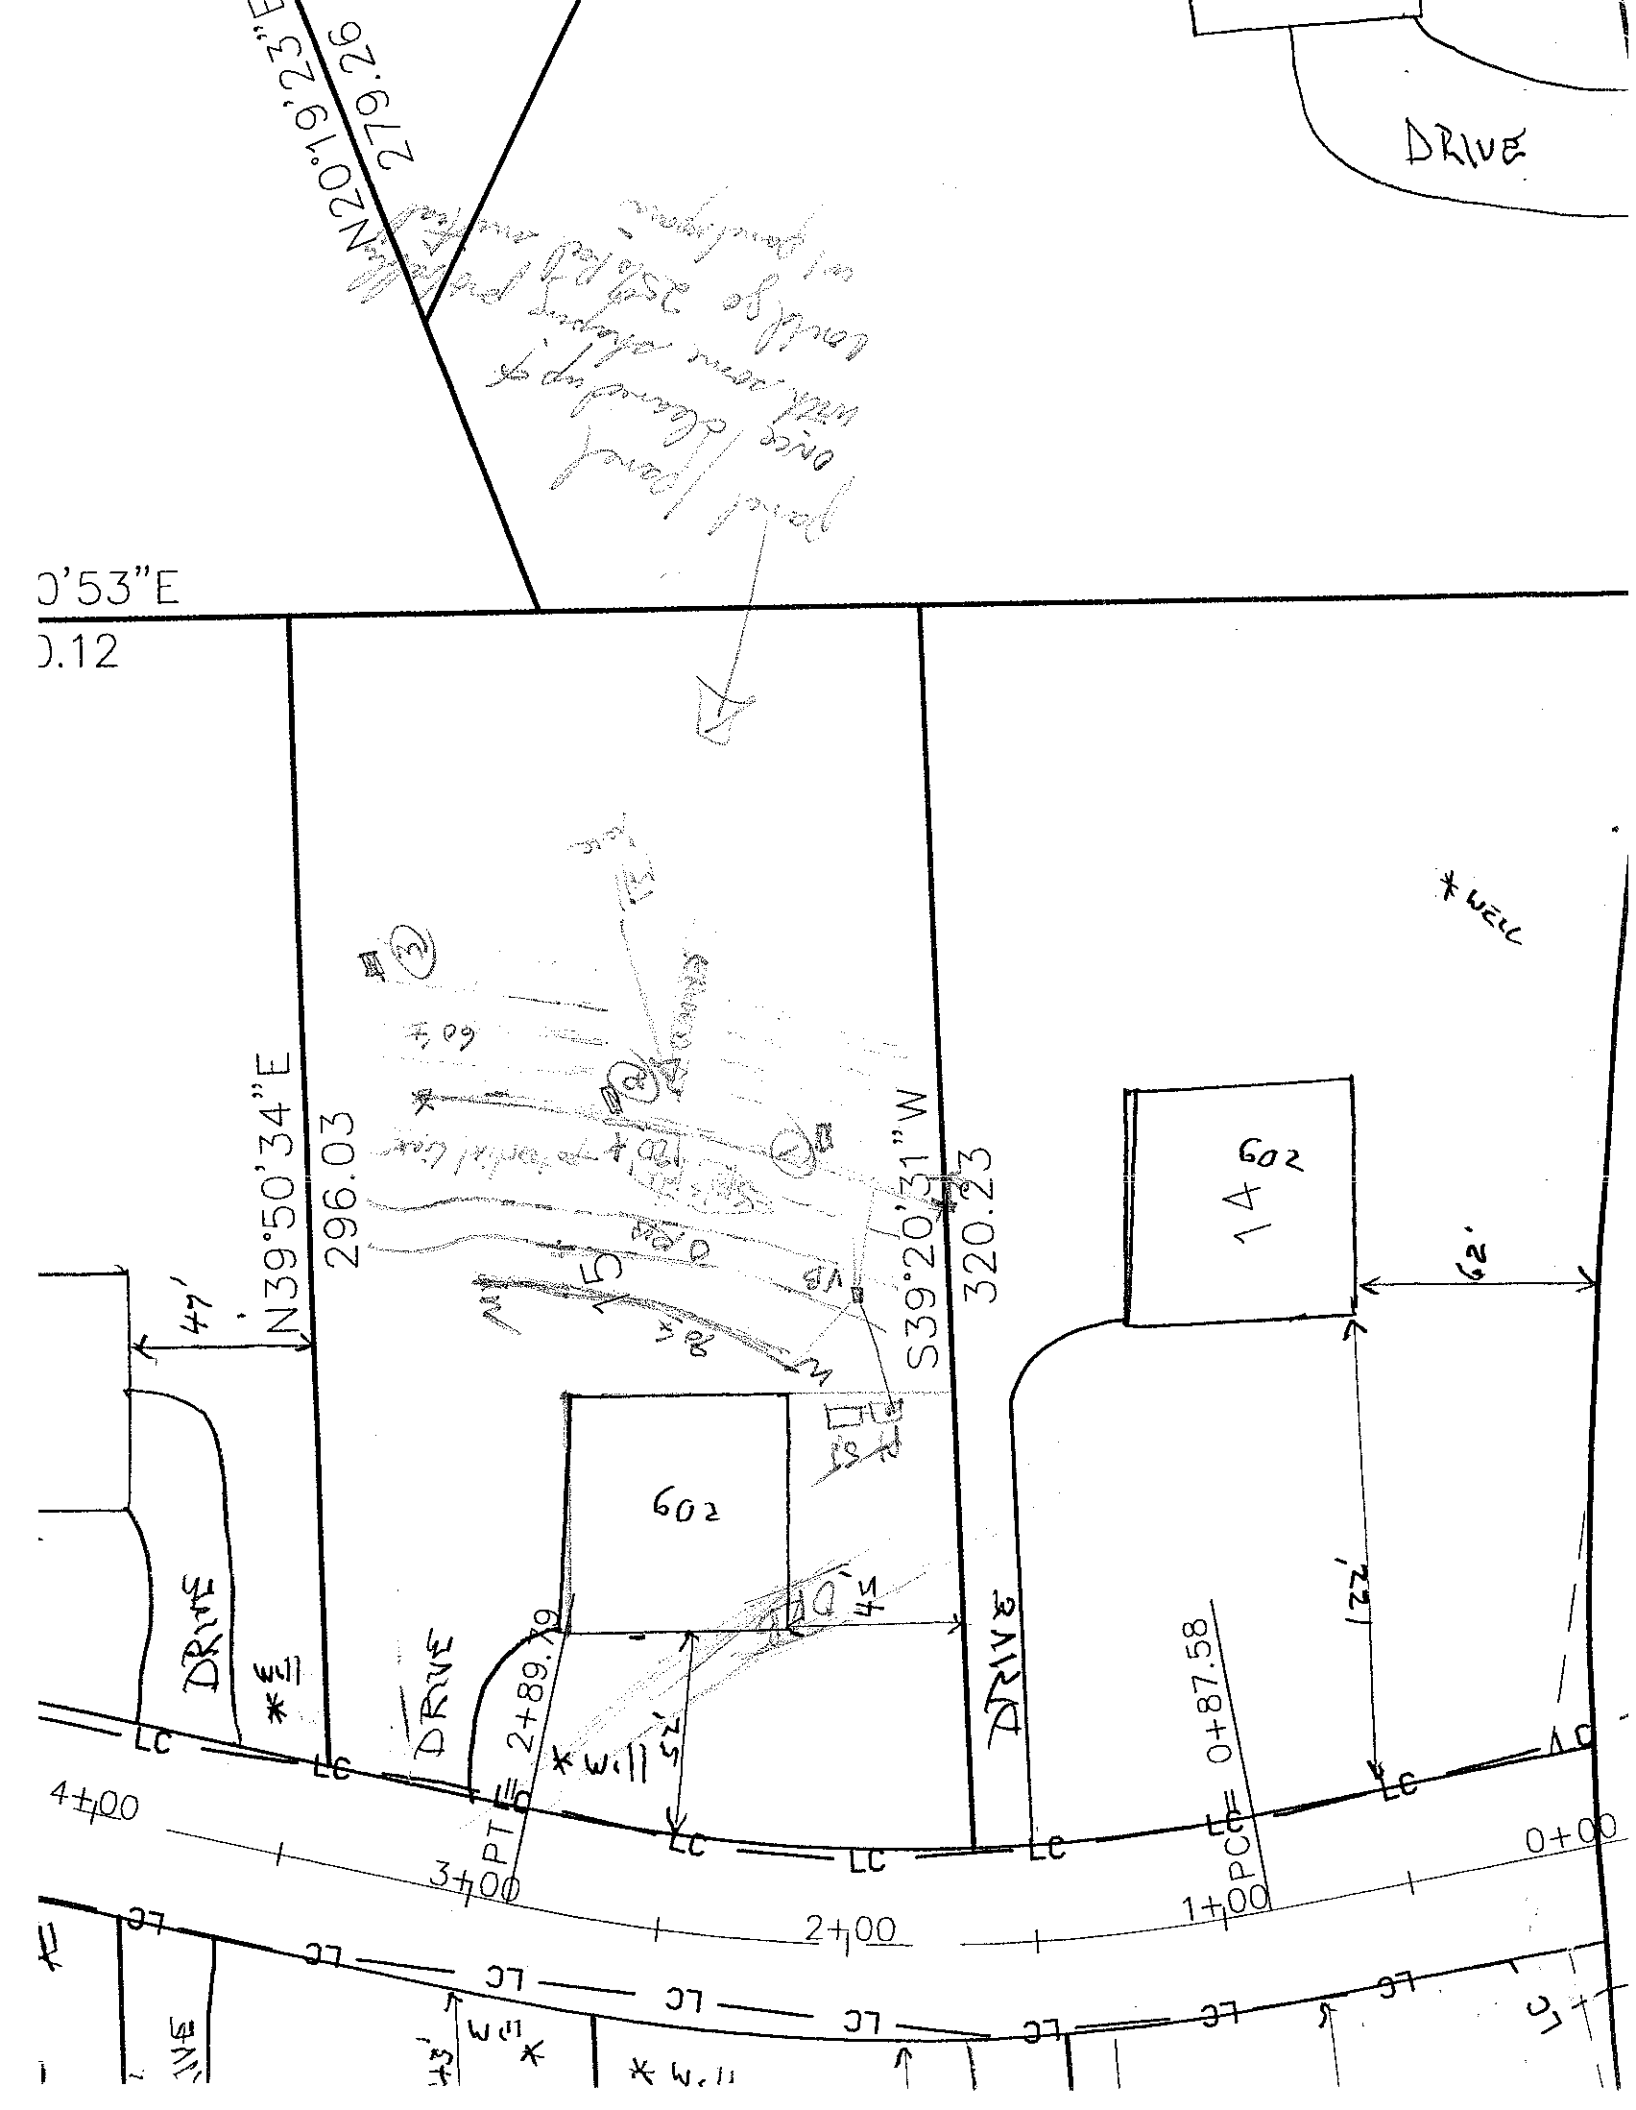
SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: Beacon Pt Partners APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: 5-2-04
PROPOSED FACILITY: SFR PROPOSED DESIGN FLOW (.1949): 480gpd PROPERTY SIZE: _____
LOCATION OF SITE: lot K abv Beacon Pt PROPERTY RECORDED: _____
WATER SUPPLY: ☑ Private ☐ Public ☑ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☑ Pit ☐ Cut
TYPE OF WASTEWATER: ☑ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LAND-SCAPE POSITION/ SLOPE %	HORI-ZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	17%	0-5	gr brnsl	frssp	few mott sap 25"+				.3
		5-30	mfsbk RC	fr fr ss sp sap					
		30-50	massive sl sap	fr ss sp					
2		0-6	gr brnsl	frssp					.3
		6-21	mfsbk RC	fr sp ss sap					
		21-31	mfsbk yr cl	fr ss sp common mi sap					
		31-52	massive cl sl sap	fr ss sp					
3		0-5	gr brnsl	frssp					.3
		5-32	mfsbk RC	fr ssp					
		32-42	wfsbk yr cl	fr ssp common mi sap					
		42-53	massive yr cl brnsl sap fr ss sp						
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	15	15
System Type(s)	LPP BPS	LPP BPS
Site LTAR	.3	.3

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): 15
EVALUATED BY: _____
OTHER(S) PRESENT: Paul Vanmeter


N20°19'23"E
279.26
DRIVE
D'53"E
D.12
N39°50'34"E
296.03
S39°20'31"W
320.23
602
609
47'
62'
127'
DRIVE
DRIVE
DRIVE
* WELL
* Well
* Well
LC
LC
LC
LC
LC
LC
LC
LC
4+00
3+00
2+00
1+00
0+00
PT 2+89.79
PC 0+87.58