ARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
VISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: CRI
ADDRESS: _____
PROPOSED FACILITY: _____
LOCATION OF SITE: Beacon Pt I Lot #20

APPLICANT: _____
APPLICATION DATE: _____
PROPOSED DESIGN FLOW (.1949): _____

DATE EVALUATED: 4/28/19
PROPERTY SIZE: _____
PROPERTY RECORDED: _____

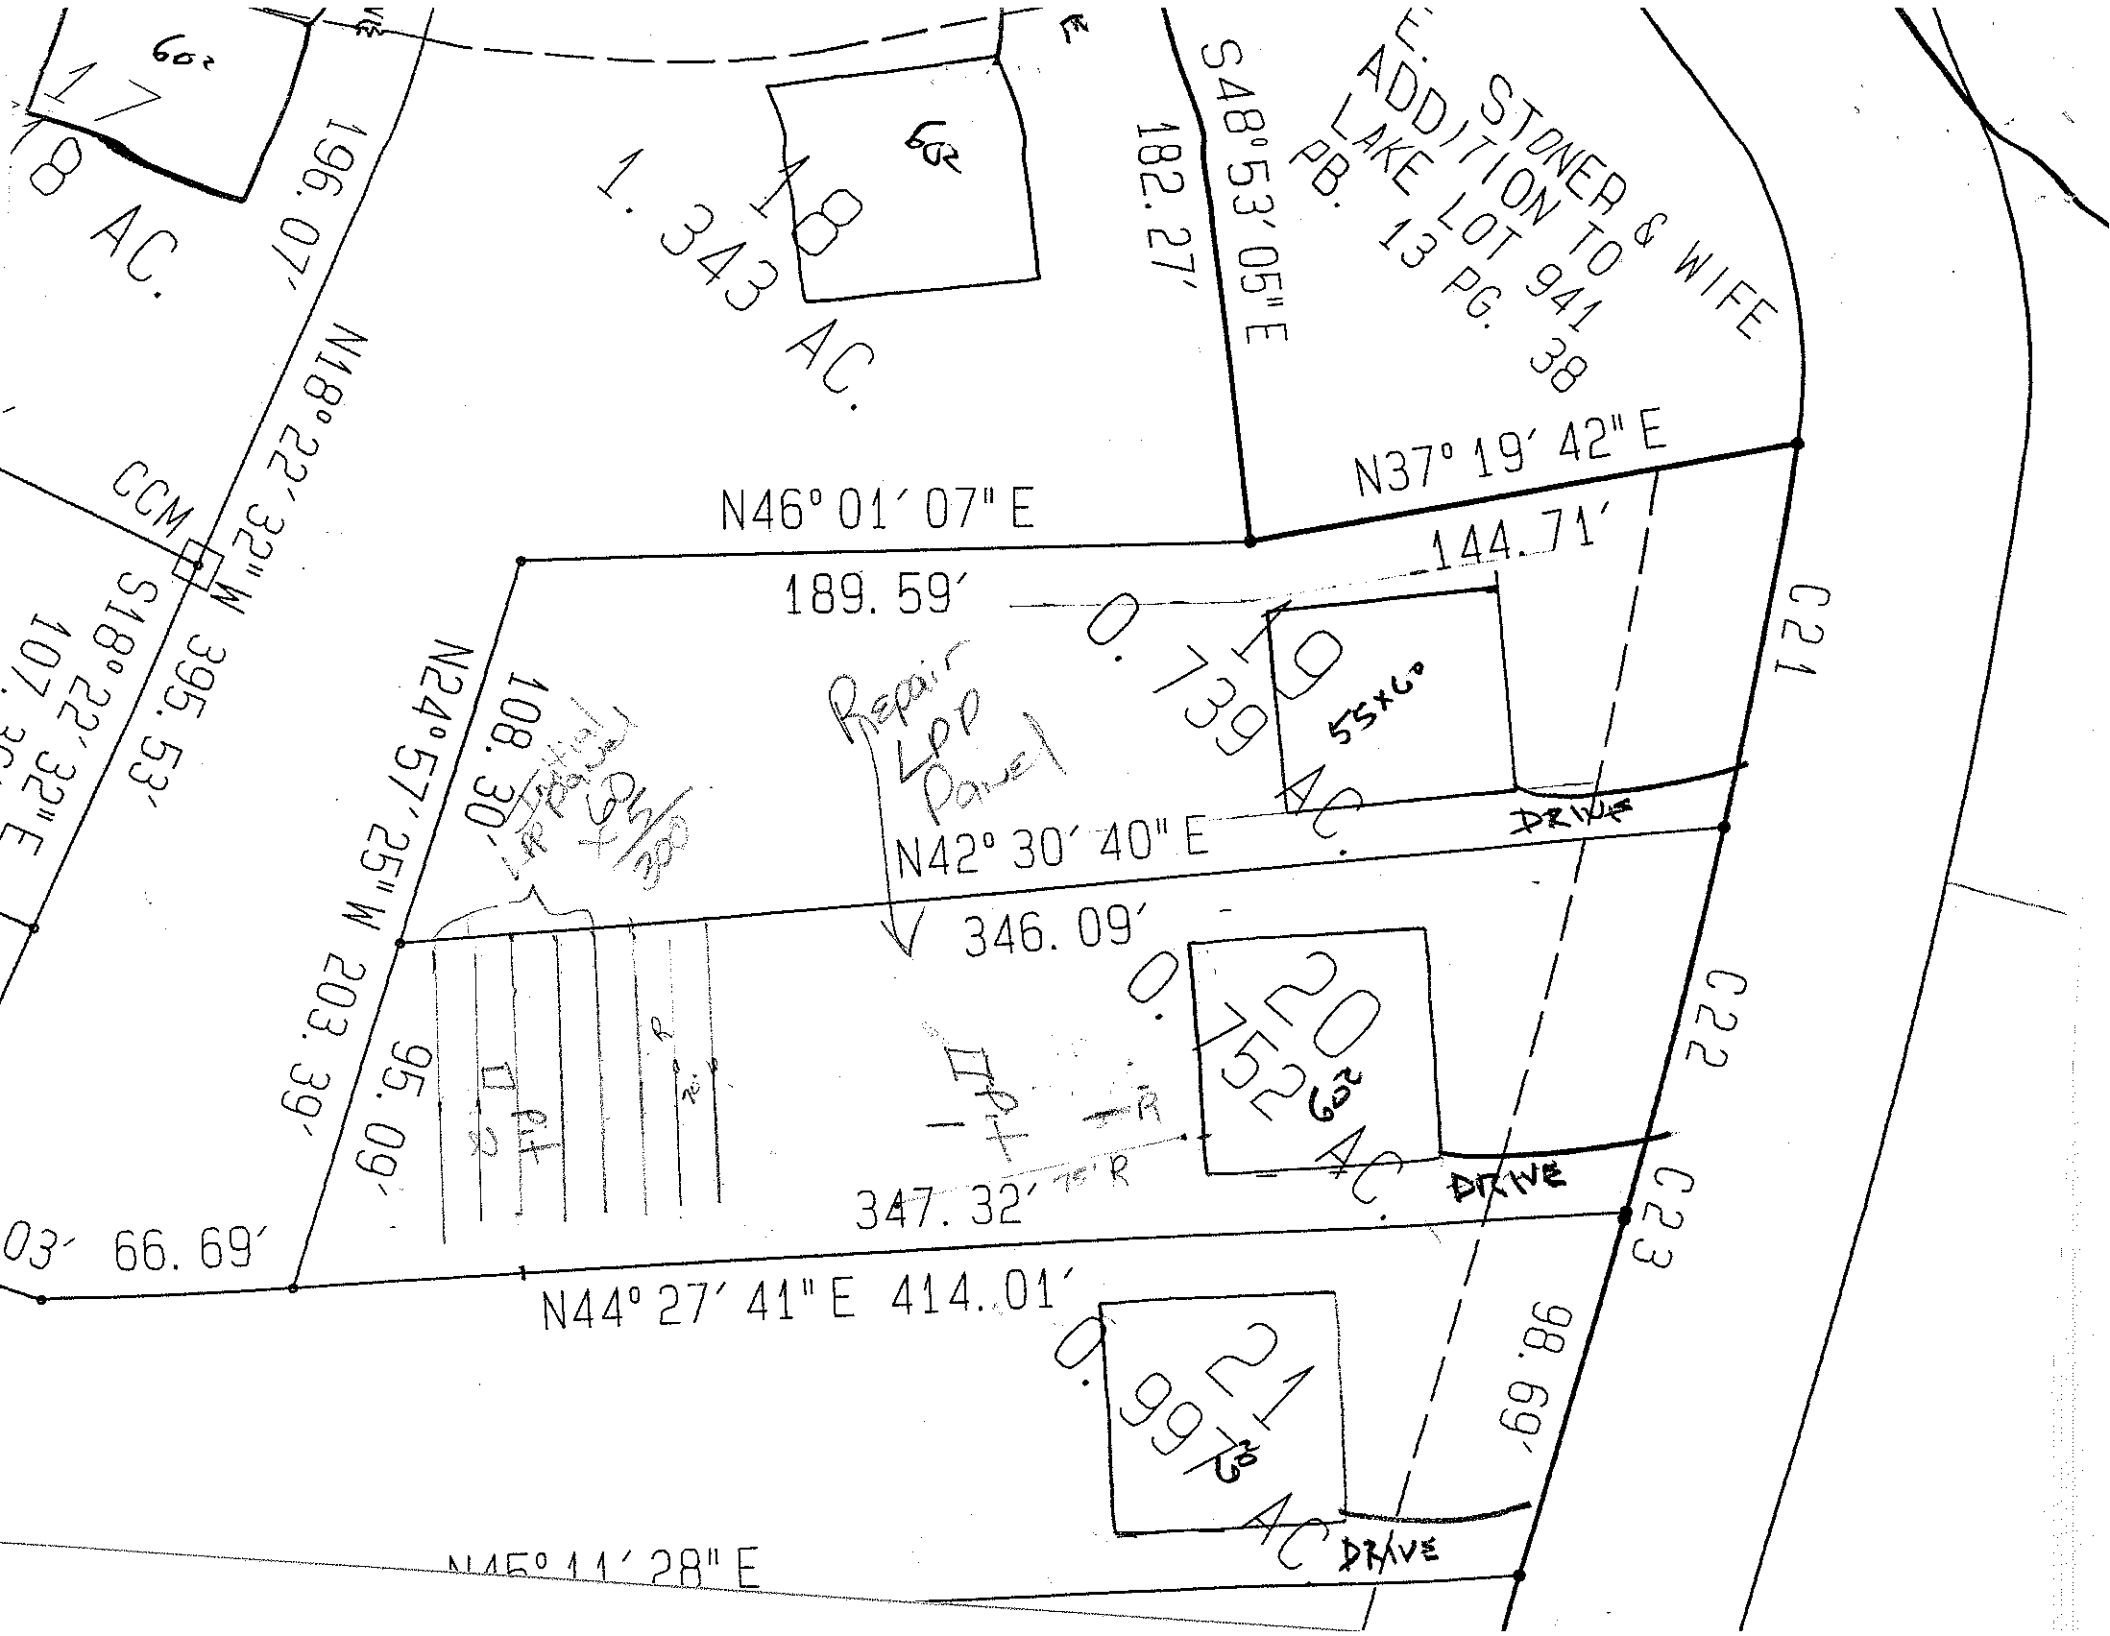
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-12"	Brw SL	GR FR					PS .3
		12-50"	Ka Brw SL	MSBK FR	SS,SP	SF	FL		
2		0-24	Rd C	M SBK FR	SS,SP				PS .3
		24-41	Rd C	M SBK FR	SS,SP				
		41-48	SL SAP						
3									
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____

EVALUATED BY: _____
OTHER(S) PRESENT: _____


STONER & WIFE
ADDITION TO
LAKE LOT 941
PB. 13 PG. 38
S48°53'05"E
182.27'
1.343 AC.
196.07'
N18°22'32"W 395.53'
CCM
N46°01'07"E
189.59'
N37°19'42"E
144.71'
0.739 AC.
55x60
DRIVE
N42°30'40"E
346.09'
108.30'
N24°57'25"W 203.39'
95.09'
0.752 AC.
DRIVE
347.32'
N44°27'41"E 414.01'
0.995 AC.
DRIVE
98.69'
C21
C22
C23
Repair
Lop
Panel
Initial
Date
66.69'