DEPARTMENT OF ENVIRONMENT,
HEALTH & NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH

DRAFT

PROPERTY I.D.#: _____
DATE: _____
COUNTY: _____

# SOIL SITE EVALUATION FOR
## ON-SITE WASTEWATER SYSTEM

APPLICANT: Tommy Steele OWNER__ AGENT:__ PHONE: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED _____
PROPOSED FACILITY: _____
PROPERTY SIZE: _____

LOCATION OF SITE: _____
WATER SUPPLY: On-site Well____ Comm. Well___ Public___ Other_____ EVAL. METHOD: Auger Boring___ Pit___ Cut___

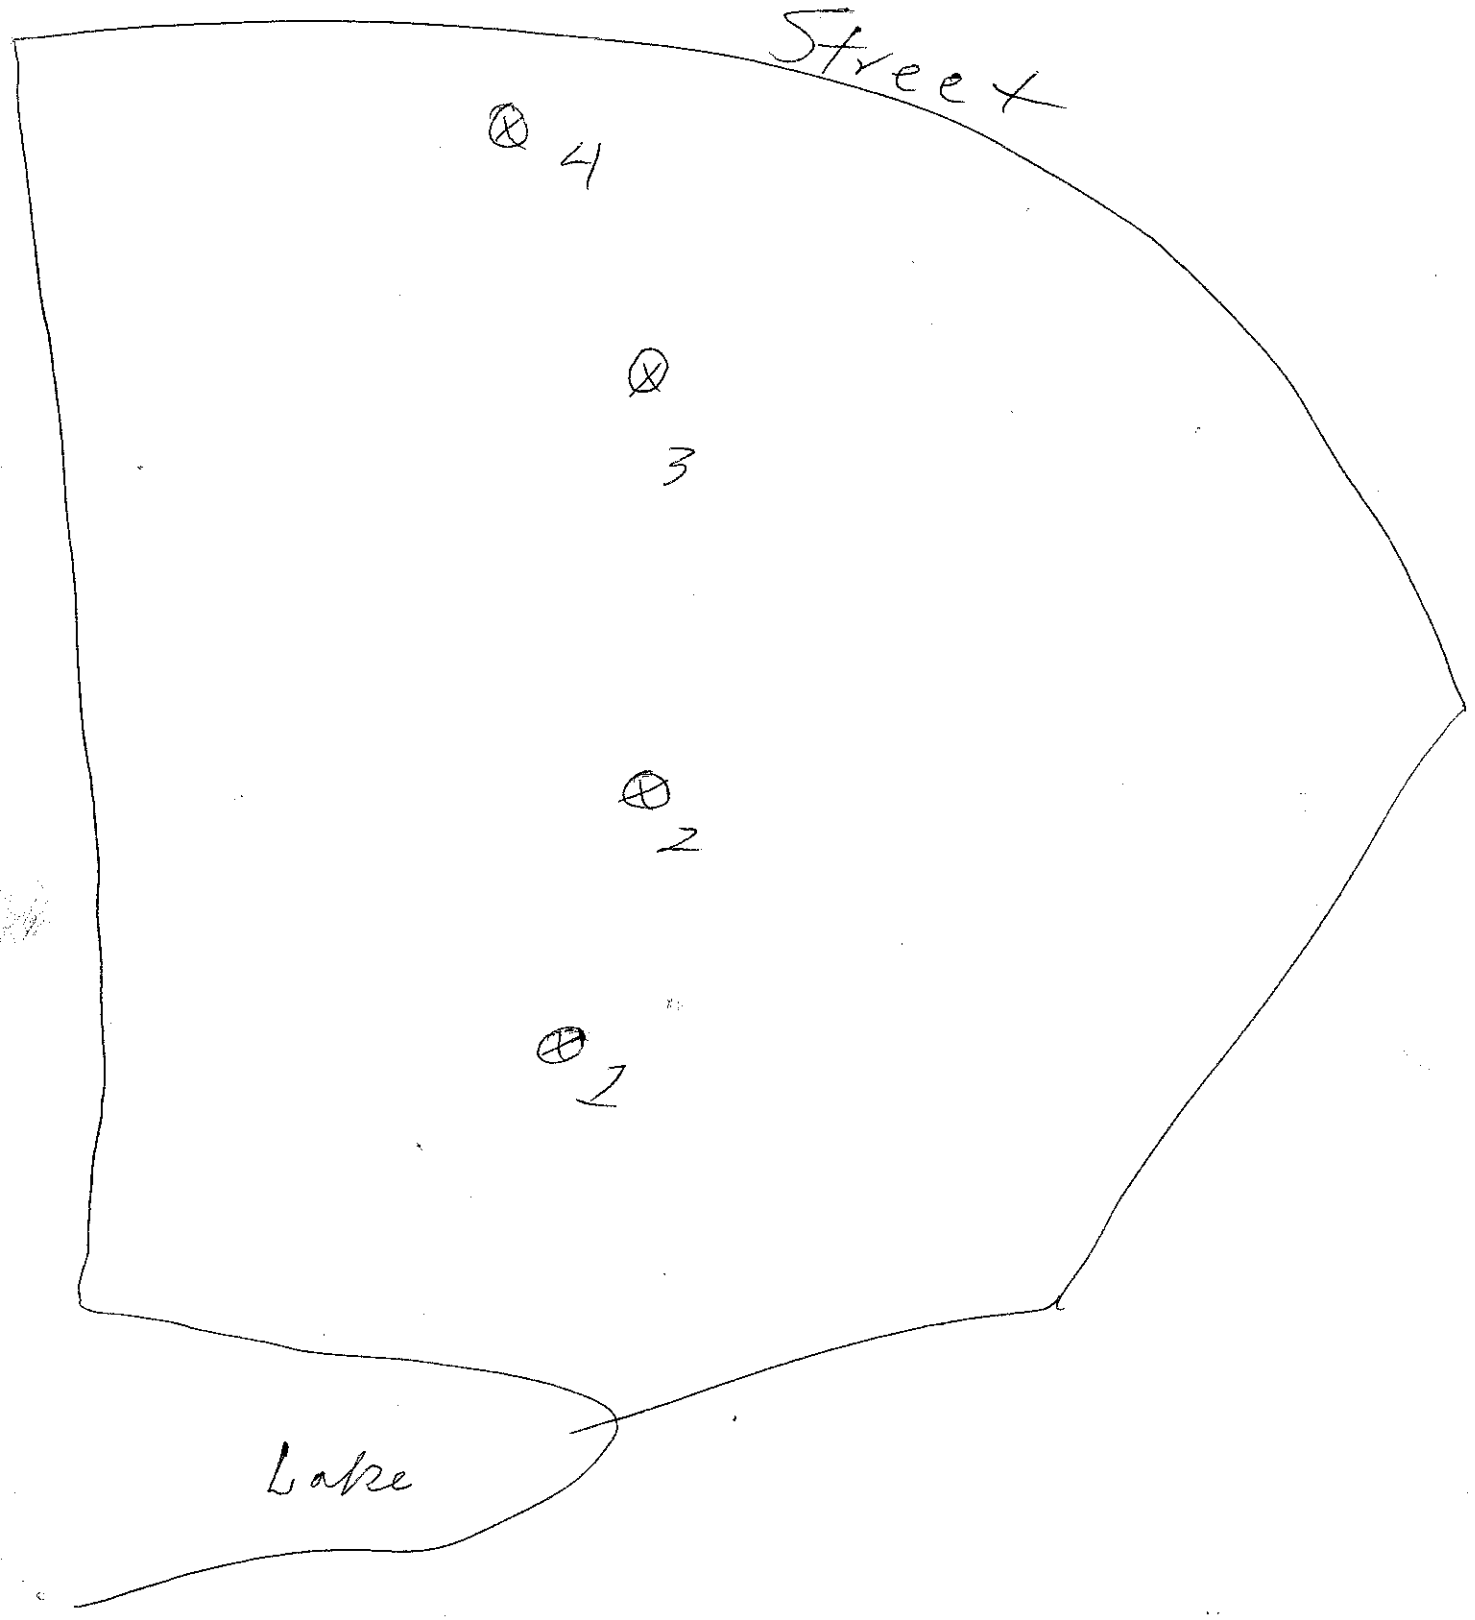
| PROFILE # | .1940 LANDSCP POS./ SLOPE(%) | HORIZON DEPTH (IN.) | .1941 (a)(1) TEXTURE | .1941 (a)(2) STRUCTURE | .1941 (a)(3) MINEROLOGY | MATRIX COLOR | MOTTLE COLOR | OTHER PROFILE FACTORS |
|---|---|---|---|---|---|---|---|---|
| 1 | linear 10 to 8% | 0 to 4" | L | Gr | | | | .1942 Wetness Cond. N/A |
| | | 4 to 24 | C | SBK | 1:1 | | | .1943 Depth/.1956 Sapr. 36" |
| | | 24 to 36 | CL | weak SBK | 1:1 | | | .1944 Restrictive Hori. N/A |
| | | 36"+ | Saprolite | | | | | .1948 Profile Class. PS |
| | | | | | | | | Profile LTAR .2 |
| 2 | linear 12 % | 0 to 4" | L | Gr | | | | .1942 Wetness Cond. N/A |
| | | 4 to 24 | C | SBK | 1:1 | | | .1943 Depth/.1956 Sapr. N/A |
| | | 24 to 36 | C | weak SBK | 1:1 | | | .1944 Restrictive Hori. N/A |
| | | 36 to 48 | Transition | | B/C | | | .1948 Profile Class. PS |
| | | | | | | | | Profile LTAR .3 |
| 3 | linear 10% | 0 to 4" | L | Gr | | | | .1942 Wetness Cond. N/A |
| | | 4 to 30 | C | SBK | 1:1 | | | .1943 Depth/.1956 Sapr. N/A |
| | | 30 to 40 | C | weak SBK | 1:1 | | | .1944 Restrictive Hori. N/A |
| | | 40 to 48 | Transition | | B/C | | | .1948 Profile Class. PS |
| | | | | | | | | Profile LTAR .3 |
| 4 | linear 10% | 0 to 4" | L | Gr | | | | .1942 Wetness Cond. N/A |
| | | 4 to 36 | C | SBK | | | | .1943 Depth/.1956 Sapr. N/A |
| | | 36 to 48 | Transition | | B/C | | | .1944 Restrictive Hori. N/A |
| | | | | | | | | .1948 Profile Class. PS |
| | | | | | | | | Profile LTAR .3 |

AVAILABLE SPACE (.1945) Yes OTHER FACTORS (.1946) _____ SITE CLASSIFICATION (.1948) PS

SYSTEM TYPE Pump To Porus Block Panel LONG-TERM ACCEPTANCE RATE(S) .3

EVALUATED BY: J.C. Moore OTHER(S) PRESENT: mr & mrs Tommy Steele

COMMENTS: _____


Street
4
3
2
1
Lake