WASTEWATER SECTION COUNTY:

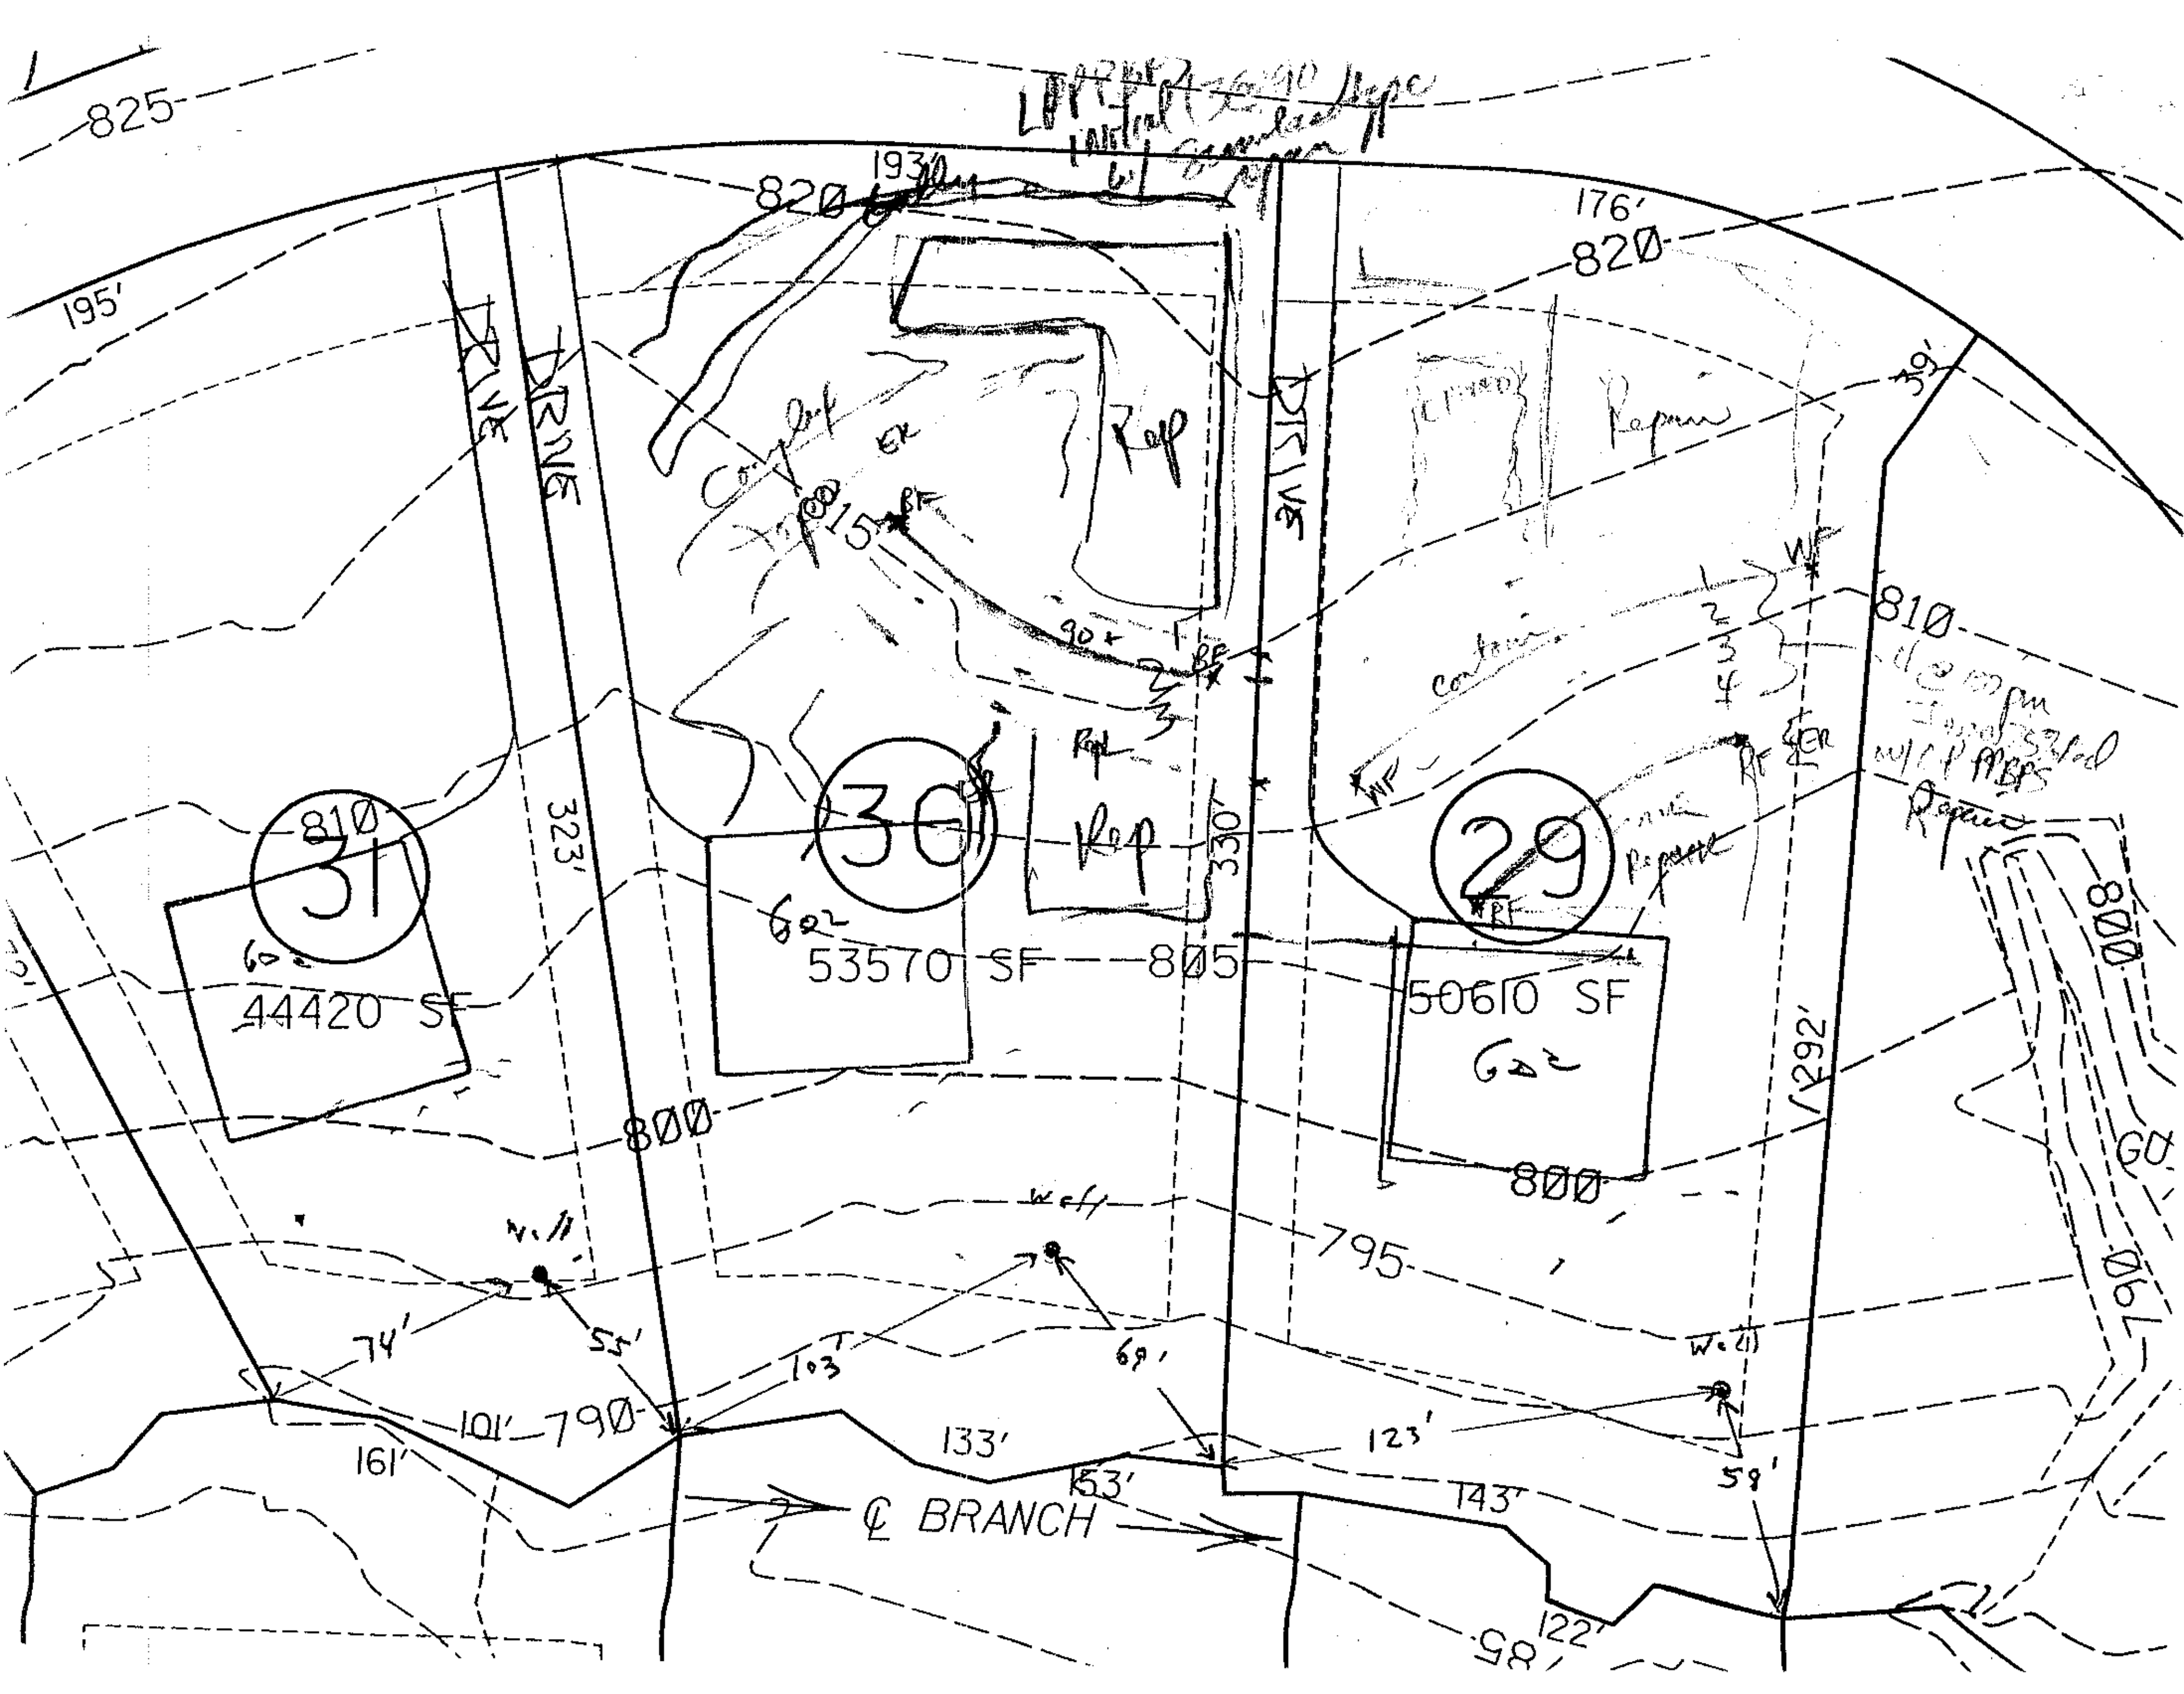
SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

ER: CRF APPLICANT:
RESS: APPLICATION DATE: DATE EVALUATED: 10-20-98
POSED FACILITY: PROPOSED DESIGN FLOW (.1949): PROPERTY SIZE:
ATION OF SITE: Wildwood Cove PROPERTY RECORDED:
ER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other
LUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
E OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
#36 TCJ (Lot 30)	0-17	SaLb RcL	fi					PS .3
	17-27	wk SaLb/HB RcL	fi-fr ssp					
	27-37	wk YR L Sap	mlc fi					
#37 TCJ (Lot 30)	0-24	SaLb RcL	fi-fr					PS .3
	24-42	wk SaLb R light CL	mlSap fr					
#38 TCJ (Lot 29)	0-26	SaLb RcL	fi-fr ssp					PS .3
	26-46	wk SaLb RcL	fr ssp few mlSap					
#39 (Lot 29)	0-20	SaLb RcL	fi-fr ssp					PS .3
	20-29	wk SaLb/HB RcL	few mlSap fi-fr ssp					
	29-46	wk YR L Sap	fr ssp					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
able Space (.1945)		
m Type(s)		
TAR		

OTHER FACTORS (.1946):
SITE CLASSIFICATION (.1948):
EVALUATED BY:
OTHER(S) PRESENT:


825
820
195'
193'
176'
DRIVE
DRIVE
DRIVE
810
323'
330'
31
30
29
44420 SF
53570 SF
50610 SF
805
800
810
795
790
800
790
292'
74'
55'
103'
69'
123'
59'
101'
161'
133'
153'
143'
122'
39'
℄ BRANCH