213 Kenway Loop 4639-42-9007

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Frank & Lea Dwyer DATE 6/6/89

PHONE: Business _____ Home 892-4550 PERMIT NO. 171

LOCATION 150 W. TR Perth Rd. TL Kenway ~ 1/4 mile on Left 1034

SUBDIVISION NAME C Land T LOT NO. 9T S. R. No. _____ SECTION OR BLOCK NO. _____

Tax #: 25-5-A-91 (Davidson)

House ( ) Mobile Home (✓) Business ( ) Other _____

No. Bedrooms 2 No. Bathrooms 1

Garbage Disposal Unit Yes ( ) No (✓)

Auto. Dishwasher Yes (✓) No ( )

Auto. Wash Machine Yes (✓) No ( )

Site Suitable Yes (✓) No ( )

Lot Area 20000ft²

Character & Porosity of Soil clay

Percolation Rate .35 gpd / ft²

Topography 40%


Depth to Water Table 4'+

Rock or other impervious formations none obs.

AC -> W

_____ Basement with Plumbing

Basement without Plumbing ✓ No Basement

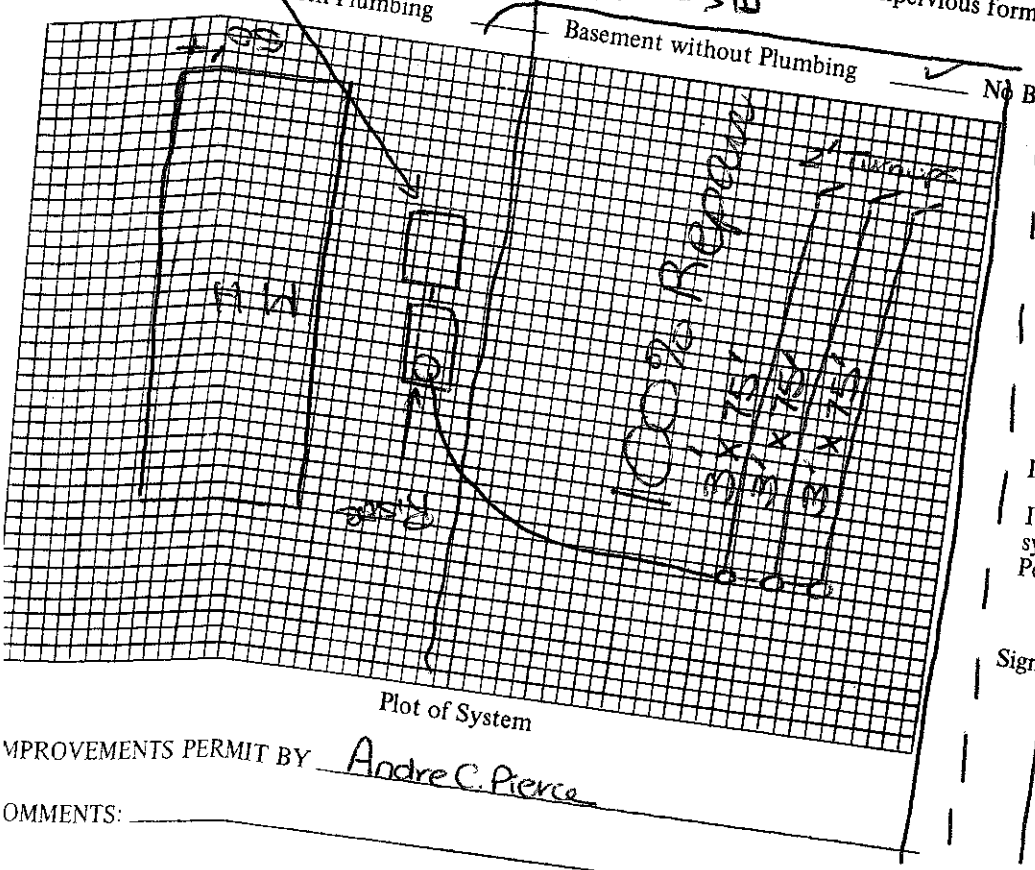

PT: 1000 gals

Size of Tank 1000 Gals.

Nitrification Field:

No. of Lines 3

Sq. Ft. 675 Linear Ft. 225

Depth of Stone in Lines 12"

Water Supply: Individual (✓)

Public ( )

Lake Norman Backhoe

Installed by Rodney Ellis

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

MPROVEMENTS PERMIT BY Andre C. Pierce

OMMENTS: _____

RTIFICATE OF COMPLETION BY Andre C. Pierce, R.S. DATE 6/6/89

'STING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

it is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making ovements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy