DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ____ *of* ____
PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

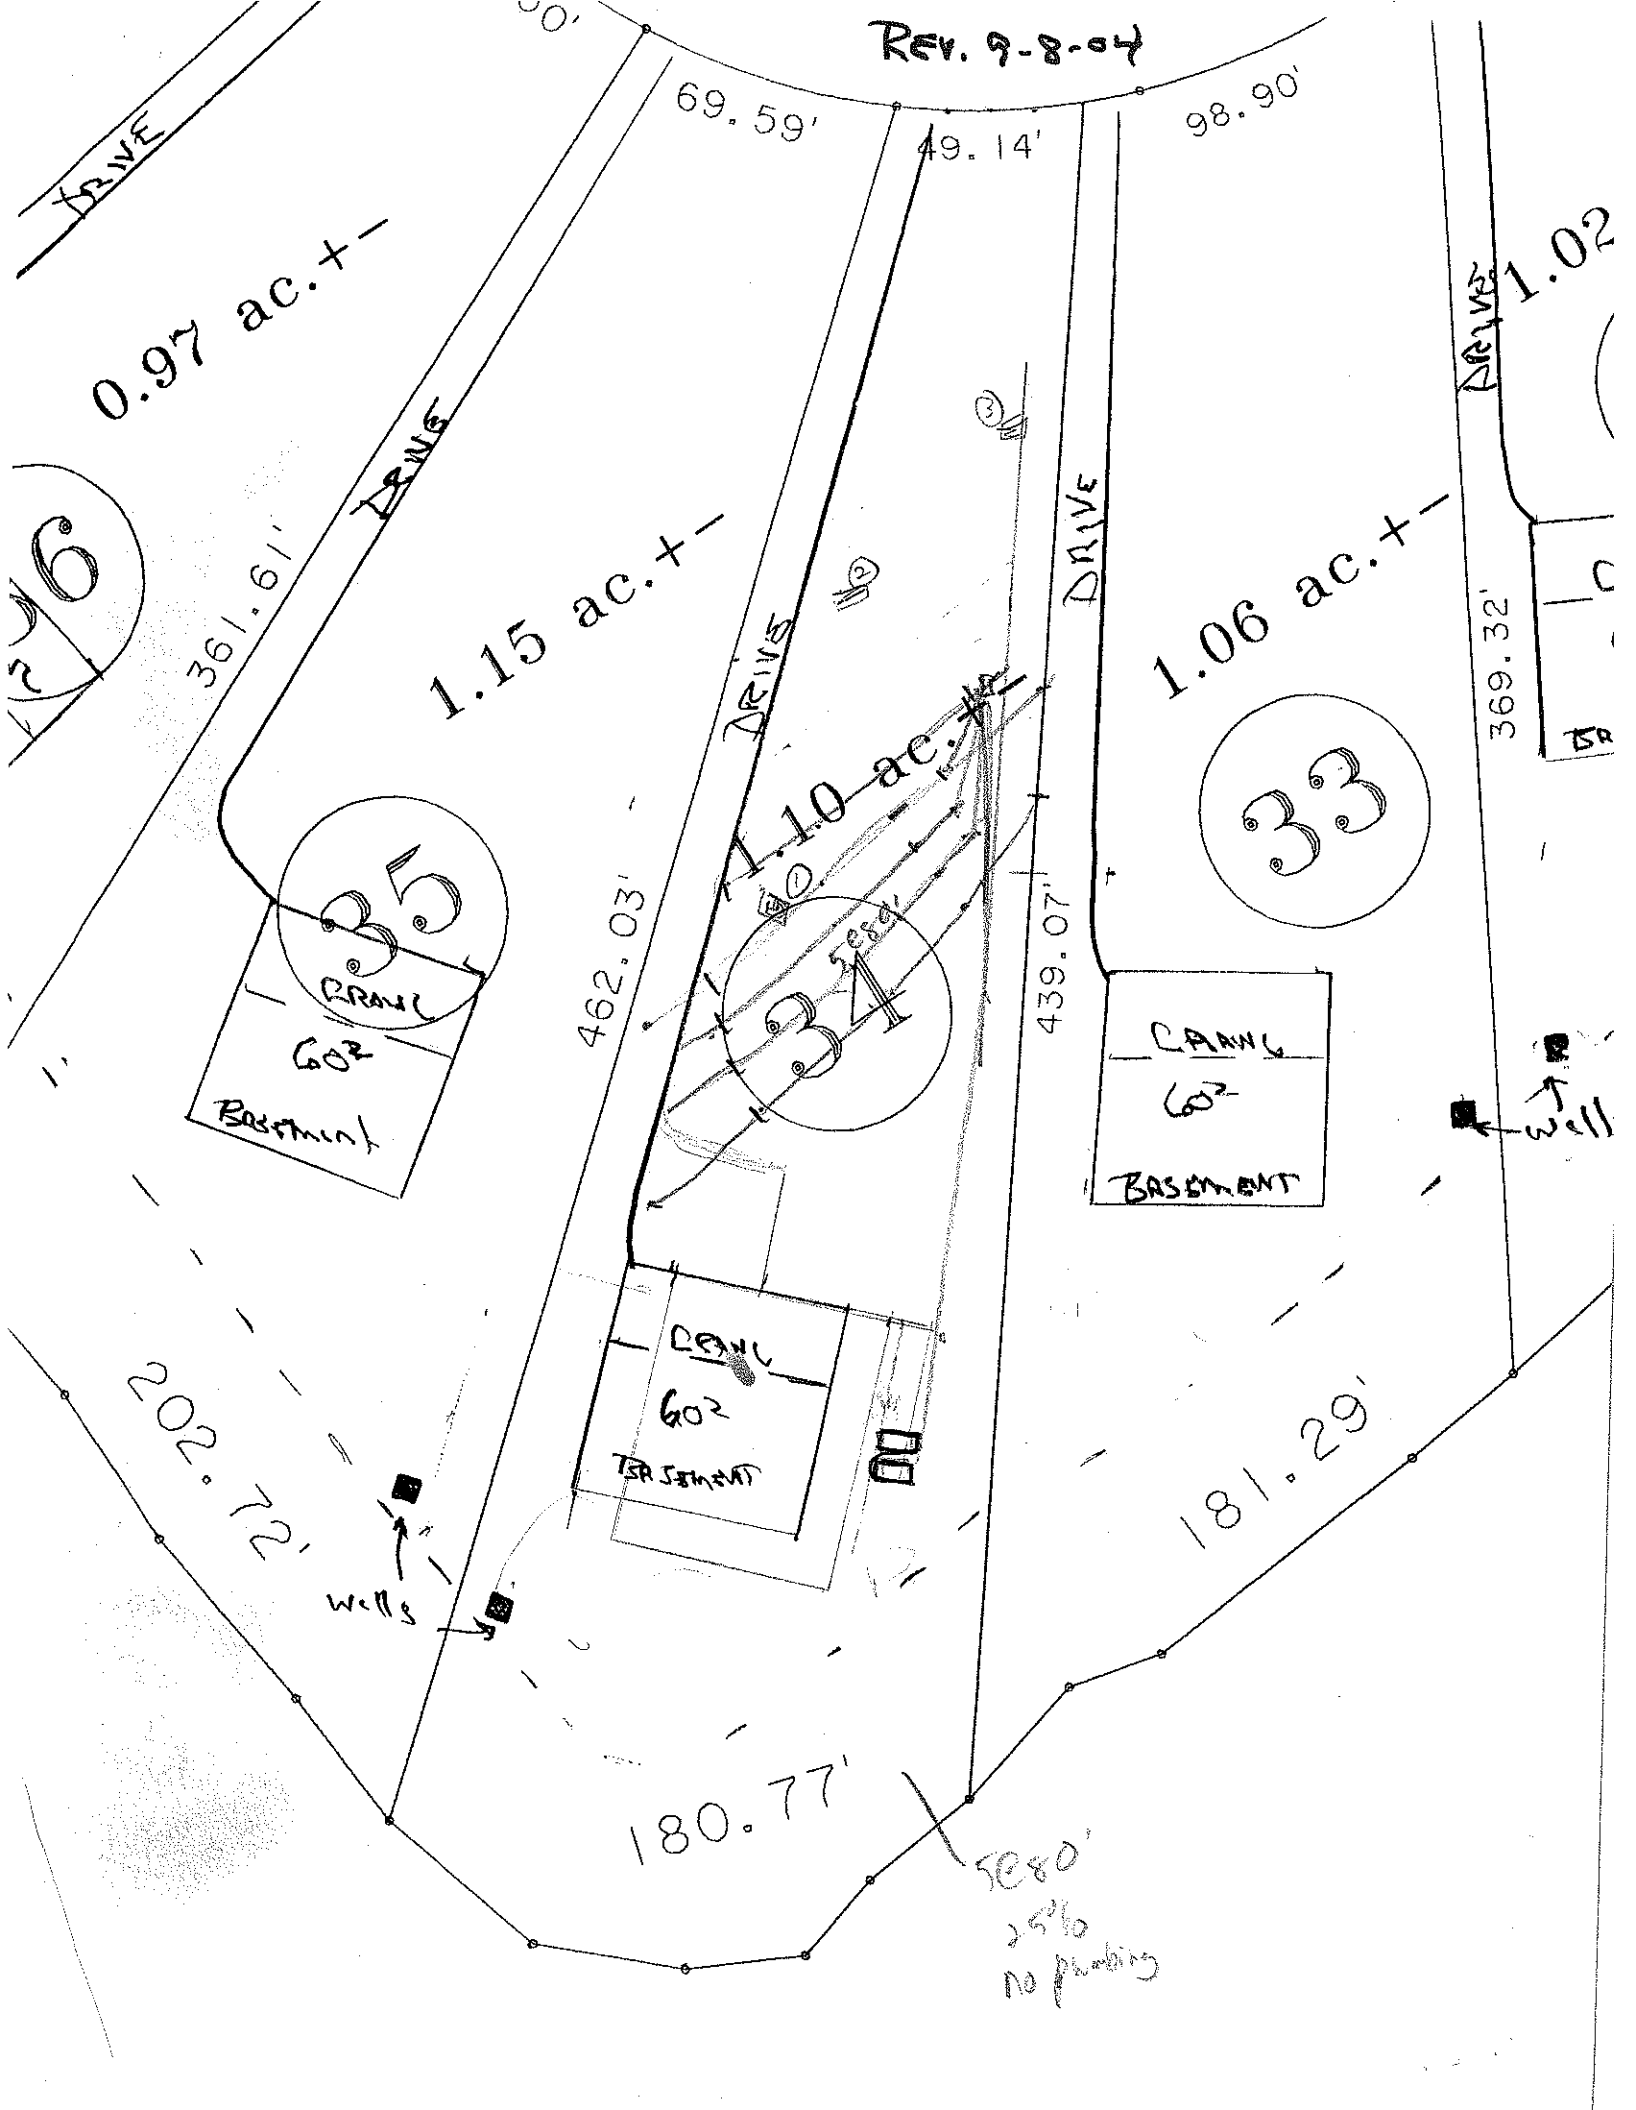
OWNER: _____ APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: _____
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____
LOCATION OF SITE: lot 34 Bay Crossing PROPERTY RECORDED: _____
WATER SUPPLY: ❑ Private ❑ Public ❑ Well ❑ Spring ❑ Other _____
EVALUATION METHOD: ❑ Auger Boring ❑ Pit ❑ Cut
TYPE OF WASTEWATER: ❑ Sewage ❑ Industrial Process ❑ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-4	BSL GR	- fri SSSP	common SAP				PS .3
		4-27	RC MFSBK	fri SSSP					
		27-45	YR CL WISBK	fri SSSP					
		45-52	RYSL SAP M	fri SSSP					
2		0-5	BSL GR	fri SSSP					PS .3
		5-24	RC SBK	fri SSSP					
		24-51	RC MFSBK	fri SSSP					
3		0-3	BSL GR	fri SSSP	few SAP				PS .3
		3-35	RC MSBK	fri SSSP					
		35-54	YR CL WISBK	fri SSSP -					
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____

EVALUATED BY: _____
OTHER(S) PRESENT: _____


REV. 9-8-04
69.59'
49.14'
98.90'
DRIVE
0.97 ac.+-
361.61'
1.15 ac.+-
1.10 ac.+-
1.06 ac.+-
369.32'
462.03'
439.07'
35
34
33
CRAWL
60²
BASEMENT
TEA SEMENT
Well
Wells
202.27'
181.29'
180.77'
50'
80'
2.5%
no plumbing