DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: ____
COUNTY: ____

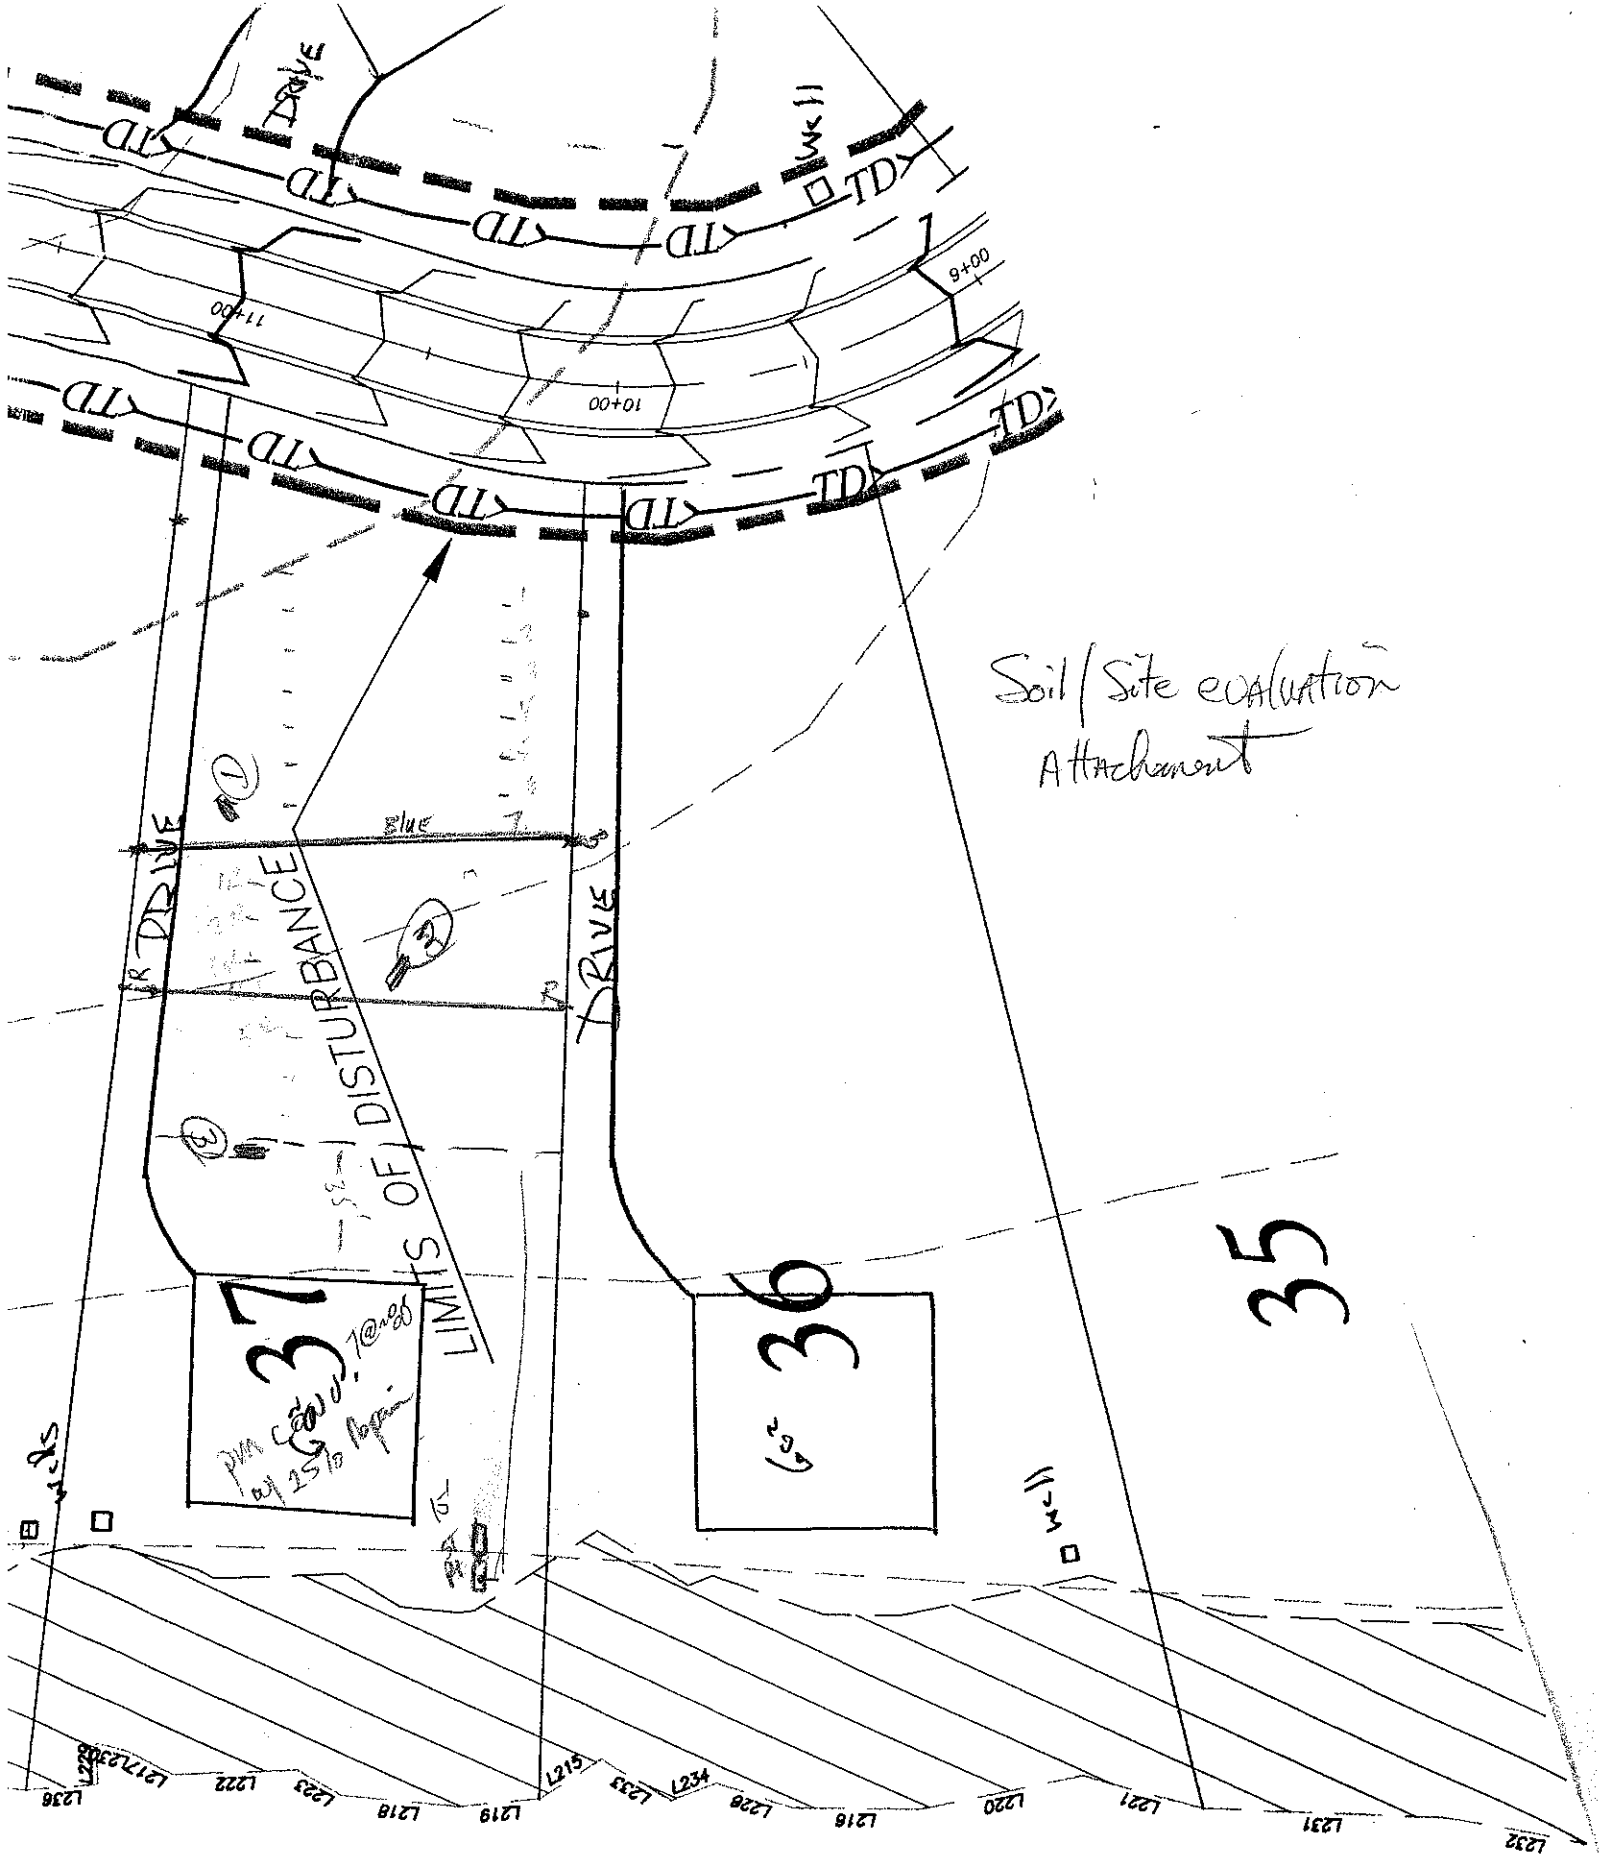
SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: Heath Properties Inc APPLICANT: ____
ADDRESS: ____ APPLICATION DATE: ____ DATE EVALUATED: 2-23-05
PROPOSED FACILITY: SFR PROPOSED DESIGN FLOW (.1949): 480gpd PROPERTY SIZE: ____
LOCATION OF SITE: lot 37 Bay Cove PROPERTY RECORDED: ____
WATER SUPPLY: ☒ Private ☐ Public ☒ Well ☐ Spring ☐ Other ____
EVALUATION METHOD: ☐ Auger Boring ☒ Pit ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-14	wkSBk scl	fr sssp					o3
		14-34	mSBk c	fr sssp sspl					
		34-52	wkSBk cl	fr sssp	Redoximorphic				
2	10-12% L	0-10	gr-wkSBk sl scl	fr sssp					o3
		10-31	SBk cl	fr sssp sspl					
		31-58	wkSBk cl	fr sssp common medium rock fragments					
3		0-8	wkSBk scl	fr sssp					o3
		8-32	SBk c	fr sssp sspl					
		32-50	mwkSBk cl	fr sssp	Redoximorphic				
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	5	5/18
System Type(s)	Conv	Conv 25% Red
Site LTAR	o3	o3

OTHER FACTORS (.1946): ____
SITE CLASSIFICATION (.1948): PS
EVALUATED BY: [illegible] RS
OTHER(S) PRESENT: Kathleen J HS


Soil/Site evaluation
Attachment
LIMITS OF DISTURBANCE
DRIVE
DRIVE
37
36
35
9+00
10+00
11+00
Blue