DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

PROPERTY ID #: _____
COUNTY: _____

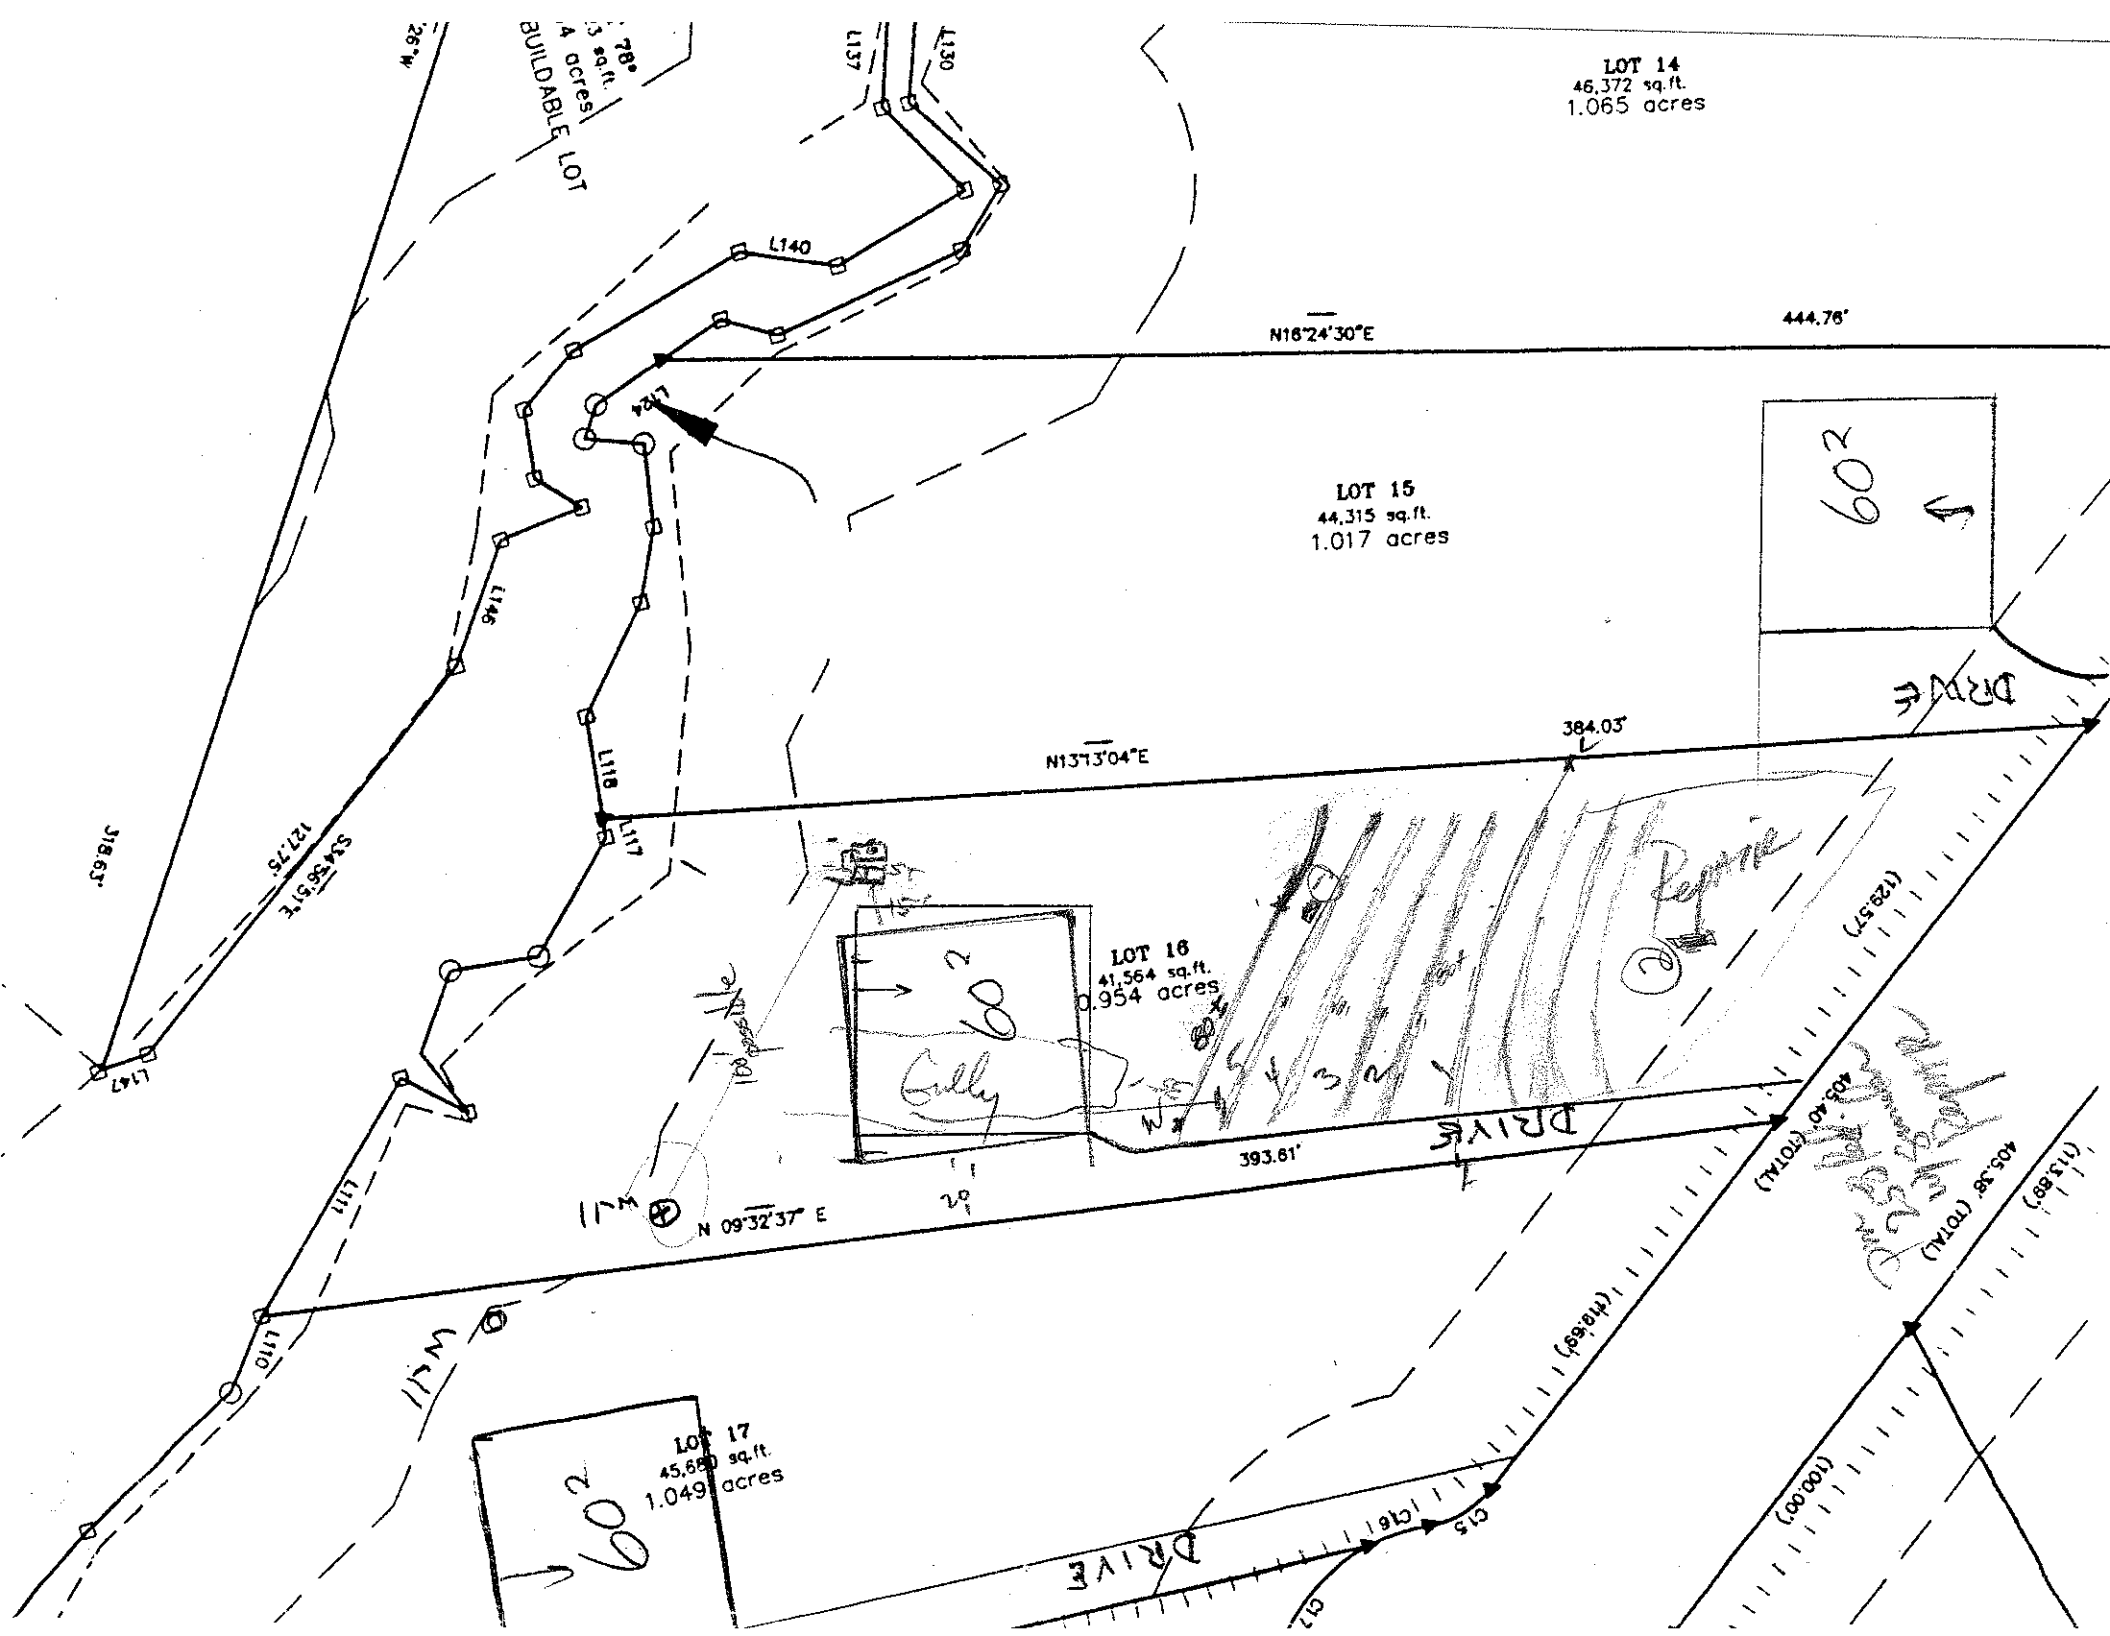
SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: Shawnda DeLong APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: 10-16-09
PROPOSED FACILITY: SFR PROPOSED DESIGN FLOW (.1949): 480 gpd PROPERTY SIZE: _____
LOCATION OF SITE: Lot 16 Huntington Woods PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☐ Public ☑ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☑ Pit ☐ Cut
TYPE OF WASTEWATER: ☑ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-3	gr fsm/s+/sol	fr sss sp					.25-.3
		3-29	m fgpk R/d	fr sp-sss sop					
		29-48	wk fgpk R/d	fr sss sp few inf sap & w R					
2	<15% L	0-6	wk fgpk R/new sol	fr sss sp					.3
		6-20	m fgpk RC	fr sss sp sap					
		20-48	wk fgpk rpd	fr ss sp few inf sap, few w-coh					
3									
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)	pm 25% red	pm/LPP 25% Red
Site LTAR	.3	.3

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): PS
EVALUATED BY: _____
OTHER(S) PRESENT: Paul Bennington


LOT 14
46,372 sq.ft.
1.065 acres
LOT 15
44,315 sq.ft.
1.017 acres
LOT 16
41,564 sq.ft.
0.954 acres
LOT 17
45,680 sq.ft.
1.049 acres
BUILDABLE LOT
N16°24'30"E
444.76'
N13°13'04"E
384.03'
393.61'
N 09°32'37" E
S14°56'51"E
127.75'
DRIVE
L117
L118
L130
L137
L140
L146
L147
L110
C15
C16
C17
602