DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

PROPERTY ID #: _____
COUNTY: _____

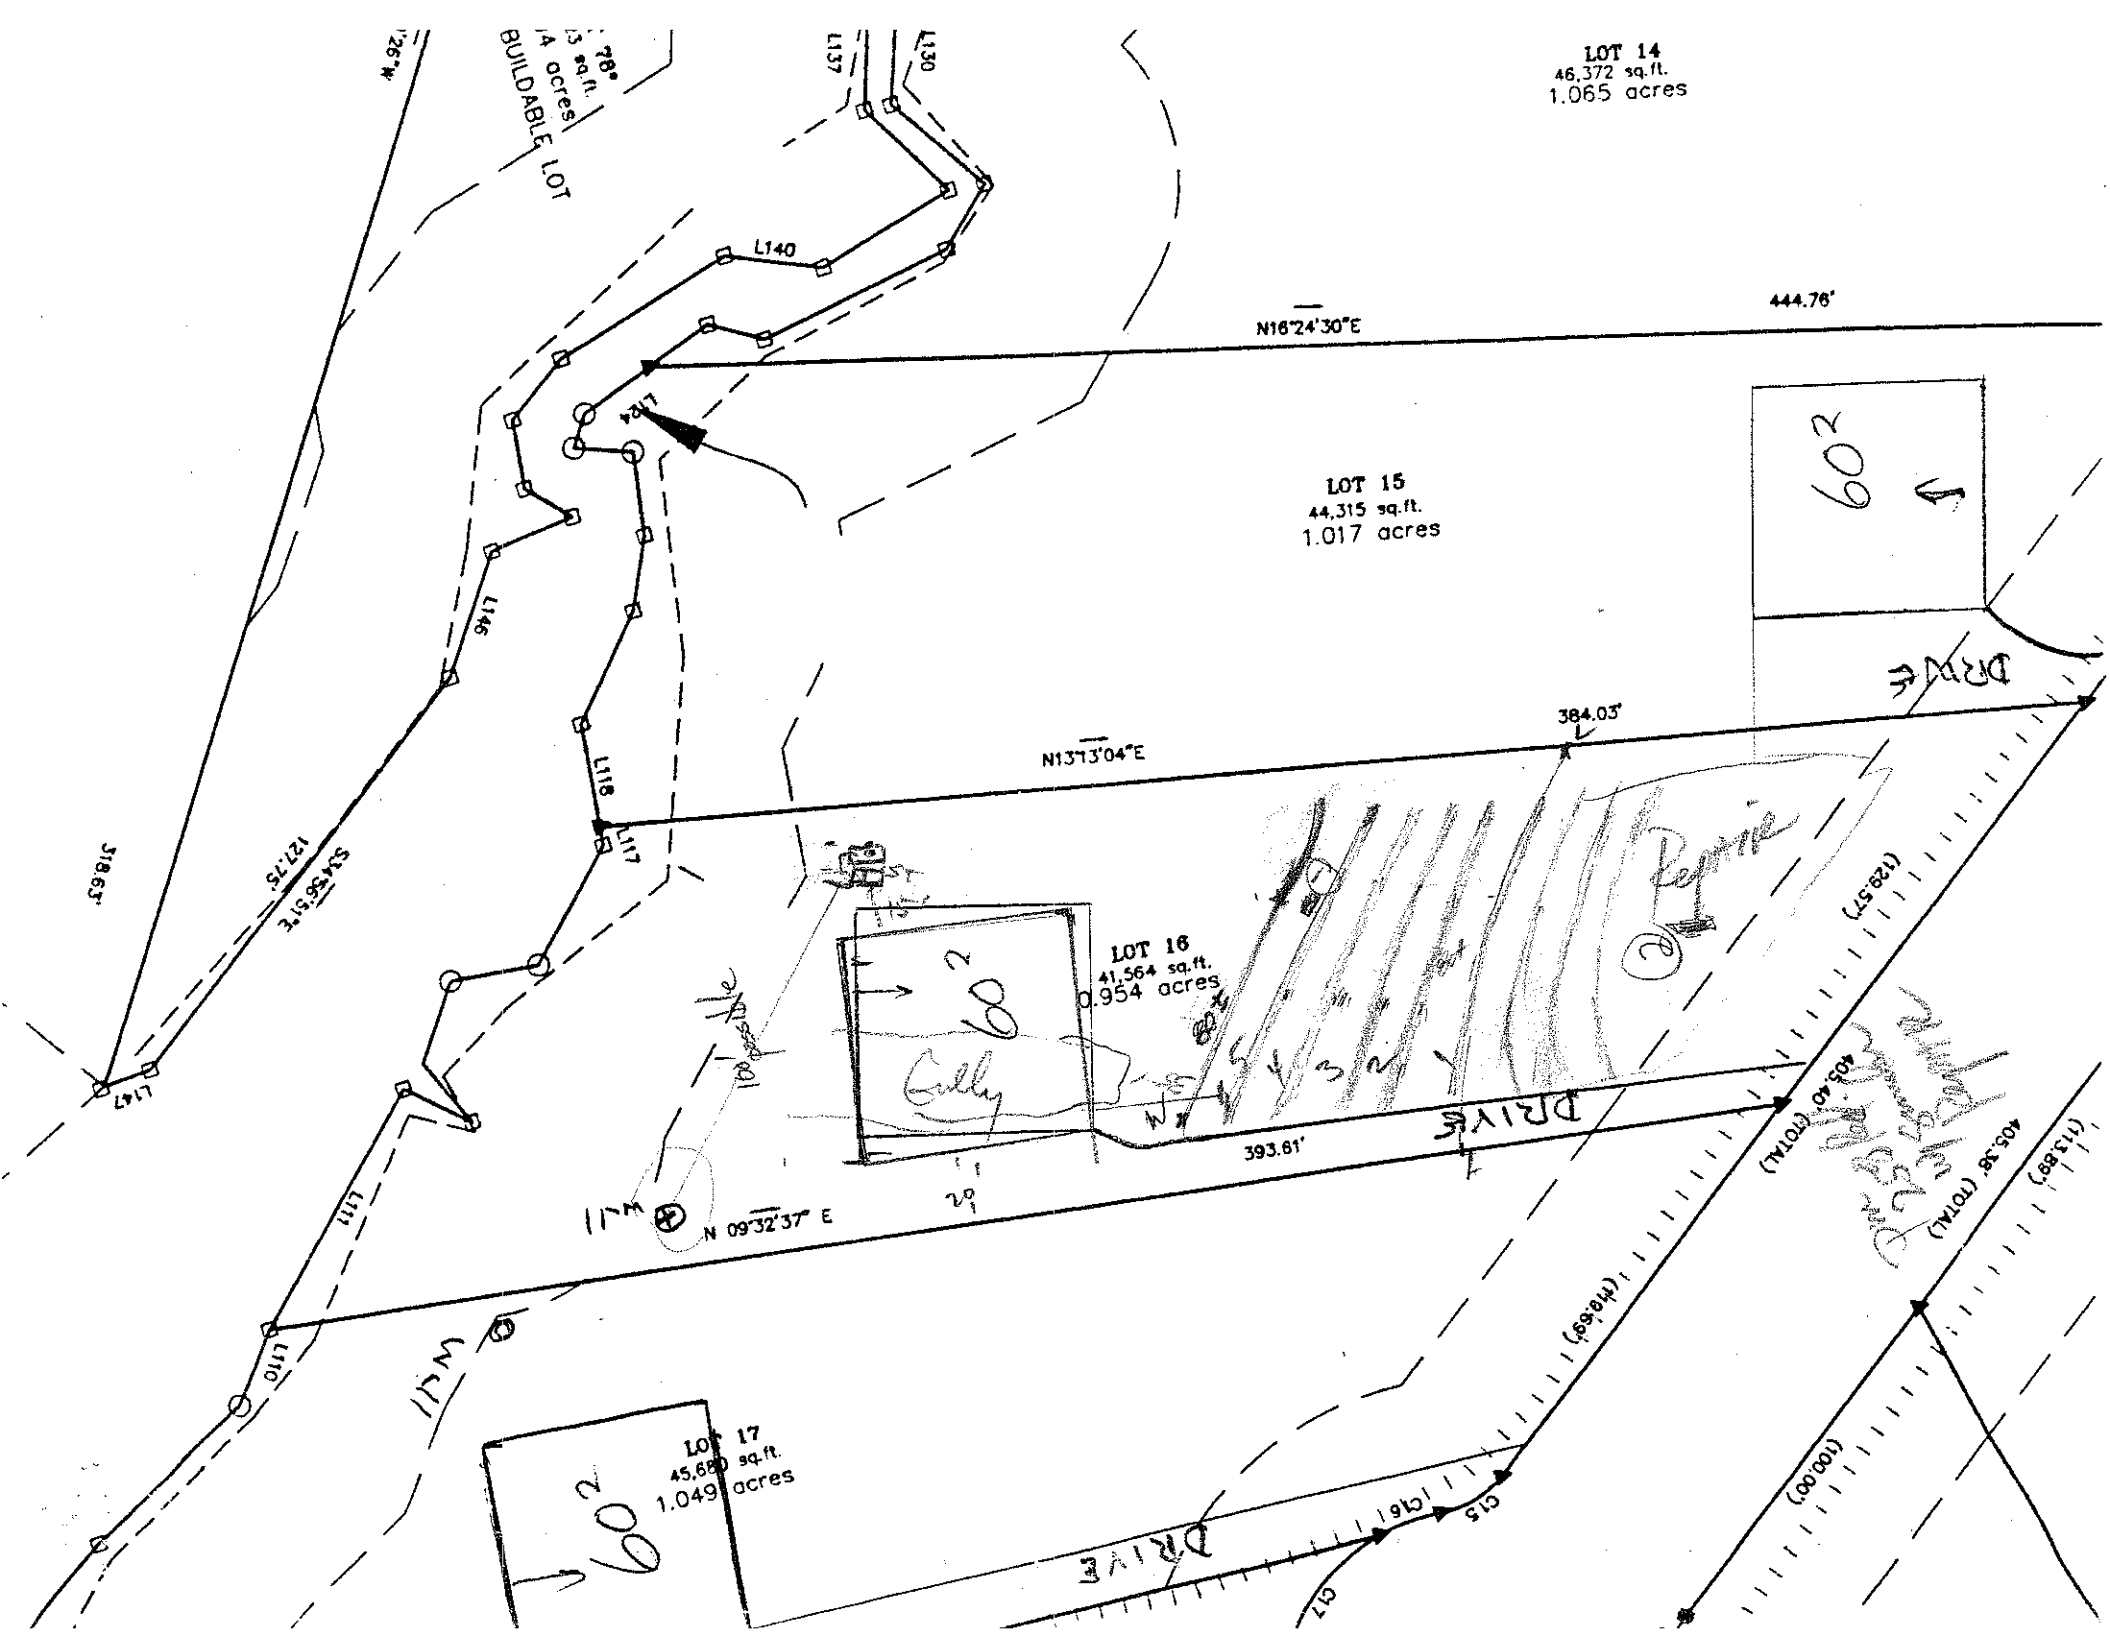
SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: Shavender Dalcap APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: 10-16-04
PROPOSED FACILITY: SFR PROPOSED DESIGN FLOW (.1949): 480 gpd PROPERTY SIZE: _____
LOCATION OF SITE: Lot 16 Worthington Woods PROPERTY RECORDED: _____
WATER SUPPLY: ☒ Private ☐ Public ☒ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☒ Pit ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-3	gr fsm/sl/sd	fr sss p					.25-.3
		3-29	m fsbk rd/dk	fr sp-sss p sep					
		29-48	wk fsbk rd	fr sss p	fe/inf sap & w r				
2	< 15% L	0-6	wk fsbk rd/brn/sd	fr sss p					.3
		6-20	m sbk RC	fr sss p sap					
		20-48	wk fsbk rd/pl	fr sss p	fe/inf sap, few w. rock				
3									
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)	pm 25% Red	pm/LP 25% Red
Site LTAR	.3	.3

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): BS
EVALUATED BY: _____
OTHER(S) PRESENT: _____


LOT 14
46,372 sq.ft.
1.065 acres
BUILDABLE LOT
L140
N16°24'30"E
444.76'
LOT 15
44,315 sq.ft.
1.017 acres
L146
L118
L117
N13°13'04"E
384.03'
DRIVE
LOT 16
41,564 sq.ft.
0.954 acres
L147
L111
N 09°32'37" E
393.61'
L110
LOT 17
45,680 sq.ft.
1.049 acres
C15
C16
C17
(128.57')
405.40' (TOTAL)
(113.89')
405.38' (TOTAL)
(100.00')