ON-SITE WASTEWATER SECTION

PROPERTY ID #: _____
COUNTY: _____

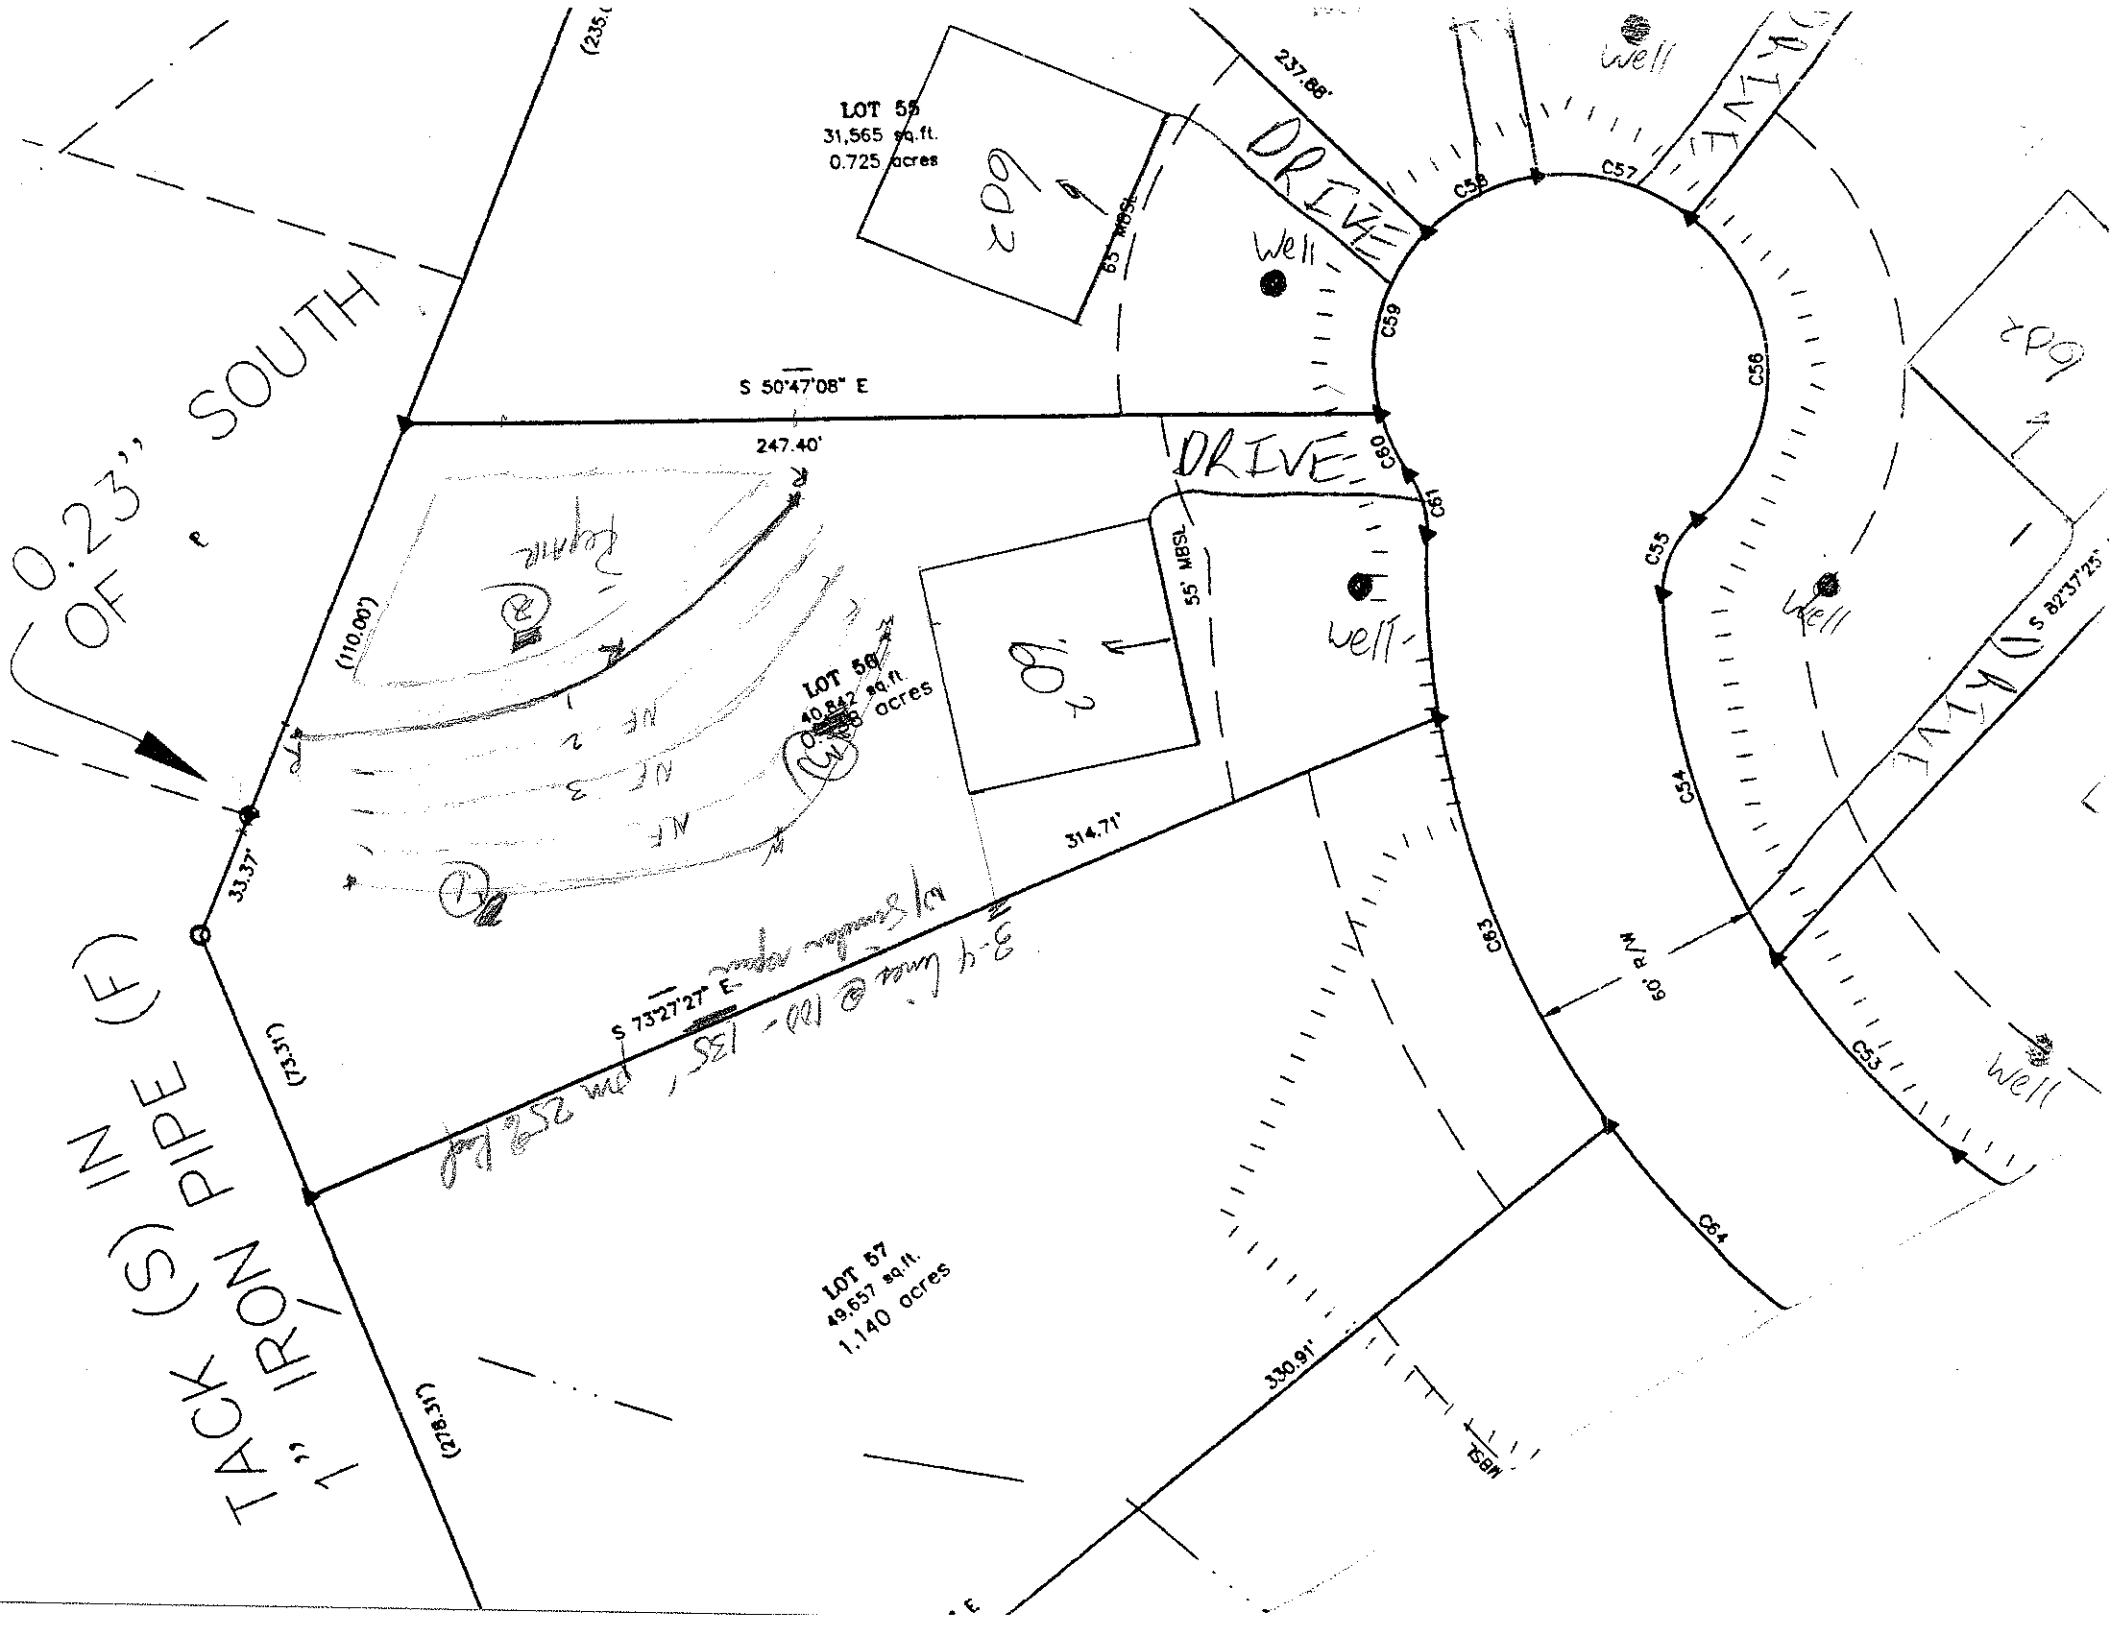
SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: Shearerdale Dev Corp. APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: 11-19-09
PROPOSED FACILITY: SFR PROPOSED DESIGN FLOW (.1949): 480gpd PROPERTY SIZE: _____
LOCATION OF SITE: Lot 56 Northington Woods PROPERTY RECORDED: _____
WATER SUPPLY: ☒ Private ☐ Public ☒ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☒ Pit ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LAND-SCAPE POSITION/ SLOPE %	HORI-ZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	OTHER PROFILE FACTORS .1943 SOIL DEPTH	OTHER PROFILE FACTORS .1956 SAPRO CLASS	OTHER PROFILE FACTORS .1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-4	gr fsl/scl	fr ss p					
		4-26	wk-m fsbk RC	fr ss p					
		26-37	(bc) wk fsbk mod cl	fr ss p	common mod				03
		37-52	massive f/scl	sm fr ss p					
2	flat S/V	0-6	wk fsbk brn scl	fr ss p					
		6-31	wk fsbk RC	fr ss p	sm				
		31-52	wk fsbk gy cl	fr ss p	few mod				03
3		0-12	gr wk fsbk brn scl	fr ss p					
		12-32	wk fsbk RC	fr ss p	sm				
		32-53	wk fsbk RCL	fr ss p	few common mod				03
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	PS
System Type(s)	Pm 25% Red	Same
Site LTAR	03	03

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): PS
EVALUATED BY: [signature]
OTHER(S) PRESENT: Paul Pennington


LOT 55
31,565 sq.ft.
0.725 acres
LOT 56
40,842 sq.ft.
0.938 acres
LOT 57
49,657 sq.ft.
1.140 acres
DRIVE
DRIVE
DRIVE
well
well
well
well
S 50°47'08" E
S 73°27'27" E
247.40'
237.88'
314.71'
330.91'
(110.00')
33.37'
65' MBSL
55' MBSL
90' R/W
0.23" OF (S) IRON PIPE (F)
TACK
C53
C54
C55
C56
C57
C58
C59
C60
C61
C62
C63
C64