09072

# IREDELL COUNTY HEALTH DEPARTMENT

## (SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR John Kindley DATE 10/17/88 ~~PERMIT NO.~~ Quad # 18 A

PHONE: Business ______ Home ~~Et~~ 528-3623

LOCATION Perth Rd. N TL Neil Farm Rd. TR immediately past Winding Shore Rd. S. R. No. Neil Rd.

SUBDIVISION NAME CL and T LOT NO. 145 SECTION OR BLOCK NO. ______

TAX # 3F-1-A-145 Fallstown

House (✓) Mobile Home ( ) Business ( ) Other ______
future – (1 BR for present.)


No. Bedrooms 3 No. Bathrooms 2+

Garbage Disposal Unit Yes (✓) No ( )
Auto. Dishwasher Yes (✓) No ( )
Auto. Wash. Machine Yes (✓) No ( )
Site ~~Suitable~~ P.S. Yes (✓) No ( )
Lot Area 2 ACRES

Character & Porosity of Soil Clay
Percolation Rate .35
Topography 6-8%
Depth to Water Table 4'+
Rock or other impervious formations none observed

____ Basement with Plumbing ____ Basement without Plumbing ____ No Basement

Pump Tank: 1250
Size of Tank 1250 Gals.
Nitrification Field:
No. of Lines ~5
Sq. Ft. 1035 Linear Ft. 345
Depth of Stone in Lines 12"
Water Supply: Individual (✓)
Public ( )

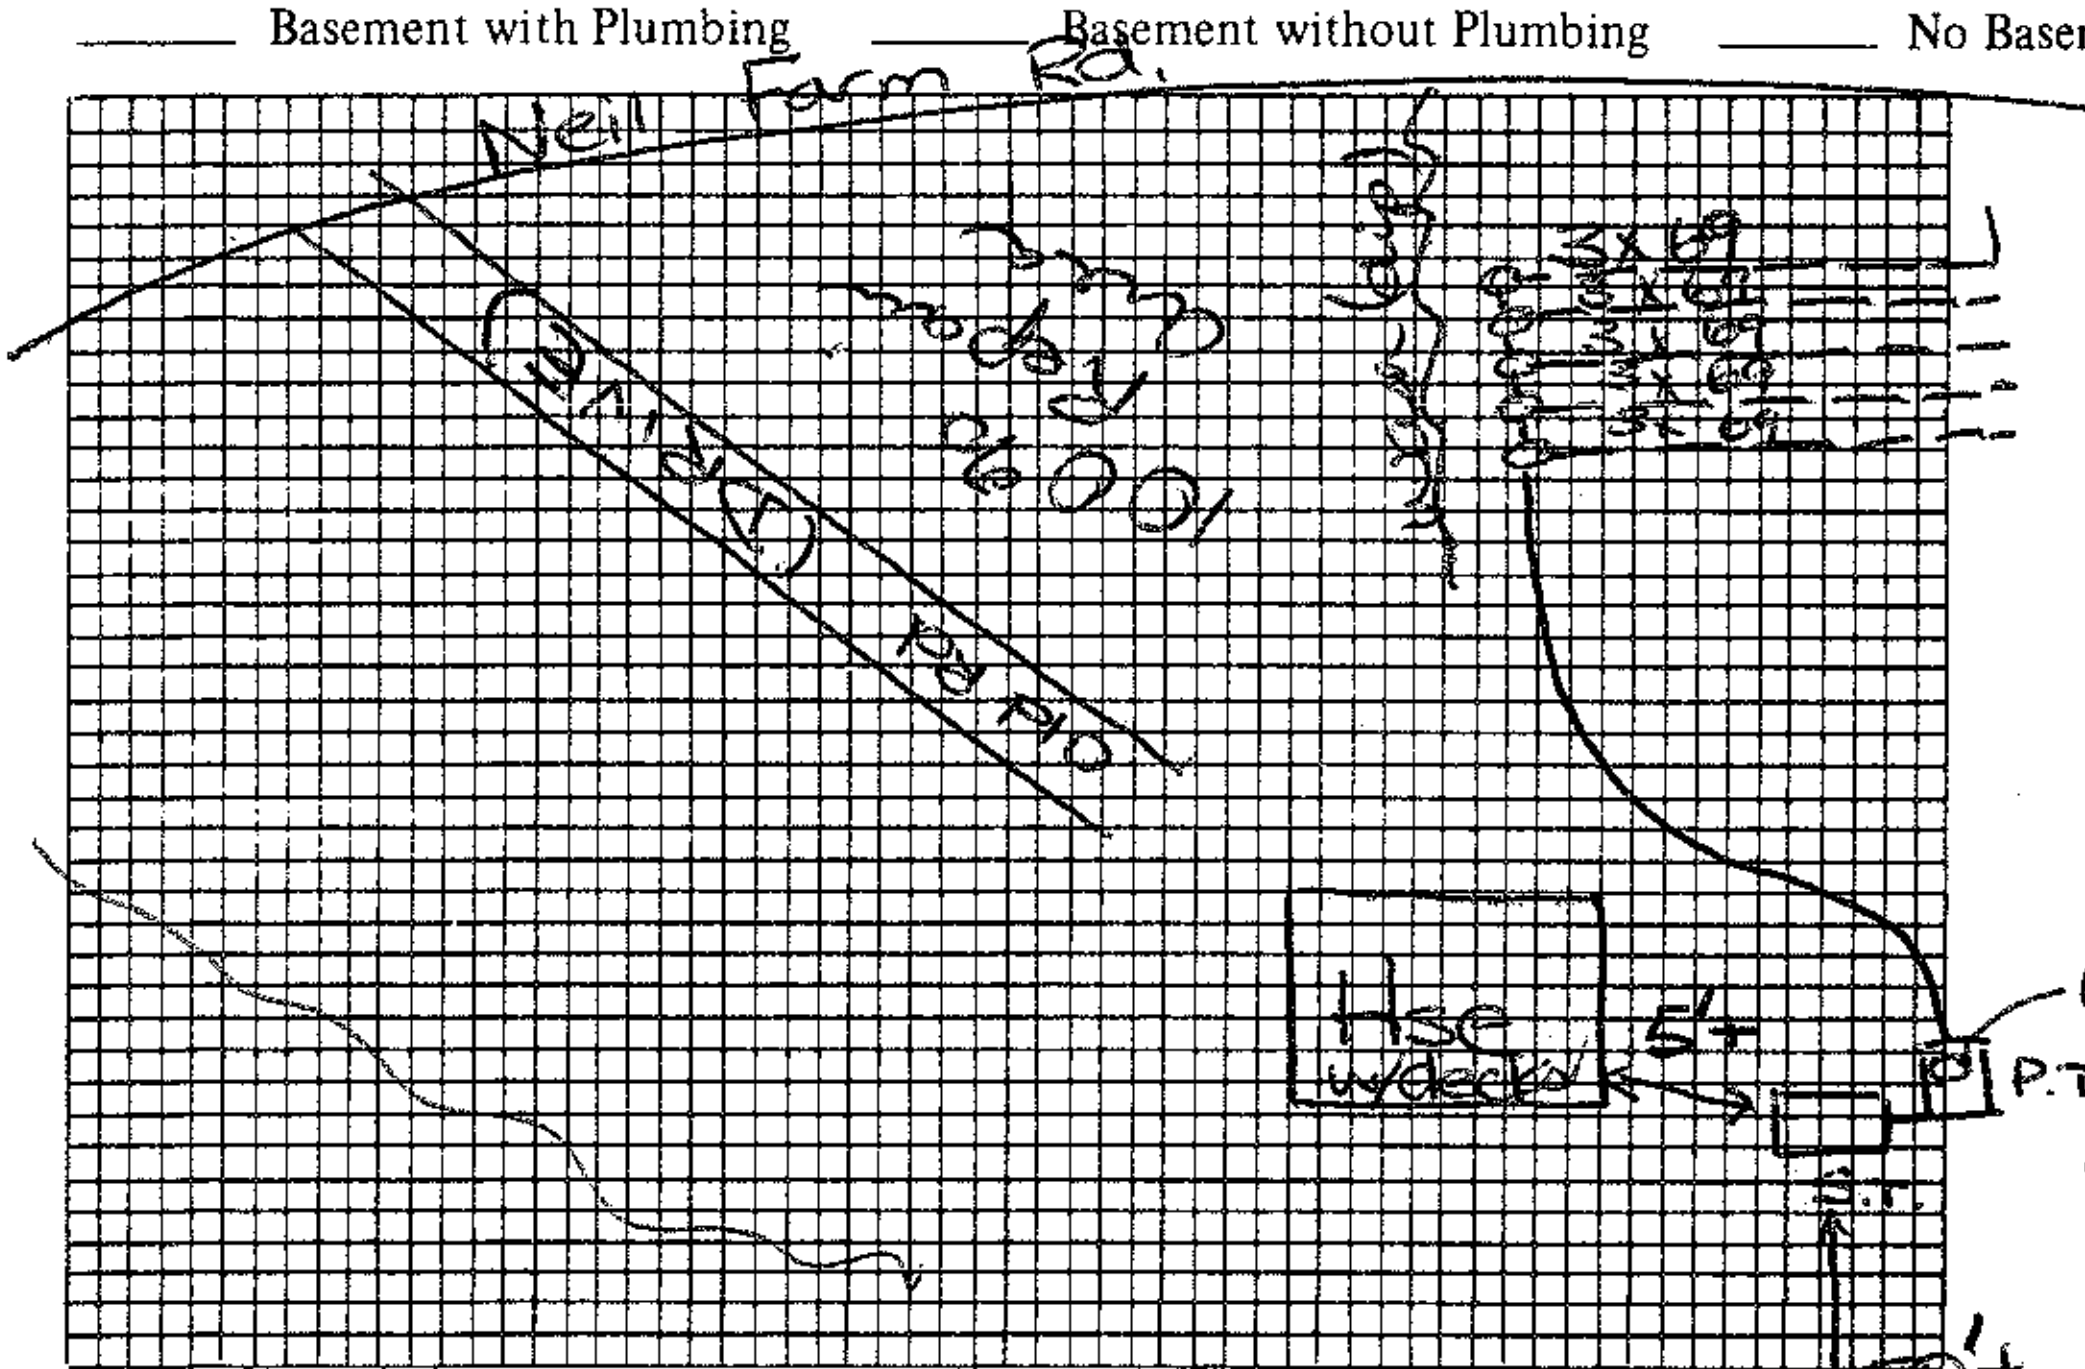


Plot of System NOT TO SCALE

Installed by ______

I understand and agree to install septic tank system as specified on this Improvements ~~Permit~~

Signed: [signature]

IMPROVEMENTS PERMIT BY Audie C. Price

Lake Norman

COMMENTS: Install tanks near house and pump through Sch 40 PVC pipe (2") to field. Use a series of ball run valves to distribute flow/pressure through field. 2' pressure head will be achieved by installing a 2' turnup on ea. line

CERTIFICATE OF COMPLETION BY Install high water alarm/float ______ DATE ______

EXISTING SYSTEM CHECKED BY: before a final is issued ______ DATE ______

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Lines must be on Contour and Shallow.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold