DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: ___
COUNTY: ___

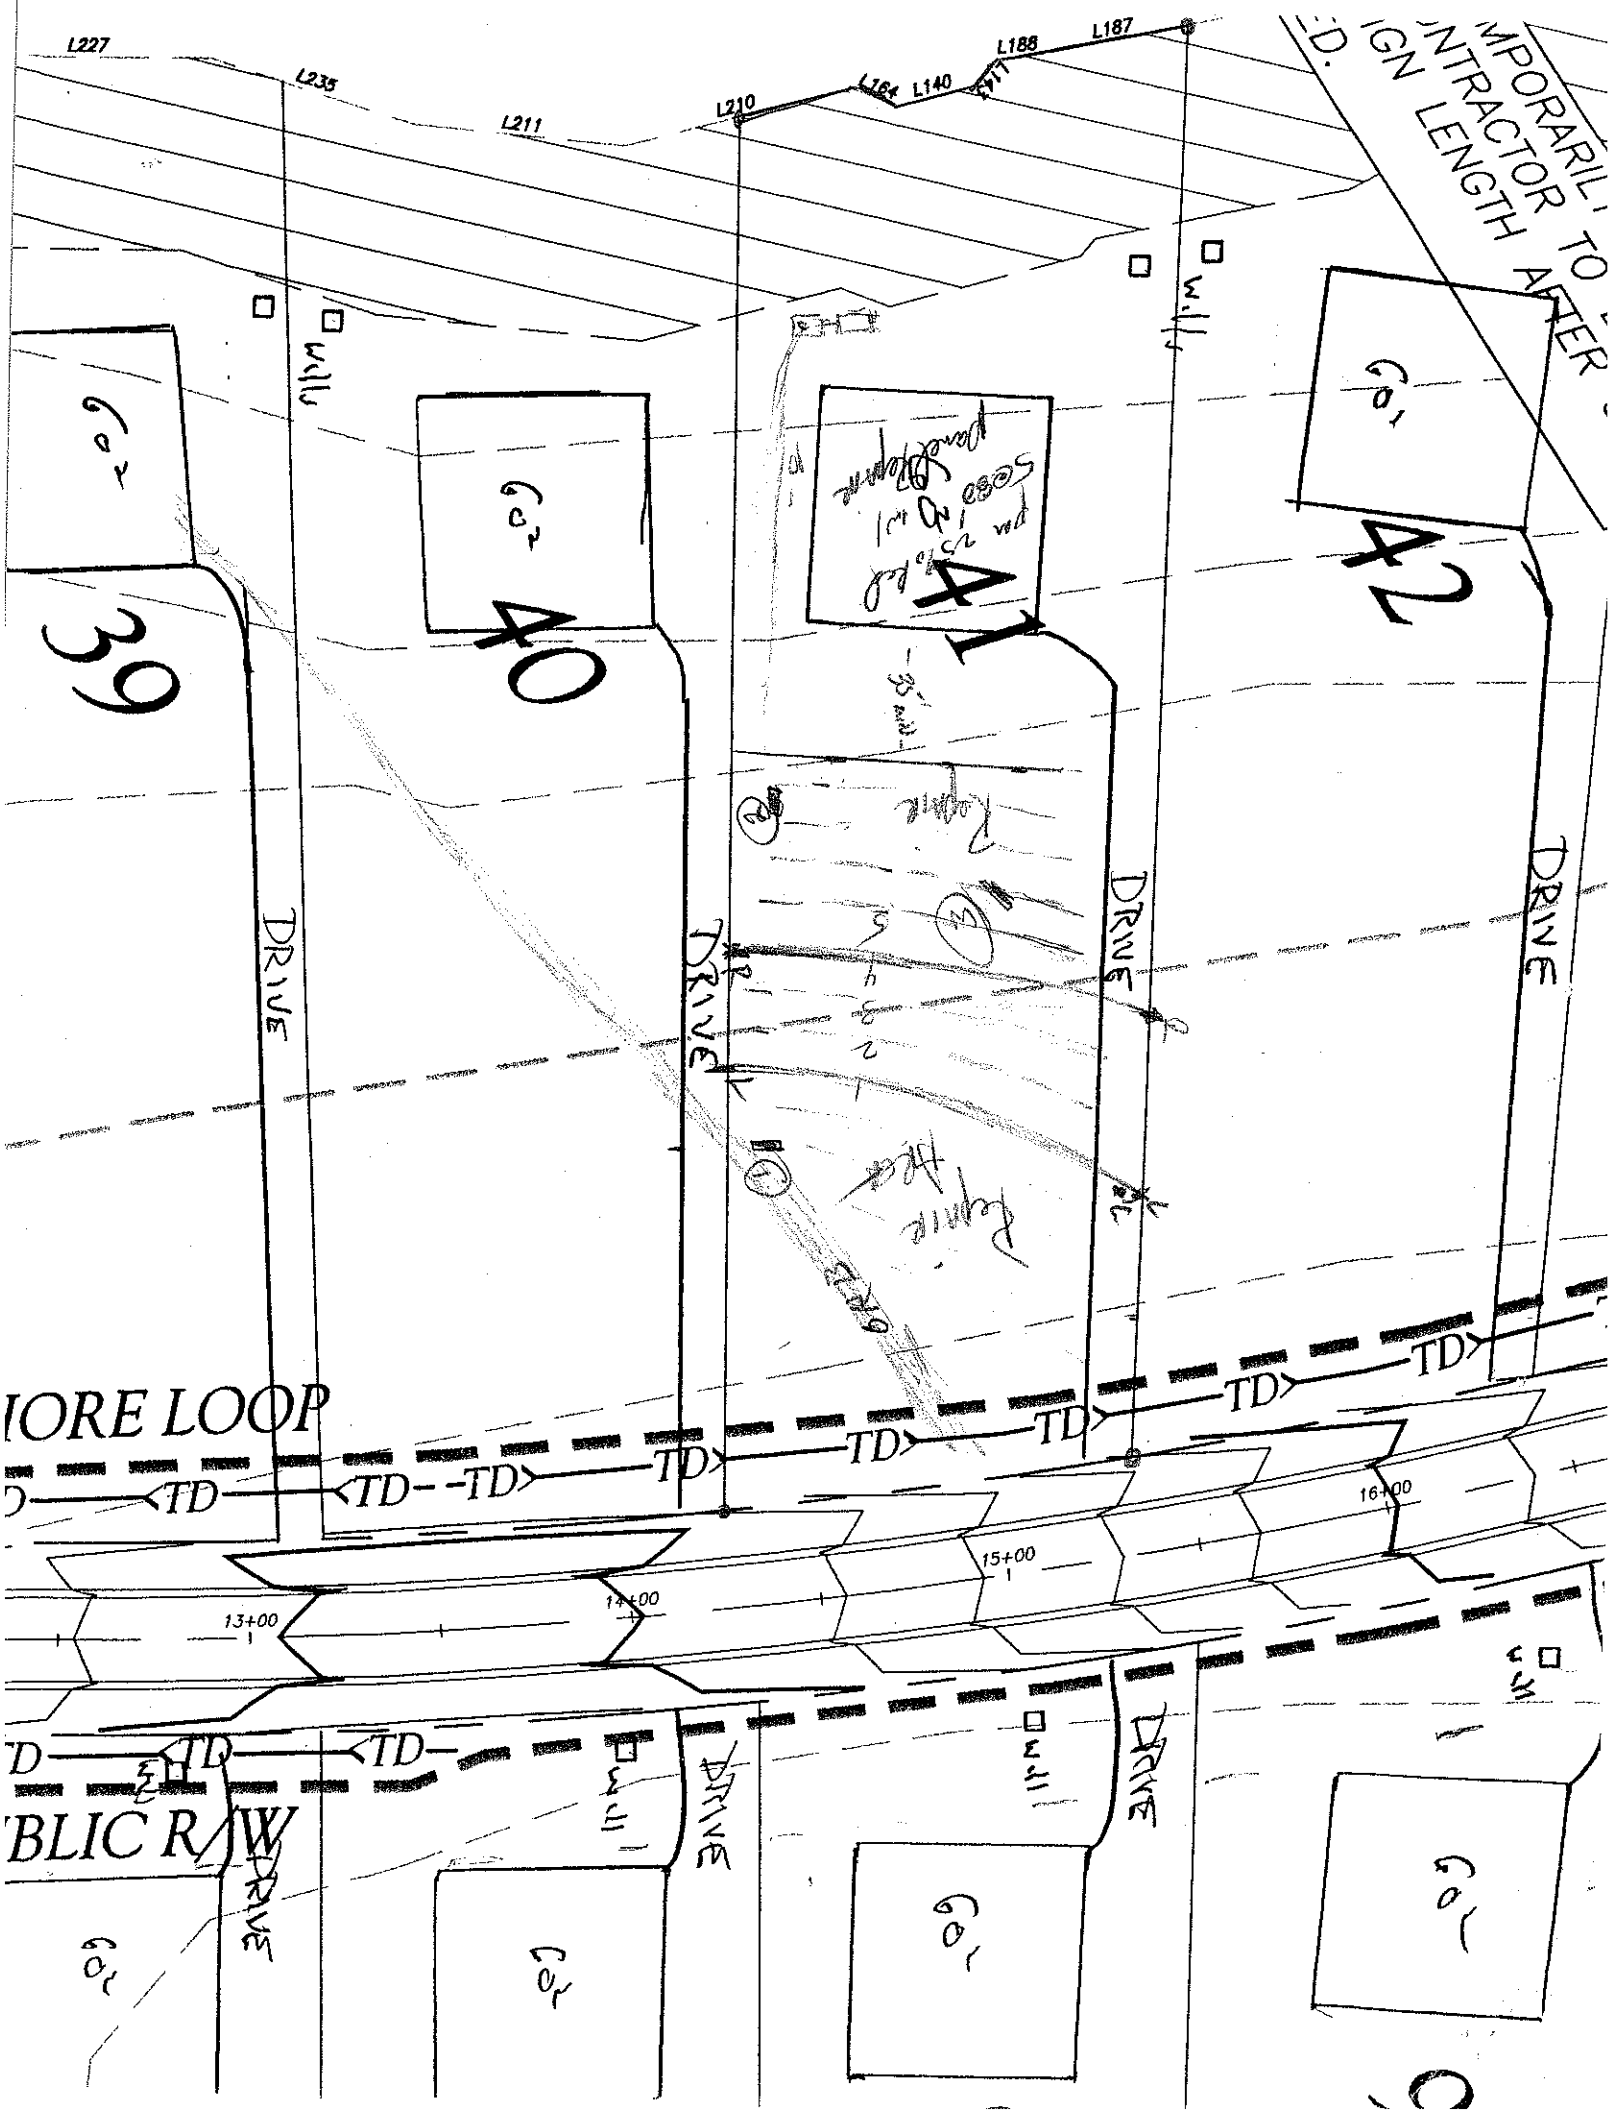
SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: Yeatt Thompson
ADDRESS: ___
APPLICANT: ___
APPLICATION DATE: ___
PROPOSED FACILITY: SFR
PROPOSED DESIGN FLOW (.1949): 4 Bdrm
DATE EVALUATED: 2-23-05
LOCATION OF SITE: Lot 41 Bay Crossing
PROPERTY SIZE: ___
PROPERTY RECORDED: ___
WATER SUPPLY: ☑ Private ☐ Public ☒ Well ☐ Spring ☐ Other ___
EVALUATION METHOD: ☐ Auger Boring ☒ Pit ☐ Cut
TYPE OF WASTEWATER: ☑ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	14% 0/10% S/V	0-9	WKSBK loam scl	frssso					o3
		9-29	m-sbk rc	frssso sso					
		29-50	wksbk gr cl	frssso few	common mi f sap few mi w sap f				
2		0-11	wksbk scl	frssso					o3
		11-48	sbk c	frssso	few mi w rock f sap				
3		0-10	wksbk loam scl	frssso					o3
		10-54	m/wksbk rcl	frssso stp	few mi w rock f sap @ 20" common mi w rock f sap 36" predominately soil				
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	PS
System Type(s)	Conv Sep Bed	LPP ERS
Site LTAR	o3	o3

OTHER FACTORS (.1946): ___
SITE CLASSIFICATION (.1948): PS
EVALUATED BY: D Williams
OTHER(S) PRESENT: R Williams @ TCE


L227
L235
L211
L210
L188
L187
L140
39
40
41
42
DRIVE
DRIVE
DRIVE
DRIVE
DRIVE
DRIVE
IORE LOOP
TD
TD
TD
TD
TD
TD
TD
TD
TD
13+00
14+00
15+00
16+00
BLIC R/W