DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: ___
COUNTY: ___

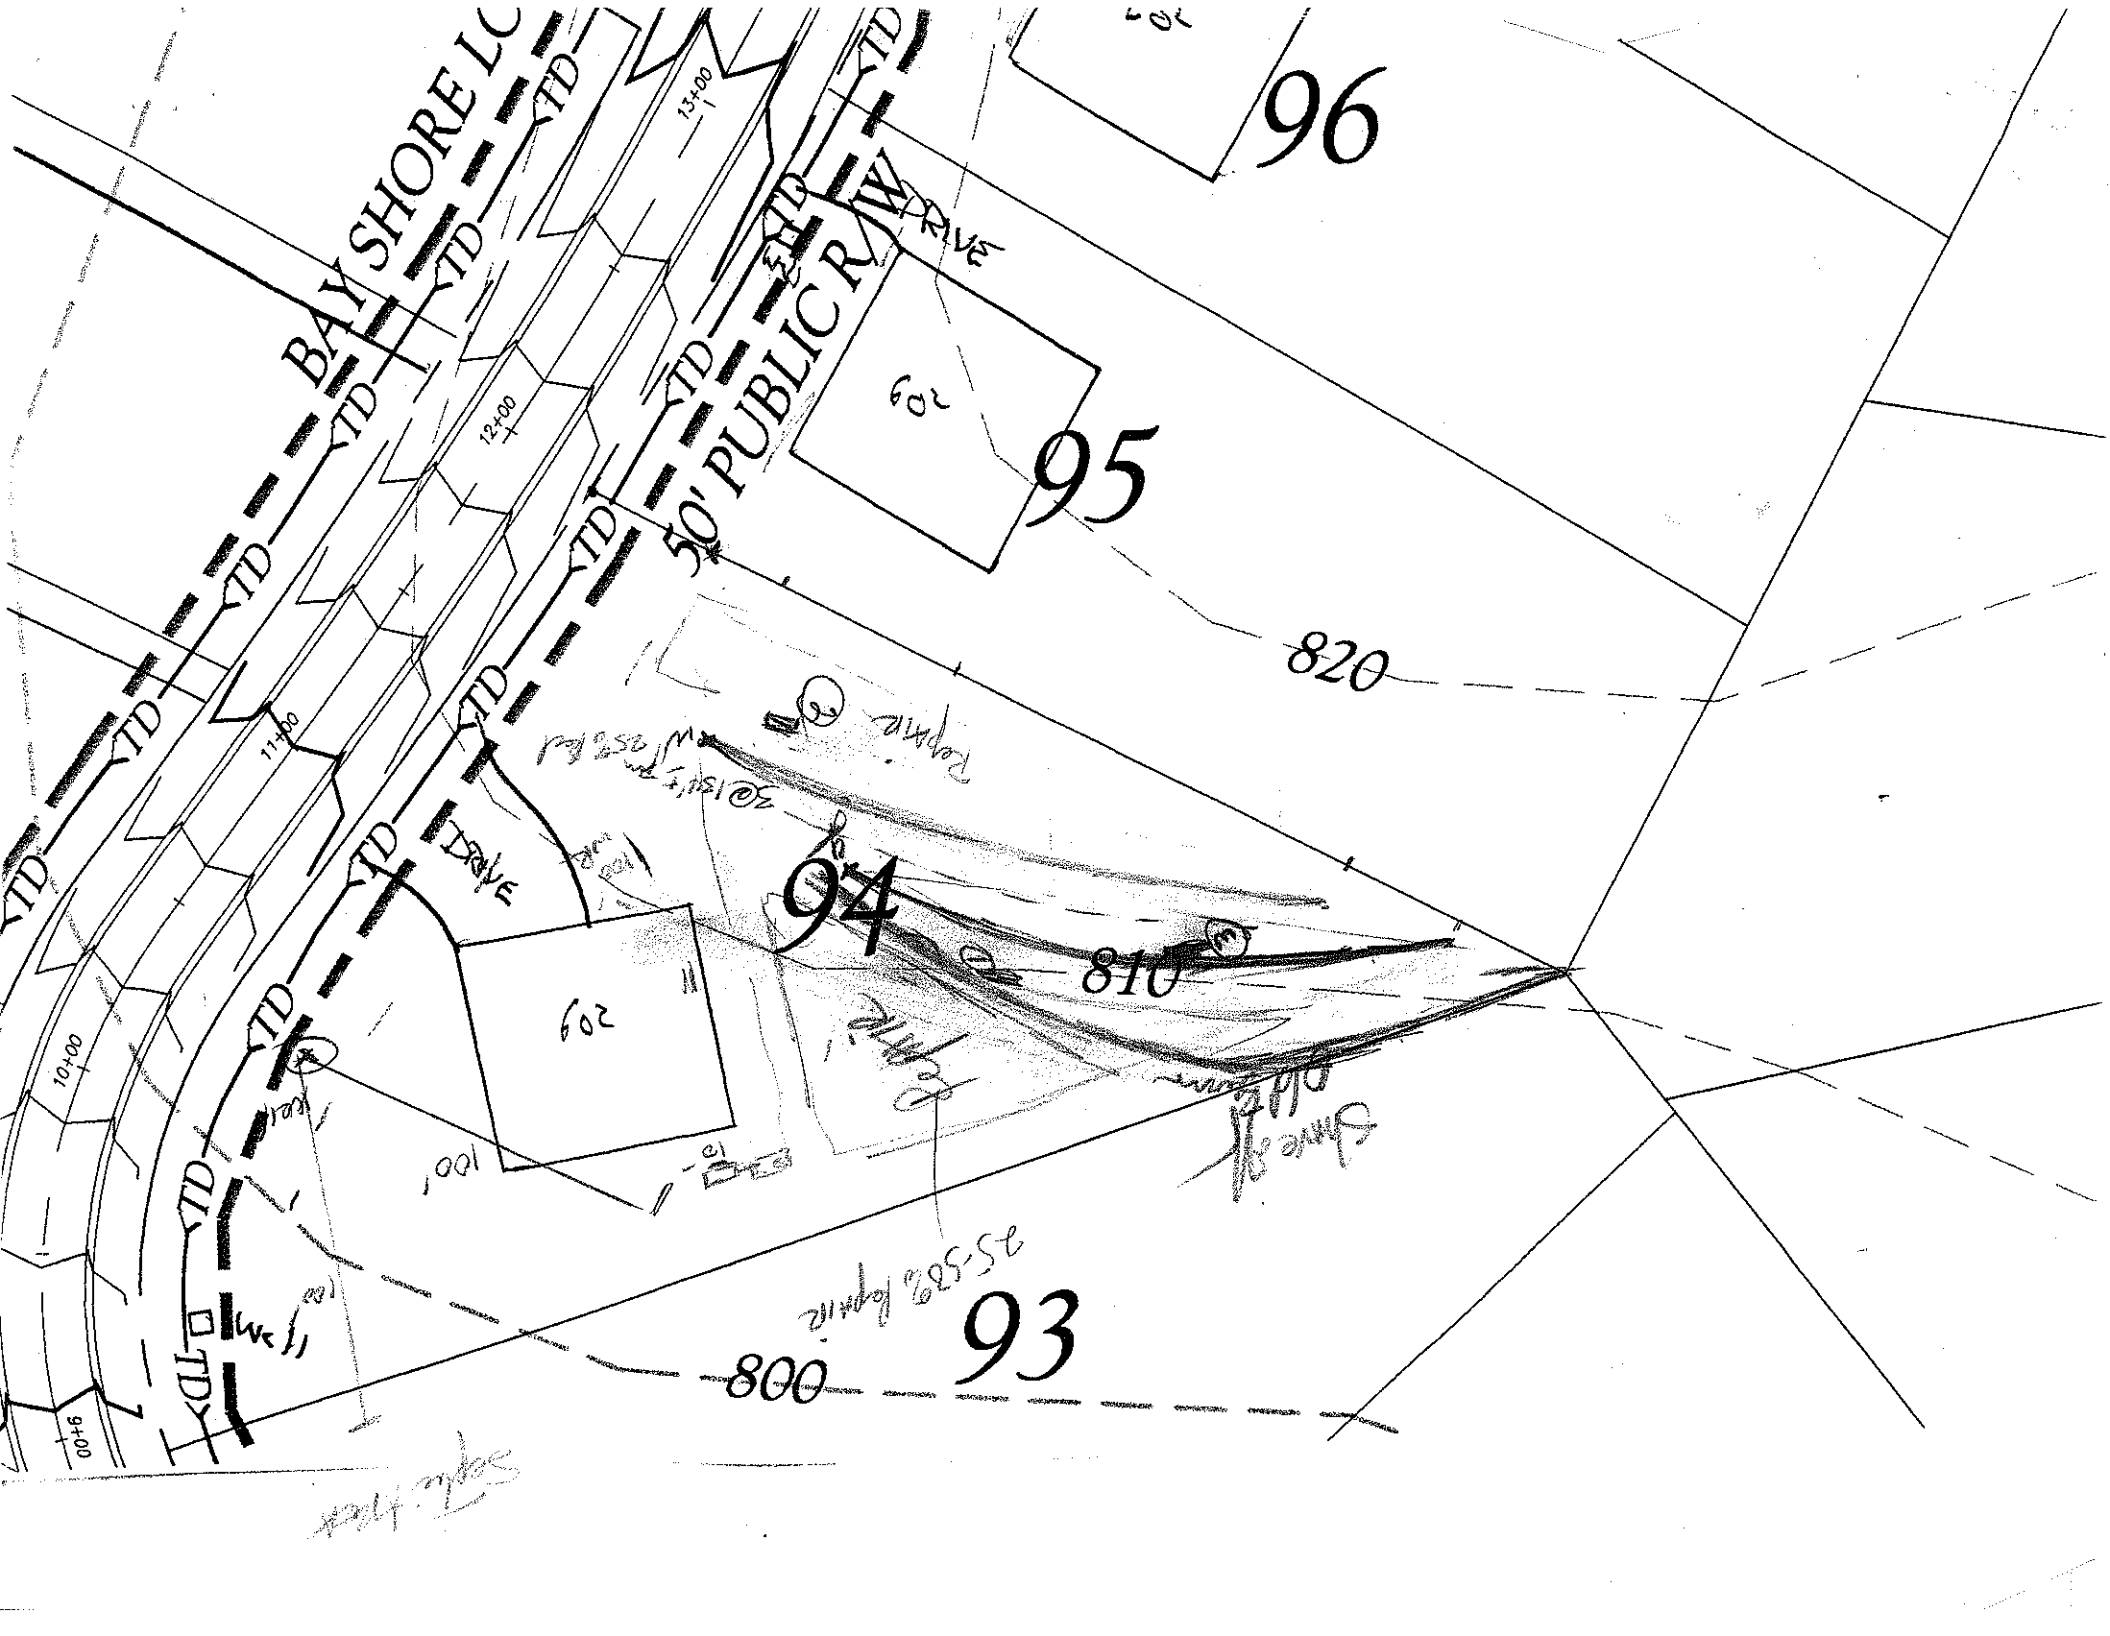
SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: Hunt Properties Inc APPLICANT: ___
ADDRESS: ___ APPLICATION DATE: ___ DATE EVALUATED: 3-2-05
PROPOSED FACILITY: 3 BR PROPOSED DESIGN FLOW (.1949): 480 gpd PROPERTY SIZE: ___
LOCATION OF SITE: lot 94 Bay crossing PROPERTY RECORDED: ___
WATER SUPPLY: ☒ Private ☐ Public ☒ Well ☐ Spring ☐ Other ___
EVALUATION METHOD: ☐ Auger Boring ☒ Pit ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	6-8% S	0-14	wk sbk fr/cl	fr ss sp sap					.3
		14-32	wk sbk gr cl/l	fr ss sp few common mi fsap					
		32-54	massive LS AP	fr ss sp					
2		0-9	wk sbk sl	fr ss sp					.3
		9-34	sbk c	fr ss sp sap few fine pores					
		34-54	wk sbk cl	fr ss sp few mi fsap					
3		0-6	wk sbk l/sl	fr ss sp					.3
		6-30	wk sbk l/c	fr ss sp sap					
		30-53	wk sbk sdl/l	fr ss sp common mi fsap					
		water seepage from soil above due to rainfall 2 days ago							
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	R	R
System Type(s)	gravel soaked	LPP/BRS
Size	.3	.3

OTHER FACTORS (.1946): ___
SITE CLASSIFICATION (.1948): R
EVALUATED BY: DH Thompson RS
OTHER(S) PRESENT: Ron Weeks TCB


BAYSHORE LO
50' PUBLIC R/W
96
95
94
93
820
810
800
209
209
100'
11+00
12+00
13+00
10+00
9+00