ON-SITE WASTEWATER SECTION

PROPERTY ID #: _____
COUNTY: _____


SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: Shavender Rai
ADDRESS: _____
APPLICANT: _____
APPLICATION DATE: _____
PROPOSED FACILITY: SFR
PROPOSED DESIGN FLOW (.1949): 480 gpd
DATE EVALUATED: 10-19-04
LOCATION OF SITE: Lot 16 Neelhurst Woods
PROPERTY SIZE: _____
PROPERTY RECORDED: _____
WATER SUPPLY: ☒ Private ☐ Public ☒ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☒ Pit ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LAND-SCAPE POSITION/ SLOPE %	HORI-ZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-3	gr brwn SL fr						
		3-24	m fsbk RC	fr sss sp so/p					
		24-53	w/f sbk yr cl	fr sss p common in bp					.3
			(B-C)						
2	<15%	0-5	gr brwn sl/scl fr						
		5-33	m fsbk RC	fr sss p so/p					
		33-56	(B-C) w/f sbk/pl brwn cl	fr sss p common in so/p					.3
3		0-8	m fsbk R brwn scl	fr sss p					
		8-48	m fsbk RC	fr sss p so/p					.3
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	PS
System Type(s)	LPPPBPS	LPPPBPS
Site LTAR	.3	.3

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): PS
EVALUATED BY: [signature]
OTHER(S) PRESENT: [signature]

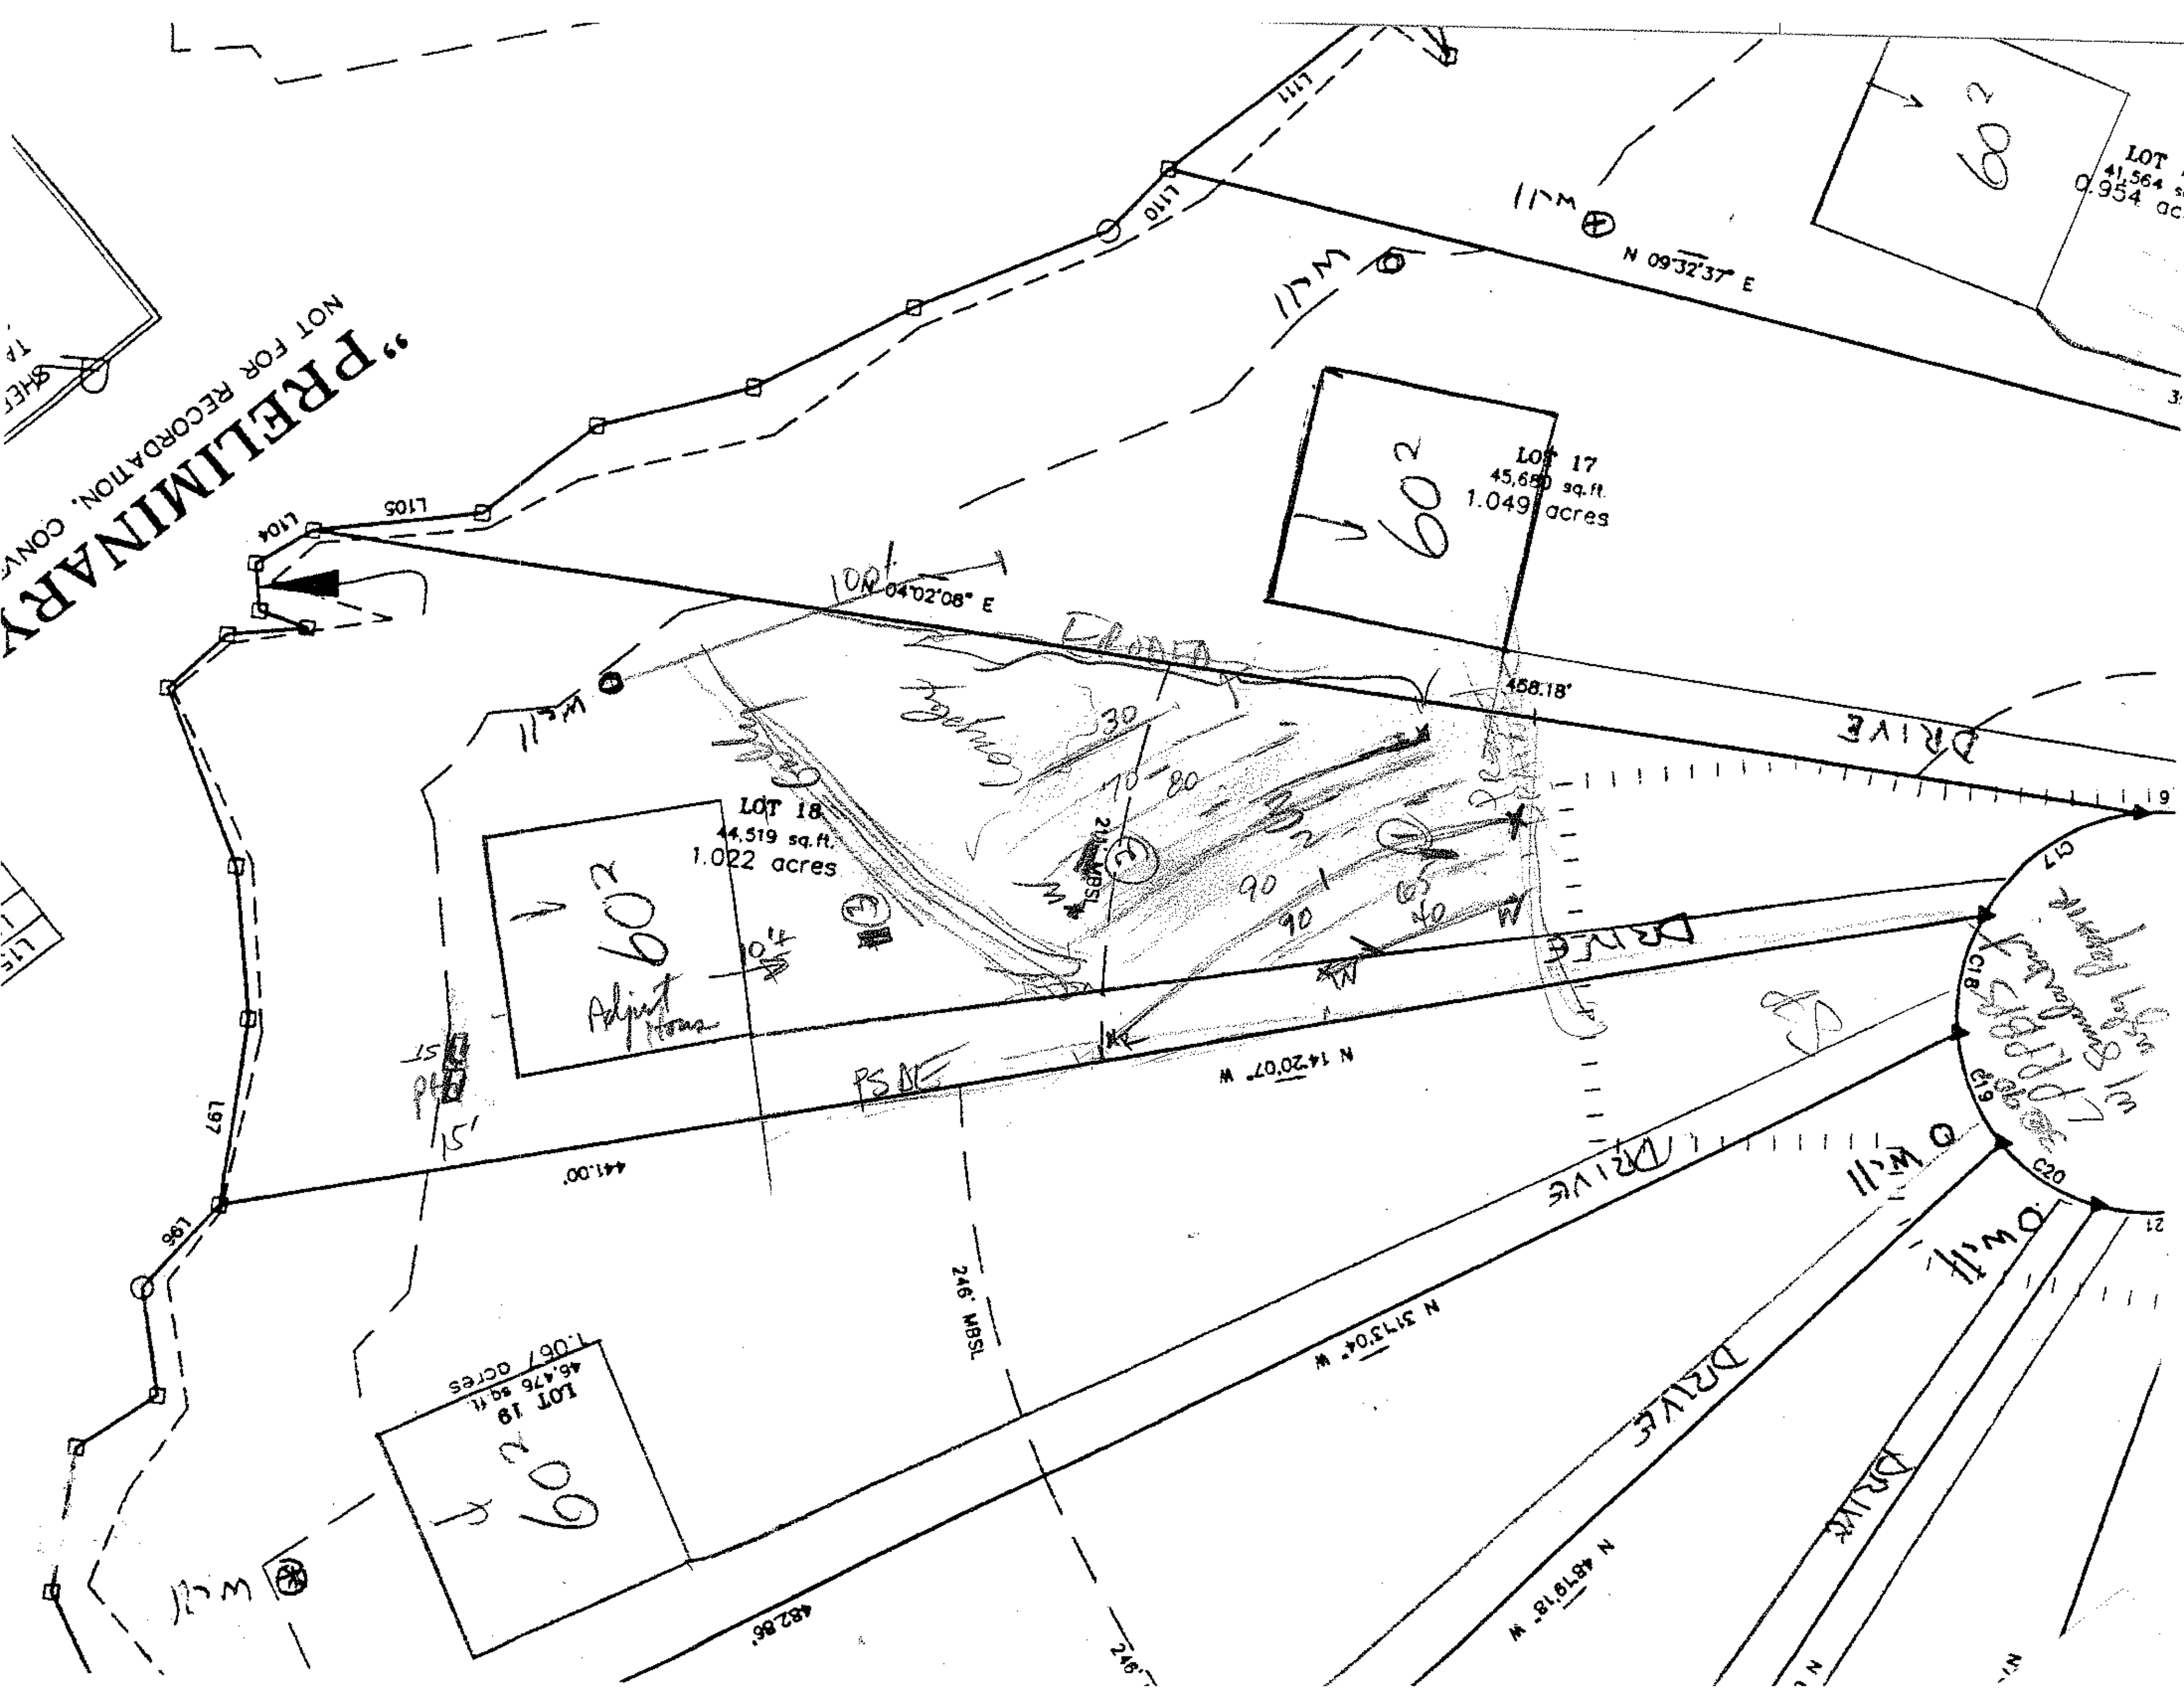

"PRELIMINARY"
NOT FOR RECORDATION, CONV
LOT 17
45,650 sq.ft.
1.049 acres
LOT 18
44,519 sq.ft.
1.022 acres
LOT 19
46,476 sq.ft.
1.067 acres
LOT
41,564 sq.ft.
0.954 ac
N 09°32'37" E
N 04°02'08" E
N 14°20'07" W
N 31°13'04" W
N 48°19'18" W
458.18'
441.00'
482.86'
246' MBSL
L96
L97
L104
L105
L110
L111
C17
C18
C19
C20
DRIVE
60²