DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

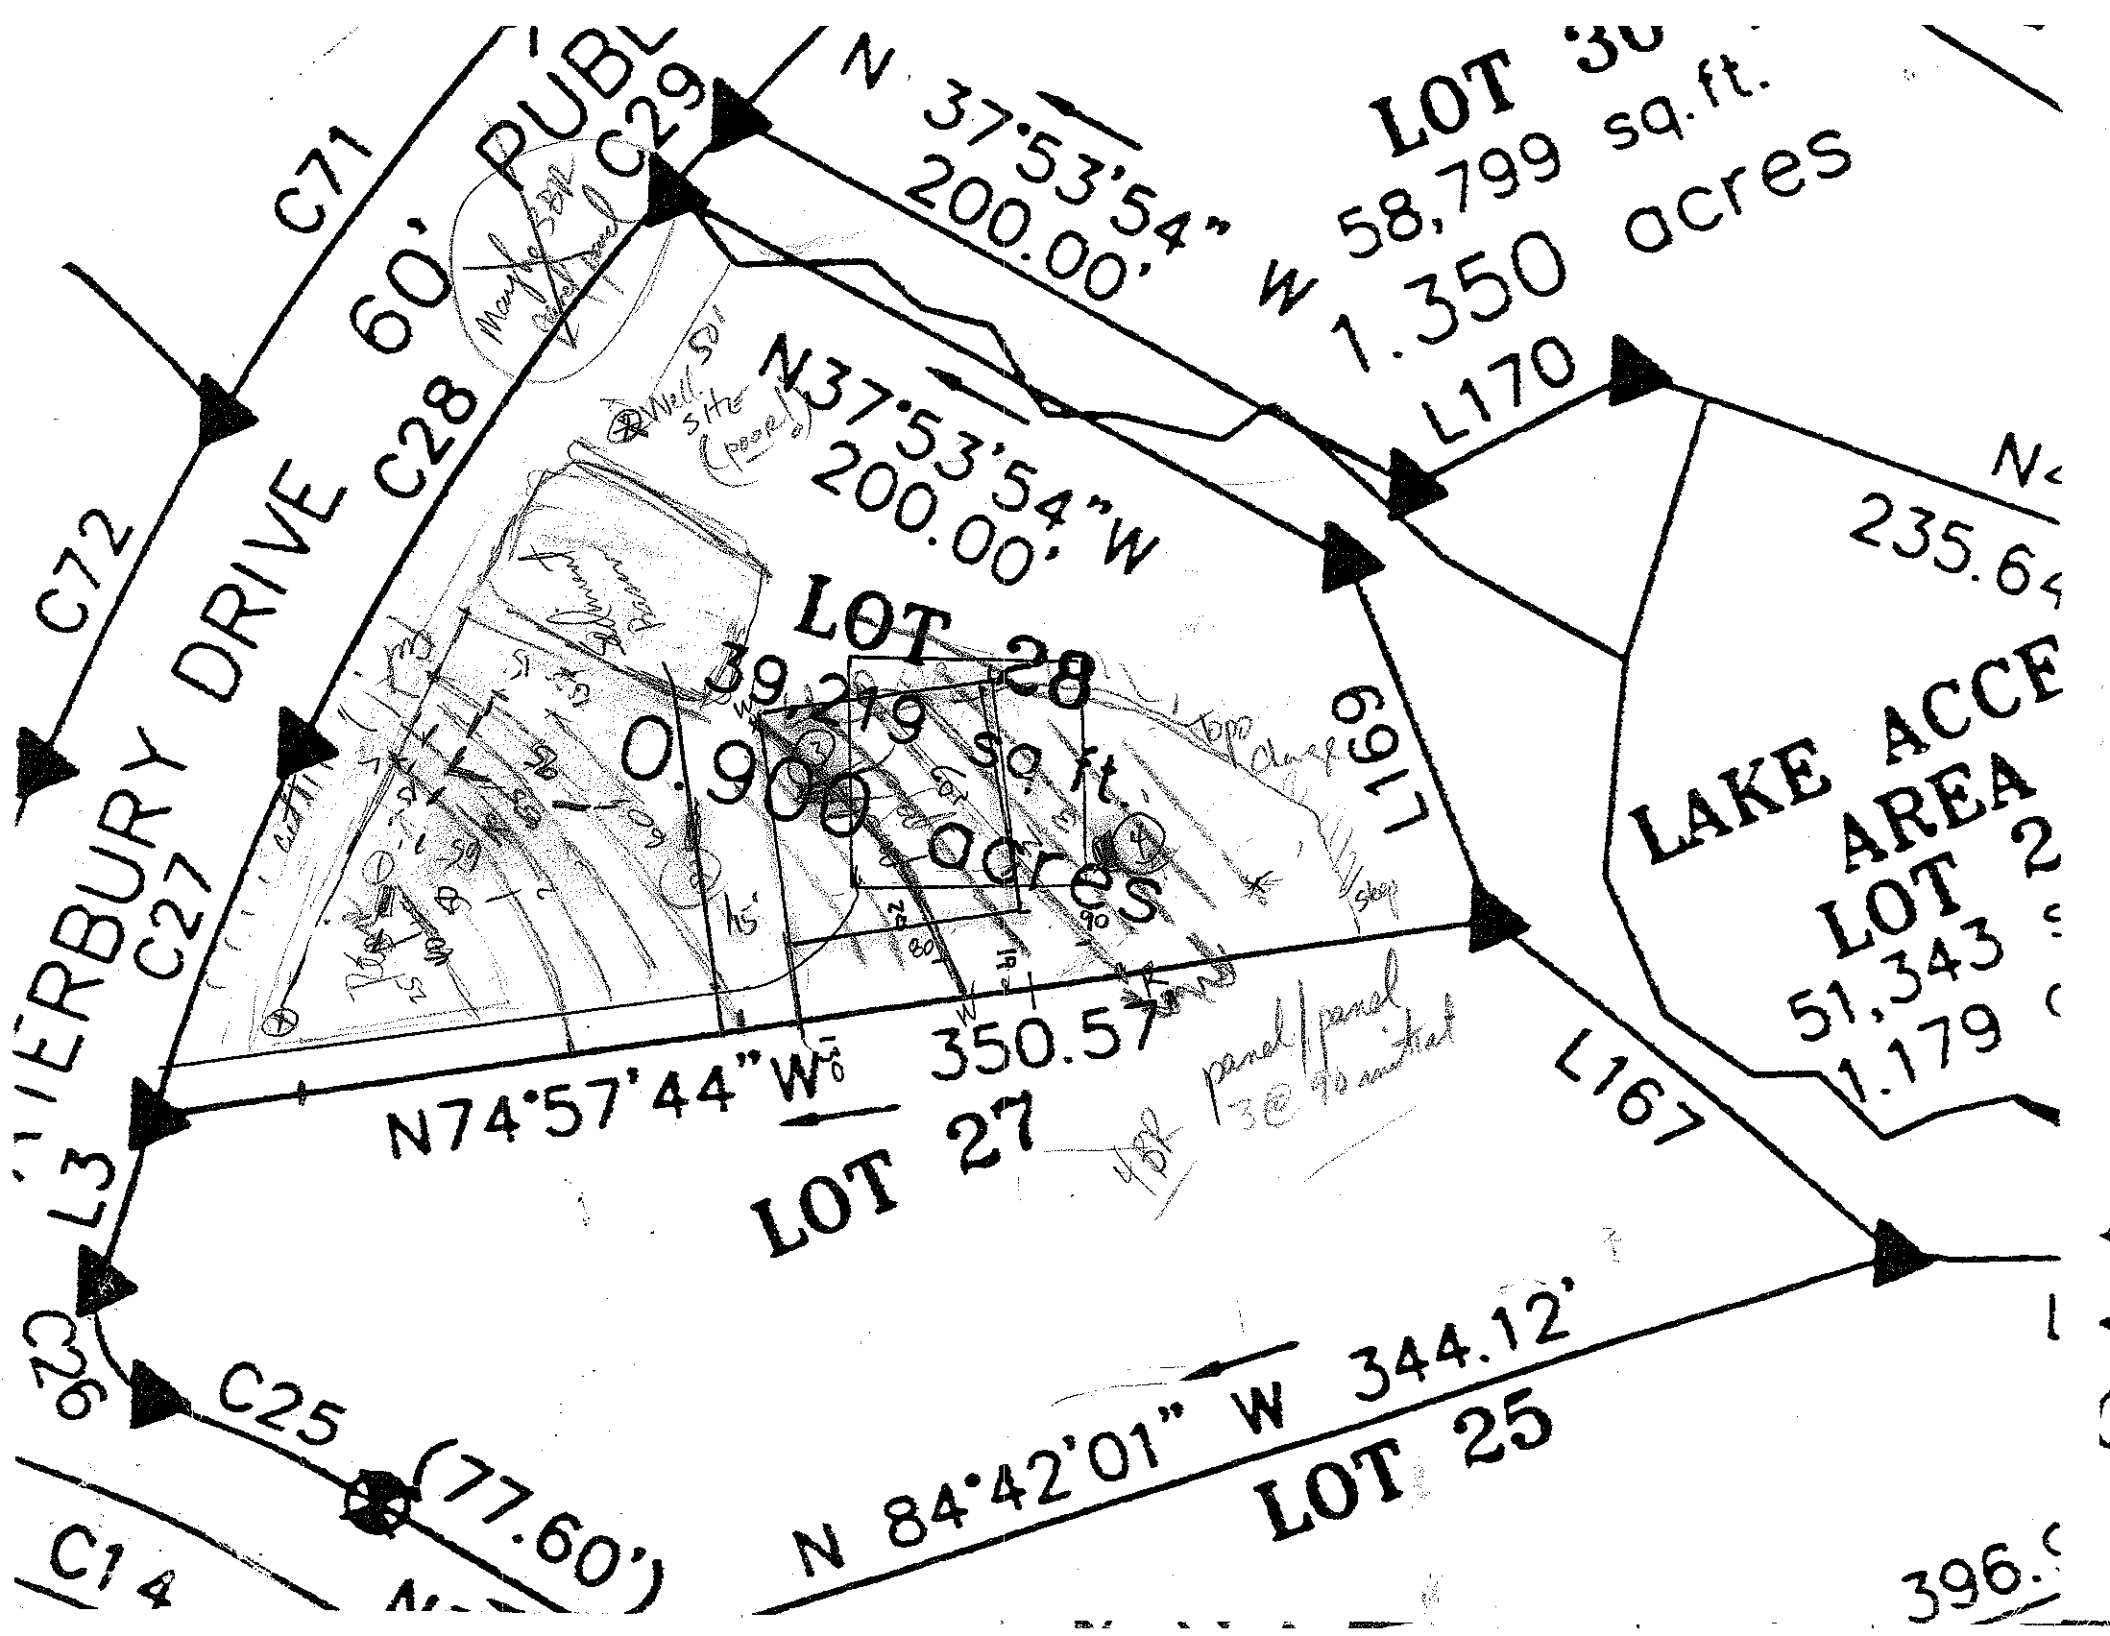
SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: Shaverdan Dev Grp APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: 11-8-04
PROPOSED FACILITY: SFR PROPOSED DESIGN FLOW (.1949): 4 Bdrm PROPERTY SIZE: _____
LOCATION OF SITE: Lot 2B Northington Woods PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☐ Public ☒ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☒ Pit ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LAND-SCAPE POSITION/ SLOPE %	HORI-ZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFIL CLASS & LTAI
1	10%	0-7	gr brn sdl	fr sss p					.3
		7-21	mfsbk RC	fr sss p ssp					
		21-37	wkfsbk yR cl	fr sss p common mn/sap					
		37-48	massive fg fsl sp	fr sss p					
2	10%	0-4	gr brn sdl	fr sss p					.3
		4-29	mfsbk RC	fr sss p ssp					
		29-60	wkfsbk yR cl (BC)	fi fr sss p common mn/sap few mn/w rock					
3	HPA-04 21% S/L	0-9	gr wkfsbk brn sl	fr sss p					.3
		9-35	mfsbk RC	fm fr sss p					
		35-56	wkfsbk yR cl	fr sss p few mn/sap					
4		0-8	gr brn sdl	fr sss p					.3
		8-34	wkfsbk RC	fr sss p ssp					
		34-60	wkfsbk RCL	fr sss p few rock					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	PS
System Type(s)	LPPPBPS	LPPPBPS
Site LTAR	.3	.3

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): PS
EVALUATED BY: DMH
OTHER(S) PRESENT: Paul Pommerger


C71
C29
60' PUBL
C28
C27
C72
L3
C26
C25
(77.60')
C14
N 37°53'54" W
200.00'
LOT 30
58,799 sq.ft.
1.350 acres
L170
N37°53'54"W
200.00'
LOT 28
39,279 sq.ft.
0.900 acres
L169
LAKE ACCE
AREA
LOT 2
51,343
1.179
235.64
N74°57'44"W
350.57'
LOT 27
L167
N 84°42'01" W 344.12'
LOT 25
396.
Well Site (pave
Mary's Bill
panel/panel
3@ 90 omitted