DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: ___
COUNTY: ___

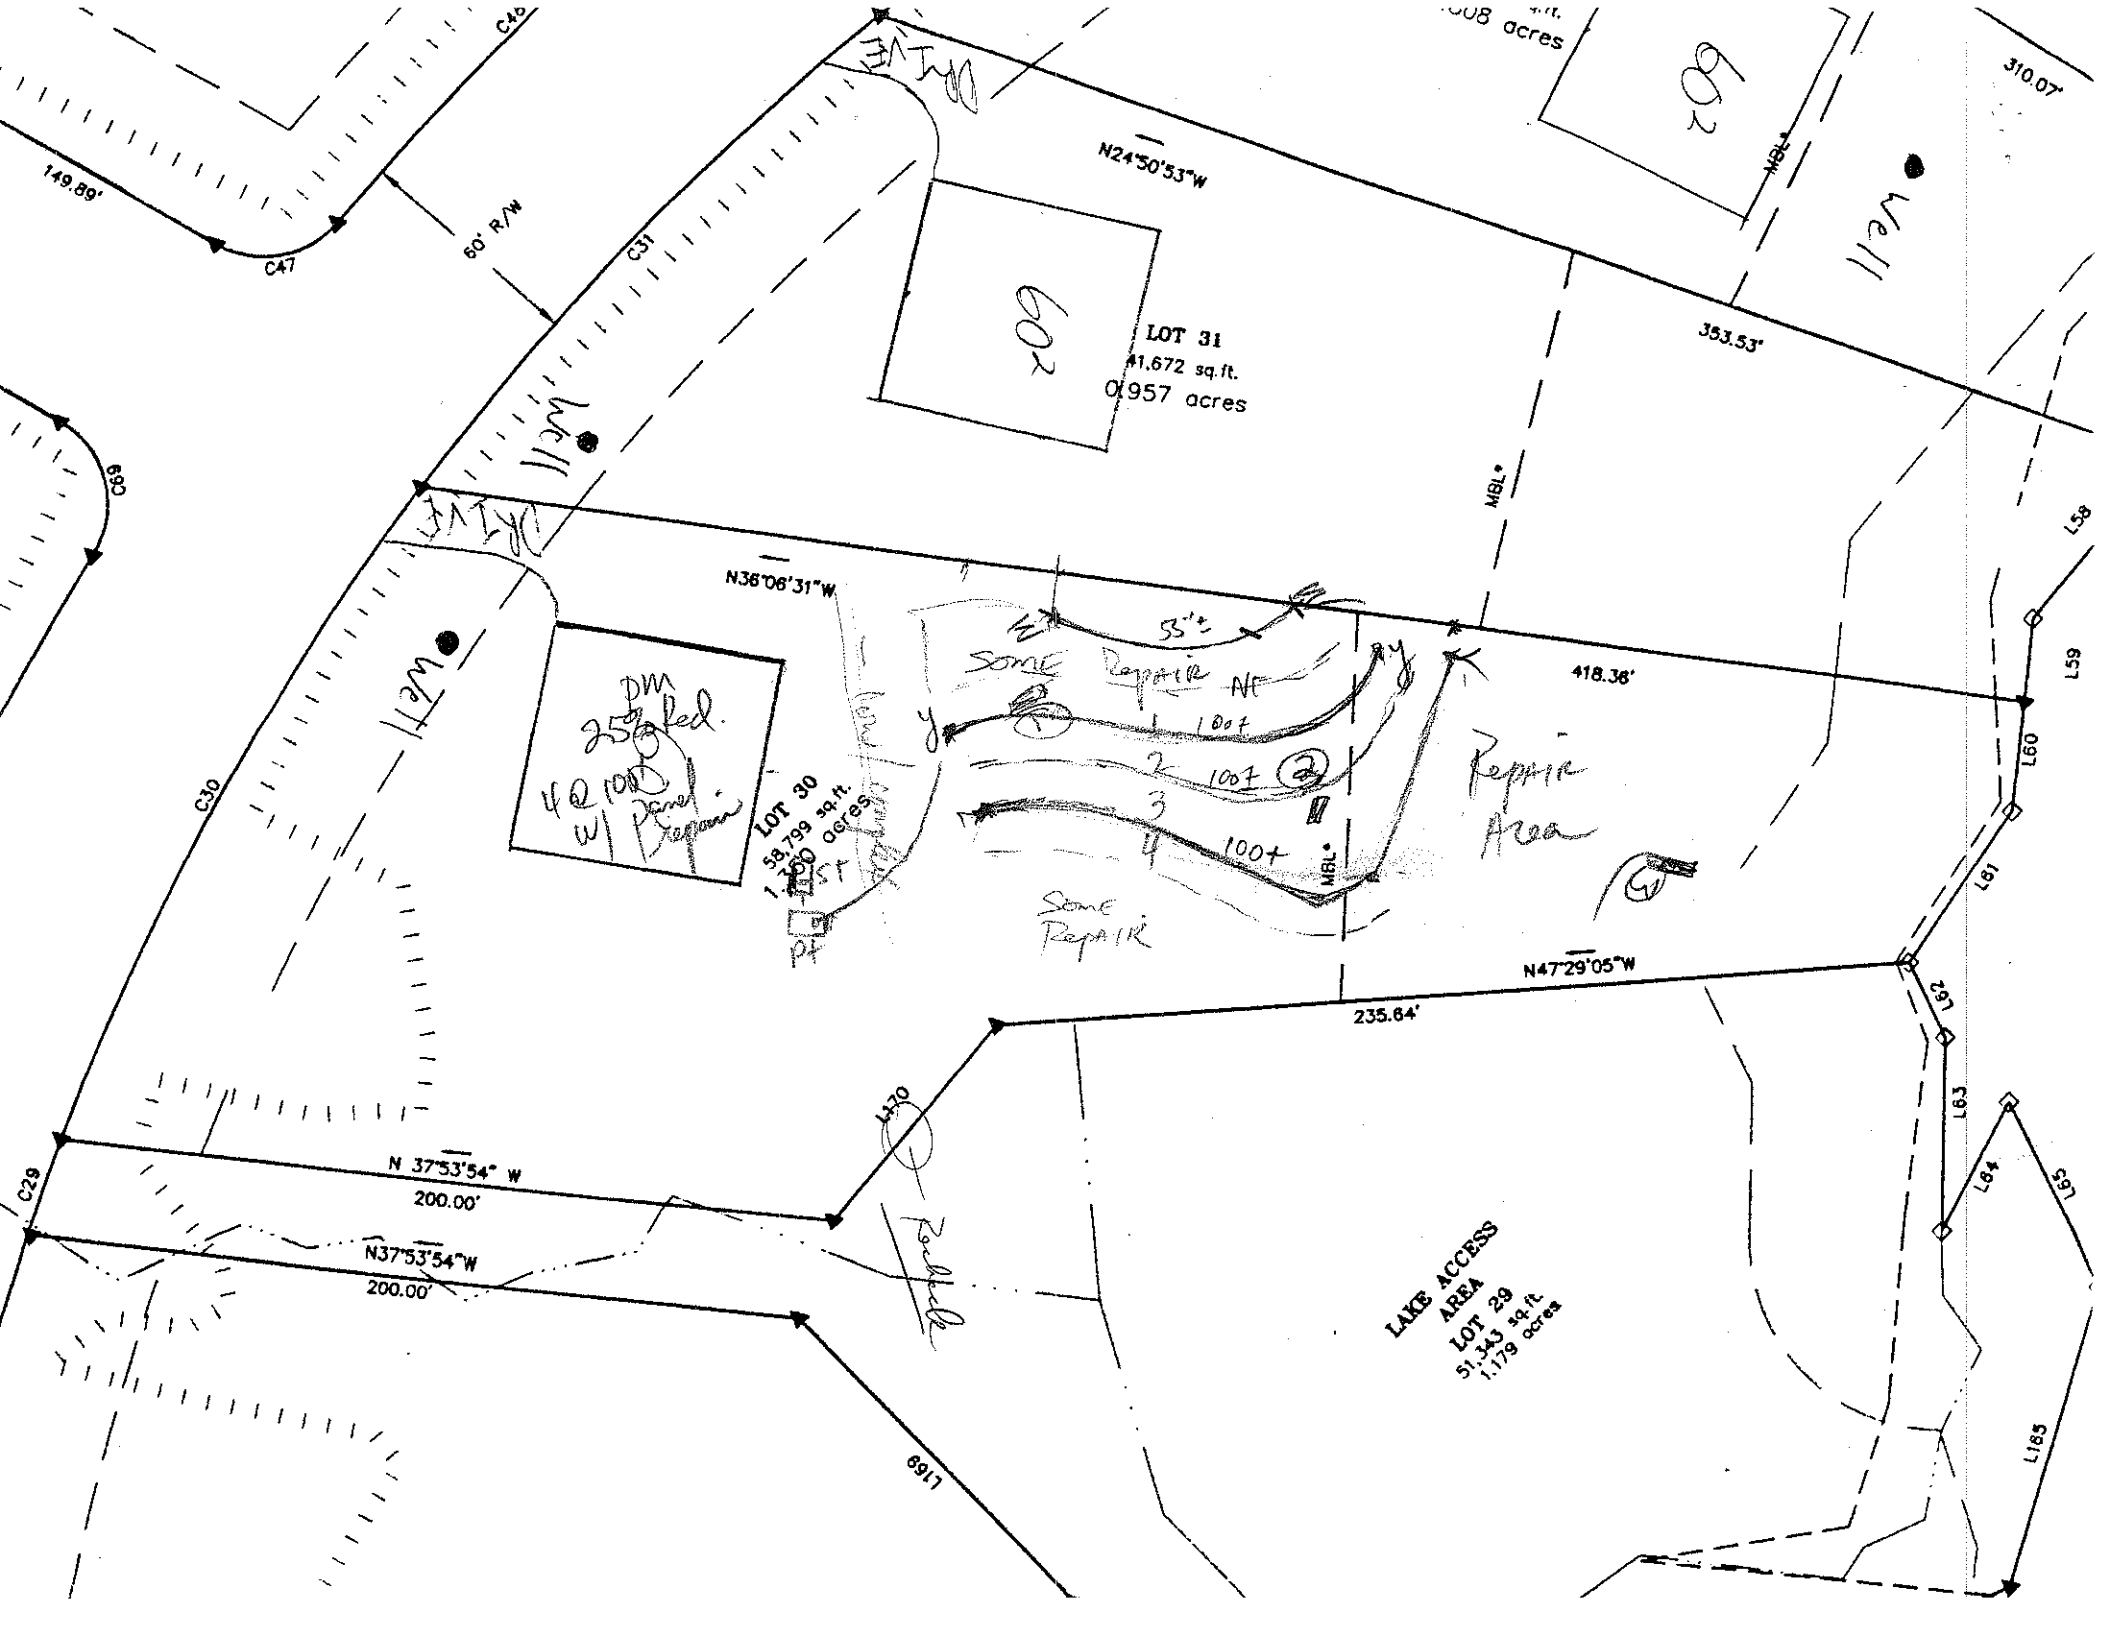
SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: Shoreline Dev. Corp APPLICANT: ___
ADDRESS: ___ APPLICATION DATE: ___ DATE EVALUATED: 11-8-04
PROPOSED FACILITY: SFR PROPOSED DESIGN FLOW (.1949): 4 Bdrm PROPERTY SIZE: ___
LOCATION OF SITE: Lot 30 Worthington Woods PROPERTY RECORDED: ___
WATER SUPPLY: ☑ Private ☐ Public ☑ Well ☐ Spring ☐ Other ___
EVALUATION METHOD: ☐ Auger Boring ☑ Pit ☐ Cut
TYPE OF WASTEWATER: ☑ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFIL CLASS & LTAI
1		0-16	wk fsbk ypc l	fr sss p					≥3
		16-27	wk fsbk ypc l	fr sss p common mid sap					
		27-59	massive Ry fsl sap	fr sss p mid gradual com					
2	40% S	0-6	gr brn sl	fr sss p					≥3
		6-22	m fsbk RC	fr ss sap					
		22-34	wk-m fsbk RC	fr ss sap					
		34-55	(B-C) wk fsbk ypc l	fr sss p common mid sap					
3		0-9	gr brn sl	fr sss p					≥3
		9-15	wk fsbk RC brn sl	fr sss p sap					
		15-41	m fsbk RC	fr ss sp sap					
		41-50	(B-C) wk fsbk ypc l	fr sss p brn mod sap					
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	PS
System Type(s)	Conv SGL Trench	LPP WEBS
Site LTAR	≥3	≥3

OTHER FACTORS (.1946): ___
SITE CLASSIFICATION (.1948): S
EVALUATED BY: DWH
OTHER(S) PRESENT: Paul Pennington


N24°50'53"W
353.53'
LOT 31
41,672 sq.ft.
0.957 acres
602
N36°06'31"W
418.36'
LOT 30
58,799 sq.ft.
1.350 acres
25% Red.
4@100
w/ Repair
Some Repair NF
100+
100+
100+
Some Repair
Repair Area
N47°29'05"W
235.64'
N 37°53'54" W
200.00'
N37°53'54"W
200.00'
LAKE ACCESS AREA
LOT 29
51,343 sq.ft.
1.179 acres
Path
60' R/W
149.89'
310.07'
MBL*
C29
C30
C31
C47
L58
L59
L60
L61
L63
L64
L65
L183
L169
L170