DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

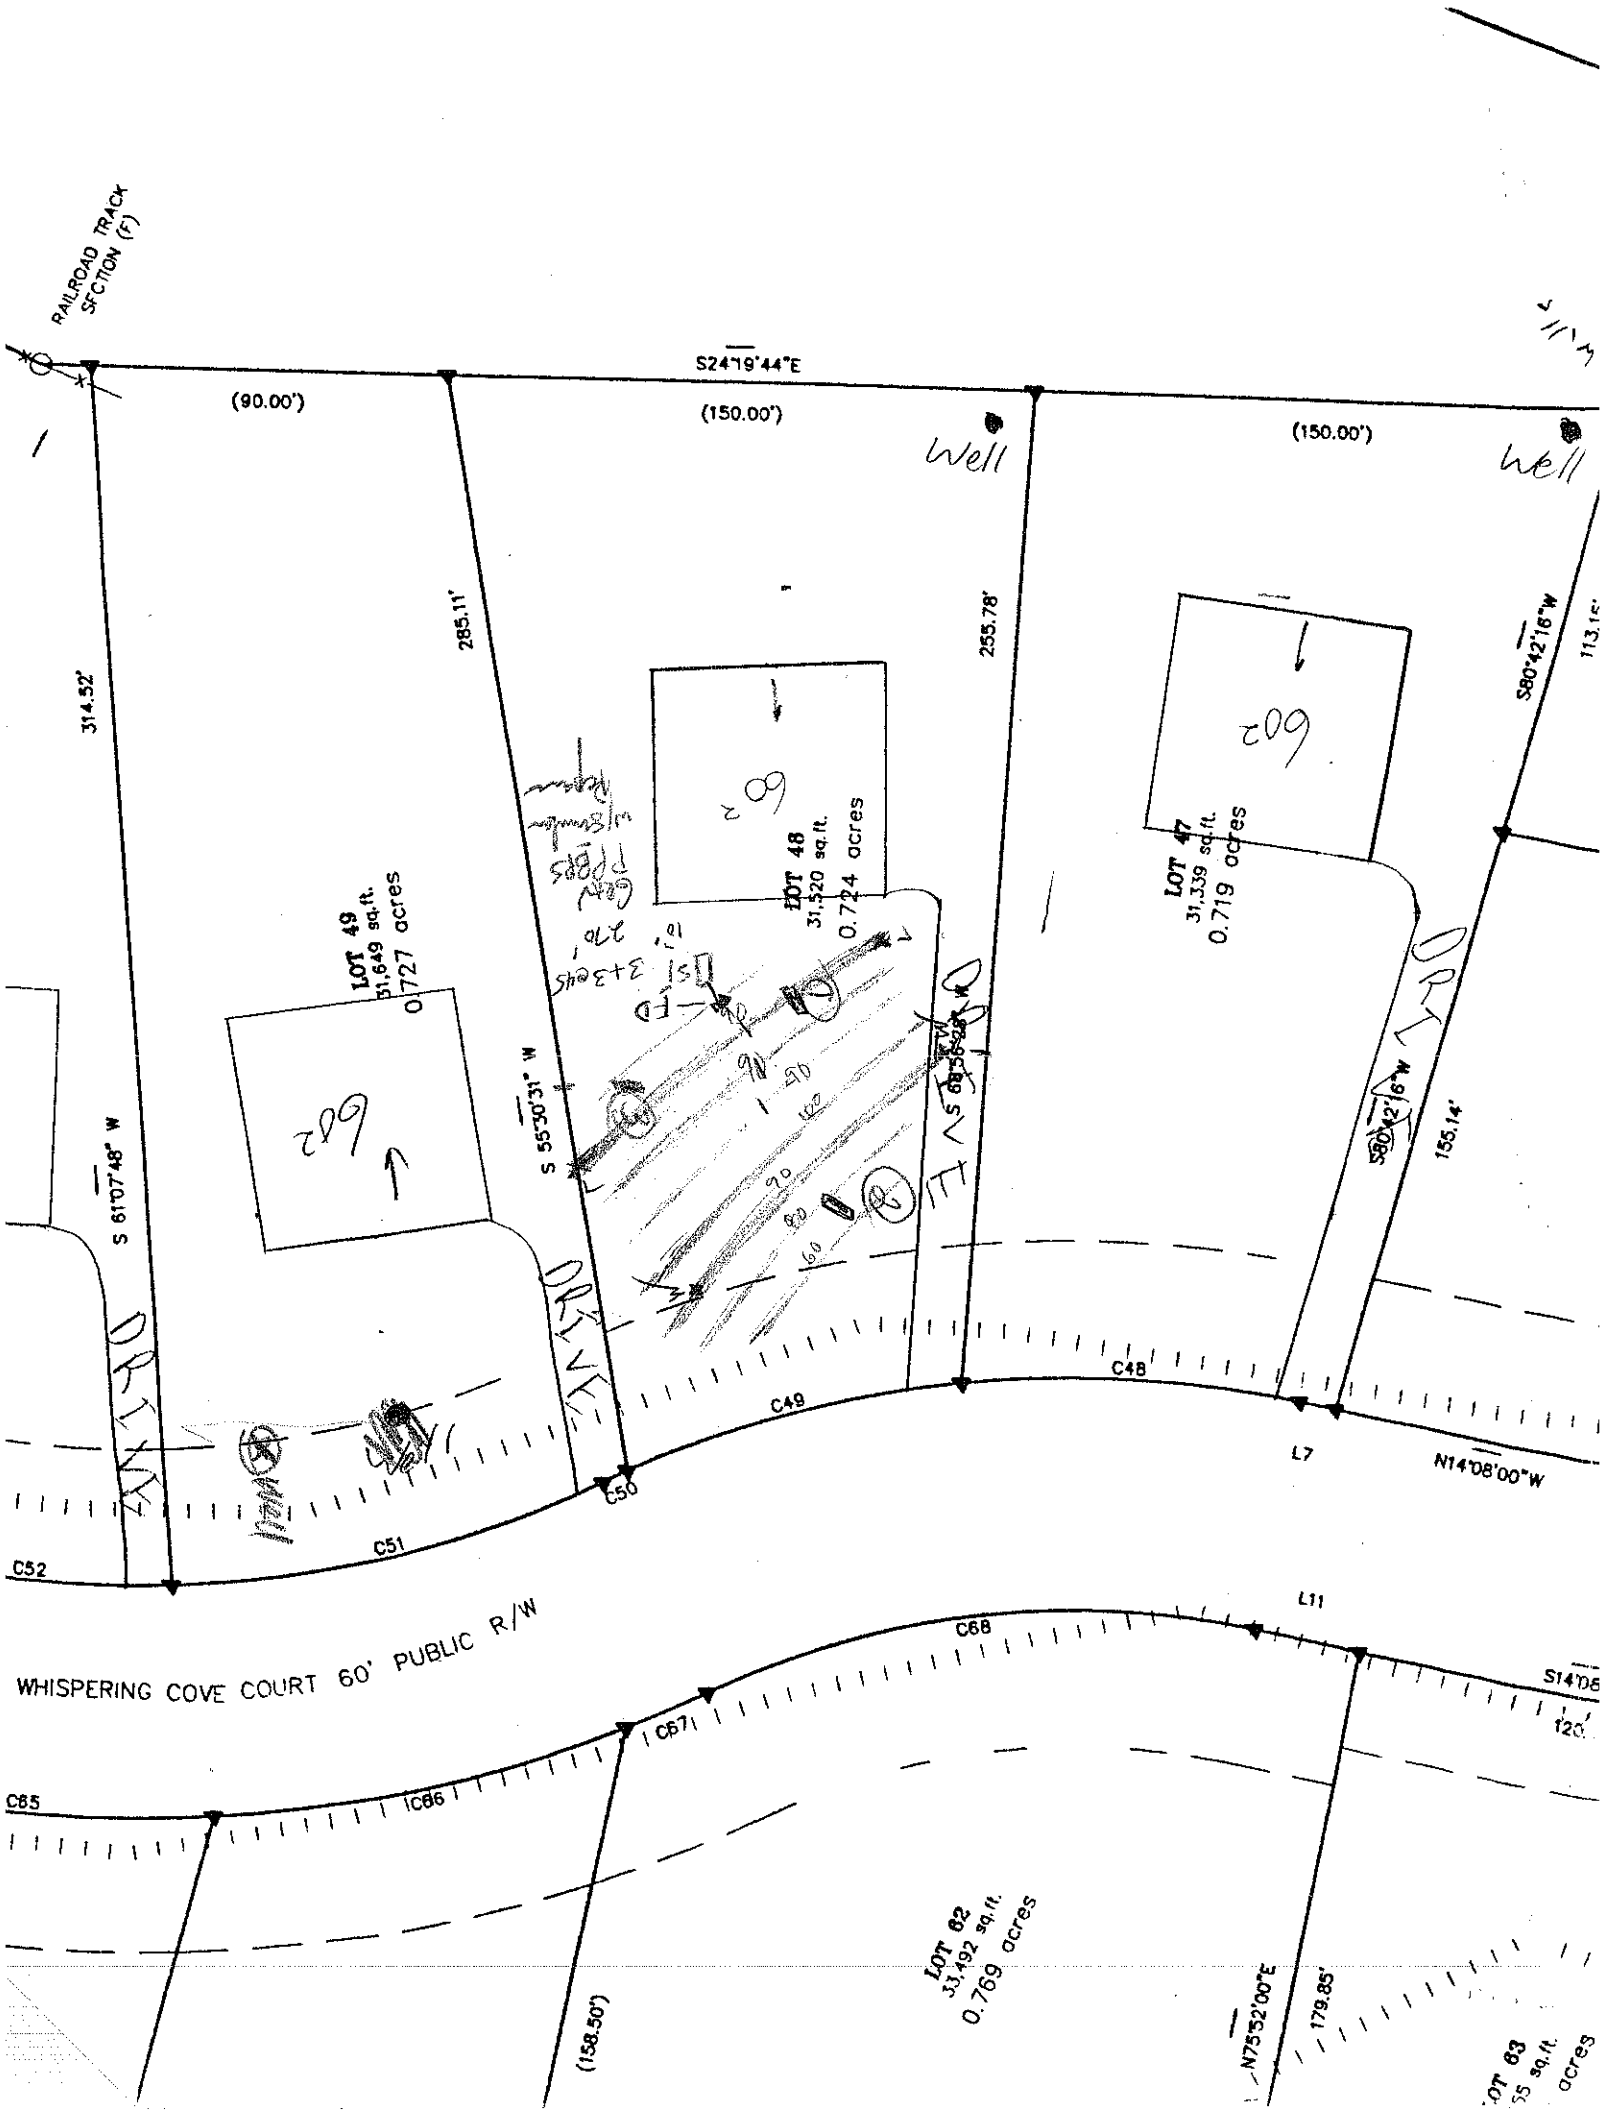
SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: Shoreline Dev. Corp APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: 11-12-04
PROPOSED FACILITY: SFR PROPOSED DESIGN FLOW (.1949): 480 gpd PROPERTY SIZE: _____
LOCATION OF SITE: Lot 48 Walkington Woods PROPERTY RECORDED: _____
WATER SUPPLY: ☒ Private ☐ Public ☒ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☒ Pit ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed Dig another pit

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	10% L	0-8	gr brnSL	fr sss p					3
		8-35	mf sbk RC	fr ss sp					
		35-48	wk f sbk yrcl	fr sss p	common in el sap				
2		0-7	gr brn sl	fr sss p					3
		7-29	mf sbk yrc	fr ss sp					
		29-50	(bc) wk f sbk pg o/l	fr sss p	common in el sap				
3	11-19-04 12" @ 65' 35'OS bnd from 46/49 pit	0-4	gr brn sl	fr sss p					3
		4-30	mf sbk RC	fr ss sp sap					
		30-52	wk f sbk yr-pr sl	fr sss p	common in el sap in el quartz & feldspar 3"/4				
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	RS	RS
System Type(s)	Gravel Sub	LPP BRS
Site LTAR	.3	.3

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): RS
EVALUATED BY: DB Hargrove
OTHER(S) PRESENT: Paul Kennington


RAILROAD TRACK
SECTION (P)
S24°19'44"E
(90.00')
(150.00')
(150.00')
well
well
314.52'
285.11'
255.78'
LOT 49
31,649 sq.ft.
0.727 acres
LOT 48
31,520 sq.ft.
0.724 acres
LOT 47
31,339 sq.ft.
0.719 acres
S 61°07'48" W
S 55°30'31" W
S80°42'16"W
155.14'
C48
C49
C50
C51
C52
L7
N14°08'00"W
L11
C68
C67
C66
C65
WHISPERING COVE COURT 60' PUBLIC R/W
LOT 62
33,492 sq.ft.
0.769 acres
(158.50')
179.85'
N75°32'00"E