DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

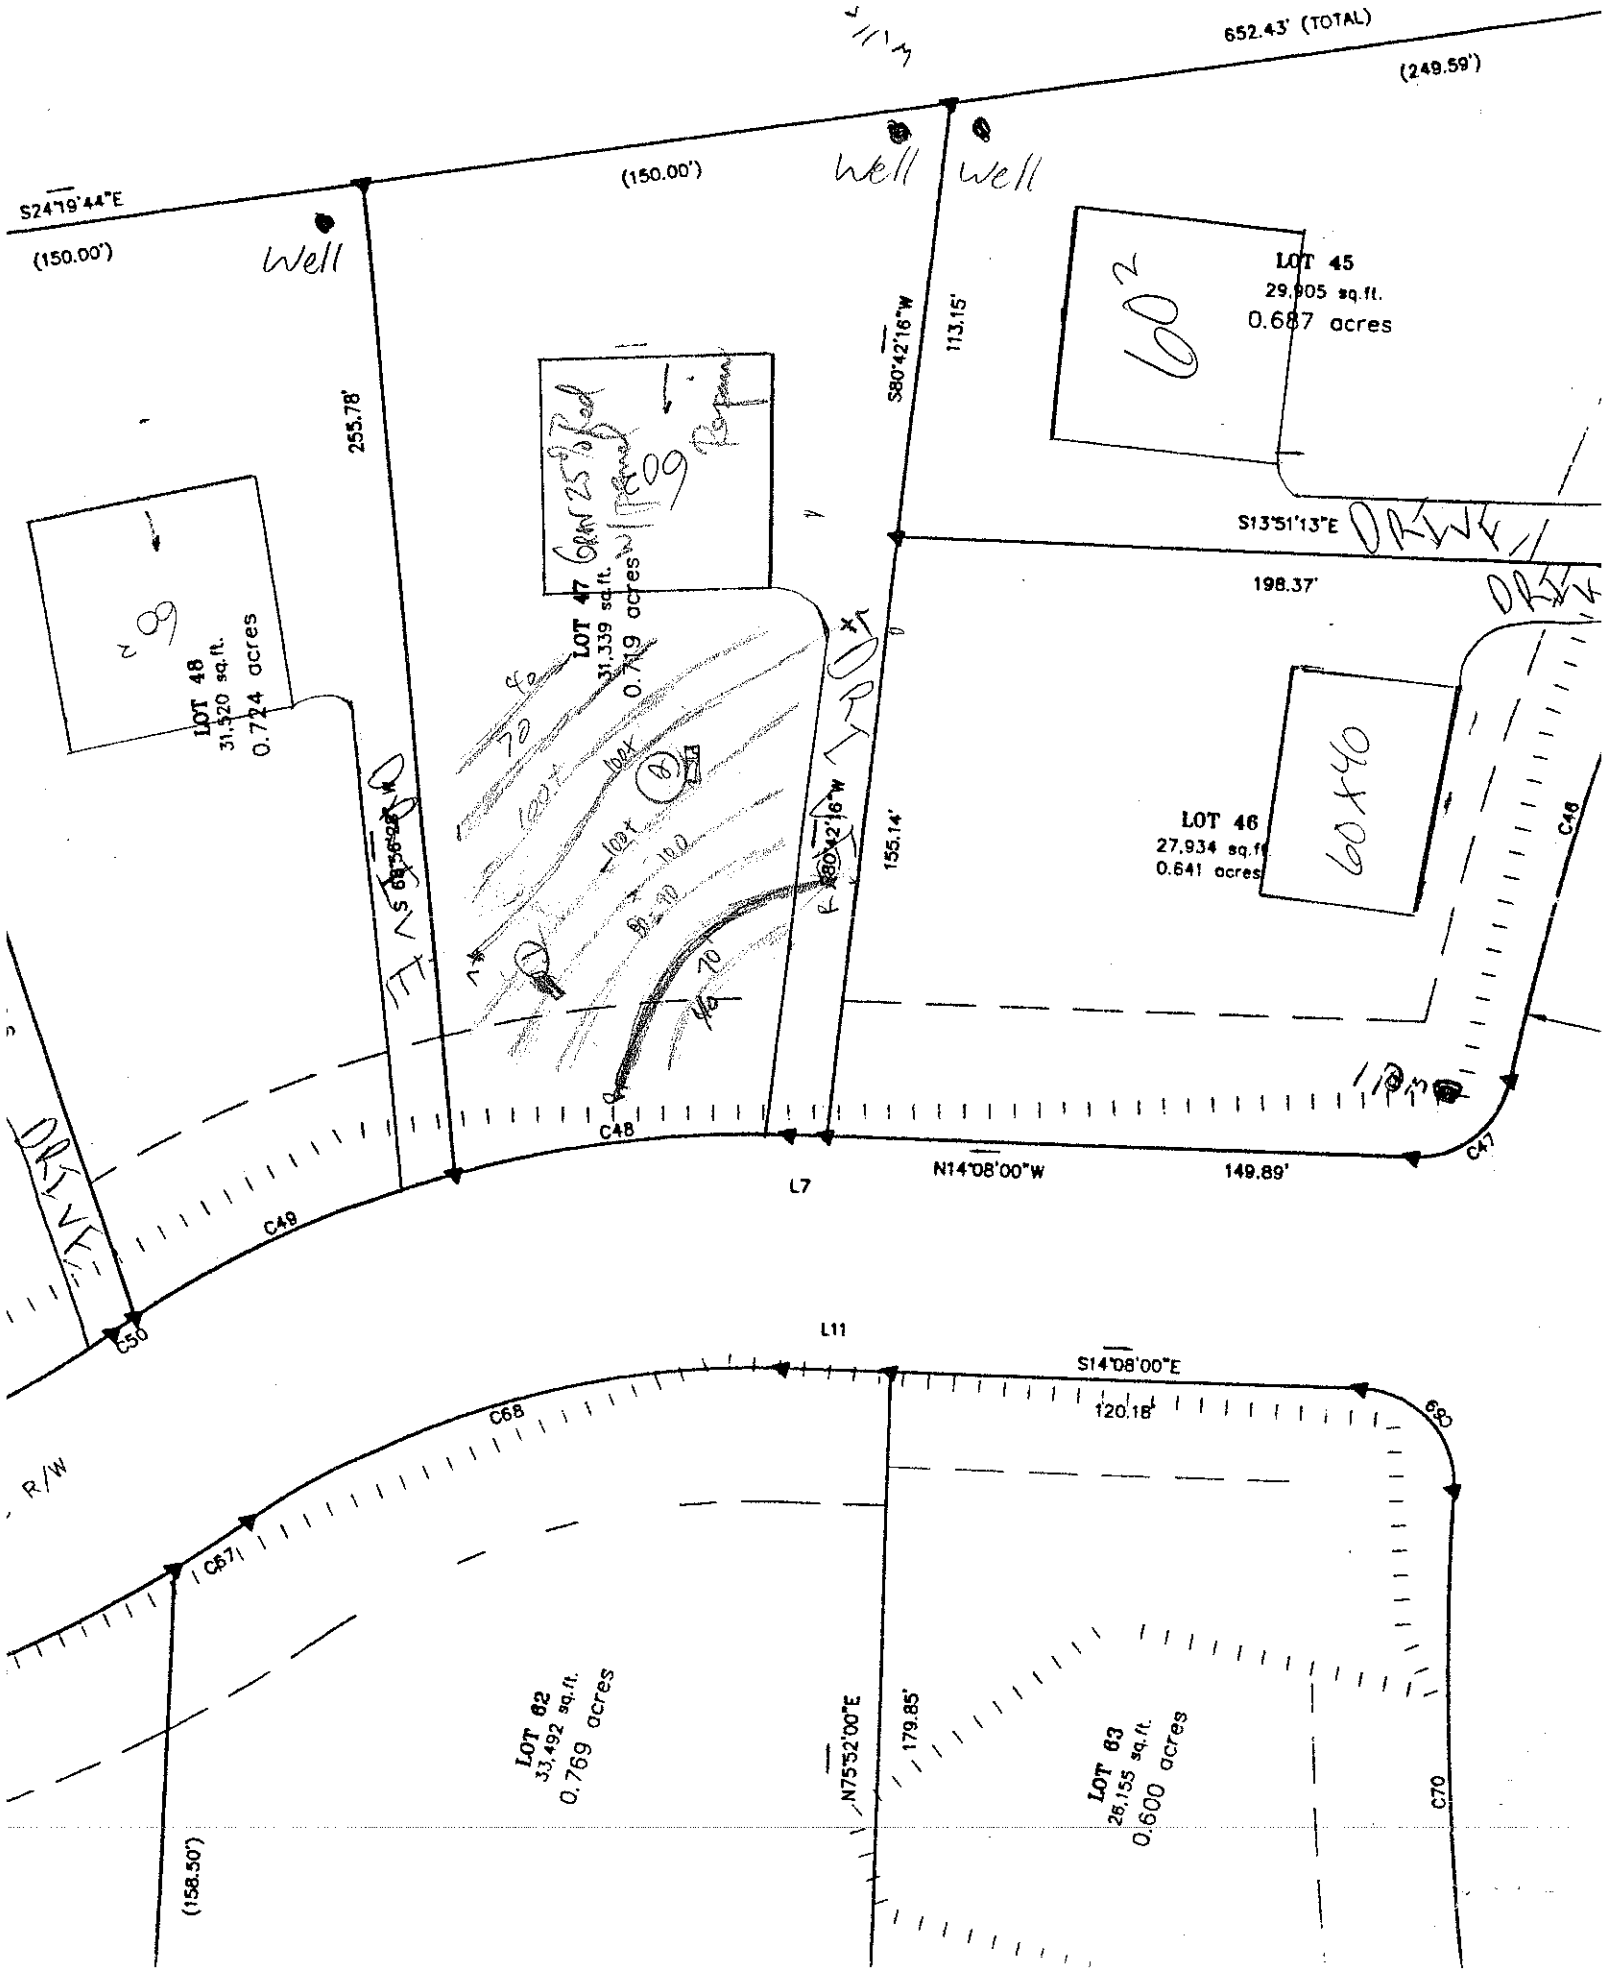
SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: Shavender Dev. Grp APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: 11-7-89
PROPOSED FACILITY: SFR PROPOSED DESIGN FLOW (.1949): 480 gpd PROPERTY SIZE: _____
LOCATION OF SITE: Lot 49 Northwinds Woods PROPERTY RECORDED: _____
WATER SUPPLY: ☑ Private ☐ Public ☑ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☑ Pit ☐ Cut
TYPE OF WASTEWATER: ☑ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-6	gr sl sk brn sl	fr ss sp					.3
		6-31	mfsbk RC	fr ss sp sp					
		31-58	wk fsbk RCL	fr ss sp	few ins pop				
2	S/O L	0-6	wk fsbk brn cl	fr ss sp					.3
		6-19	mfsbk/wk fsbk RC	fr ss sp sp					
		19-38	wk fsbk yr cl	fr ss sp	few ins pop				
		38-49	(BC) wk fsbk ry L	fr ss sp	common ins pop				
3									
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	PS
System Type(s)	Trad 25% Red	LPP BPS
Site LTAR	.3	.3

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): PS
EVALUATED BY: _____
OTHER(S) PRESENT: Paul Pennington


652.43' (TOTAL)
(249.59')
(150.00')
Well
Well
Well
S24°19'44"E
(150.00')
255.78'
LOT 48
31,520 sq.ft.
0.724 acres
LOT 47
31,339 sq.ft.
0.719 acres
LOT 45
29,905 sq.ft.
0.687 acres
S80°42'16"W
113.15'
S13°51'13"E
198.37'
DRIVE
LOT 46
27,934 sq.ft.
0.641 acres
155.14'
N80°42'16"W
C48
C47
C46
C49
C50
L7
N14°08'00"W
149.89'
L11
S14°08'00"E
120.18'
C68
C67
C69
C70
R/W
LOT 62
33,492 sq.ft.
0.769 acres
LOT 63
26,155 sq.ft.
0.600 acres
N75°52'00"E
179.85'
(158.50')