DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

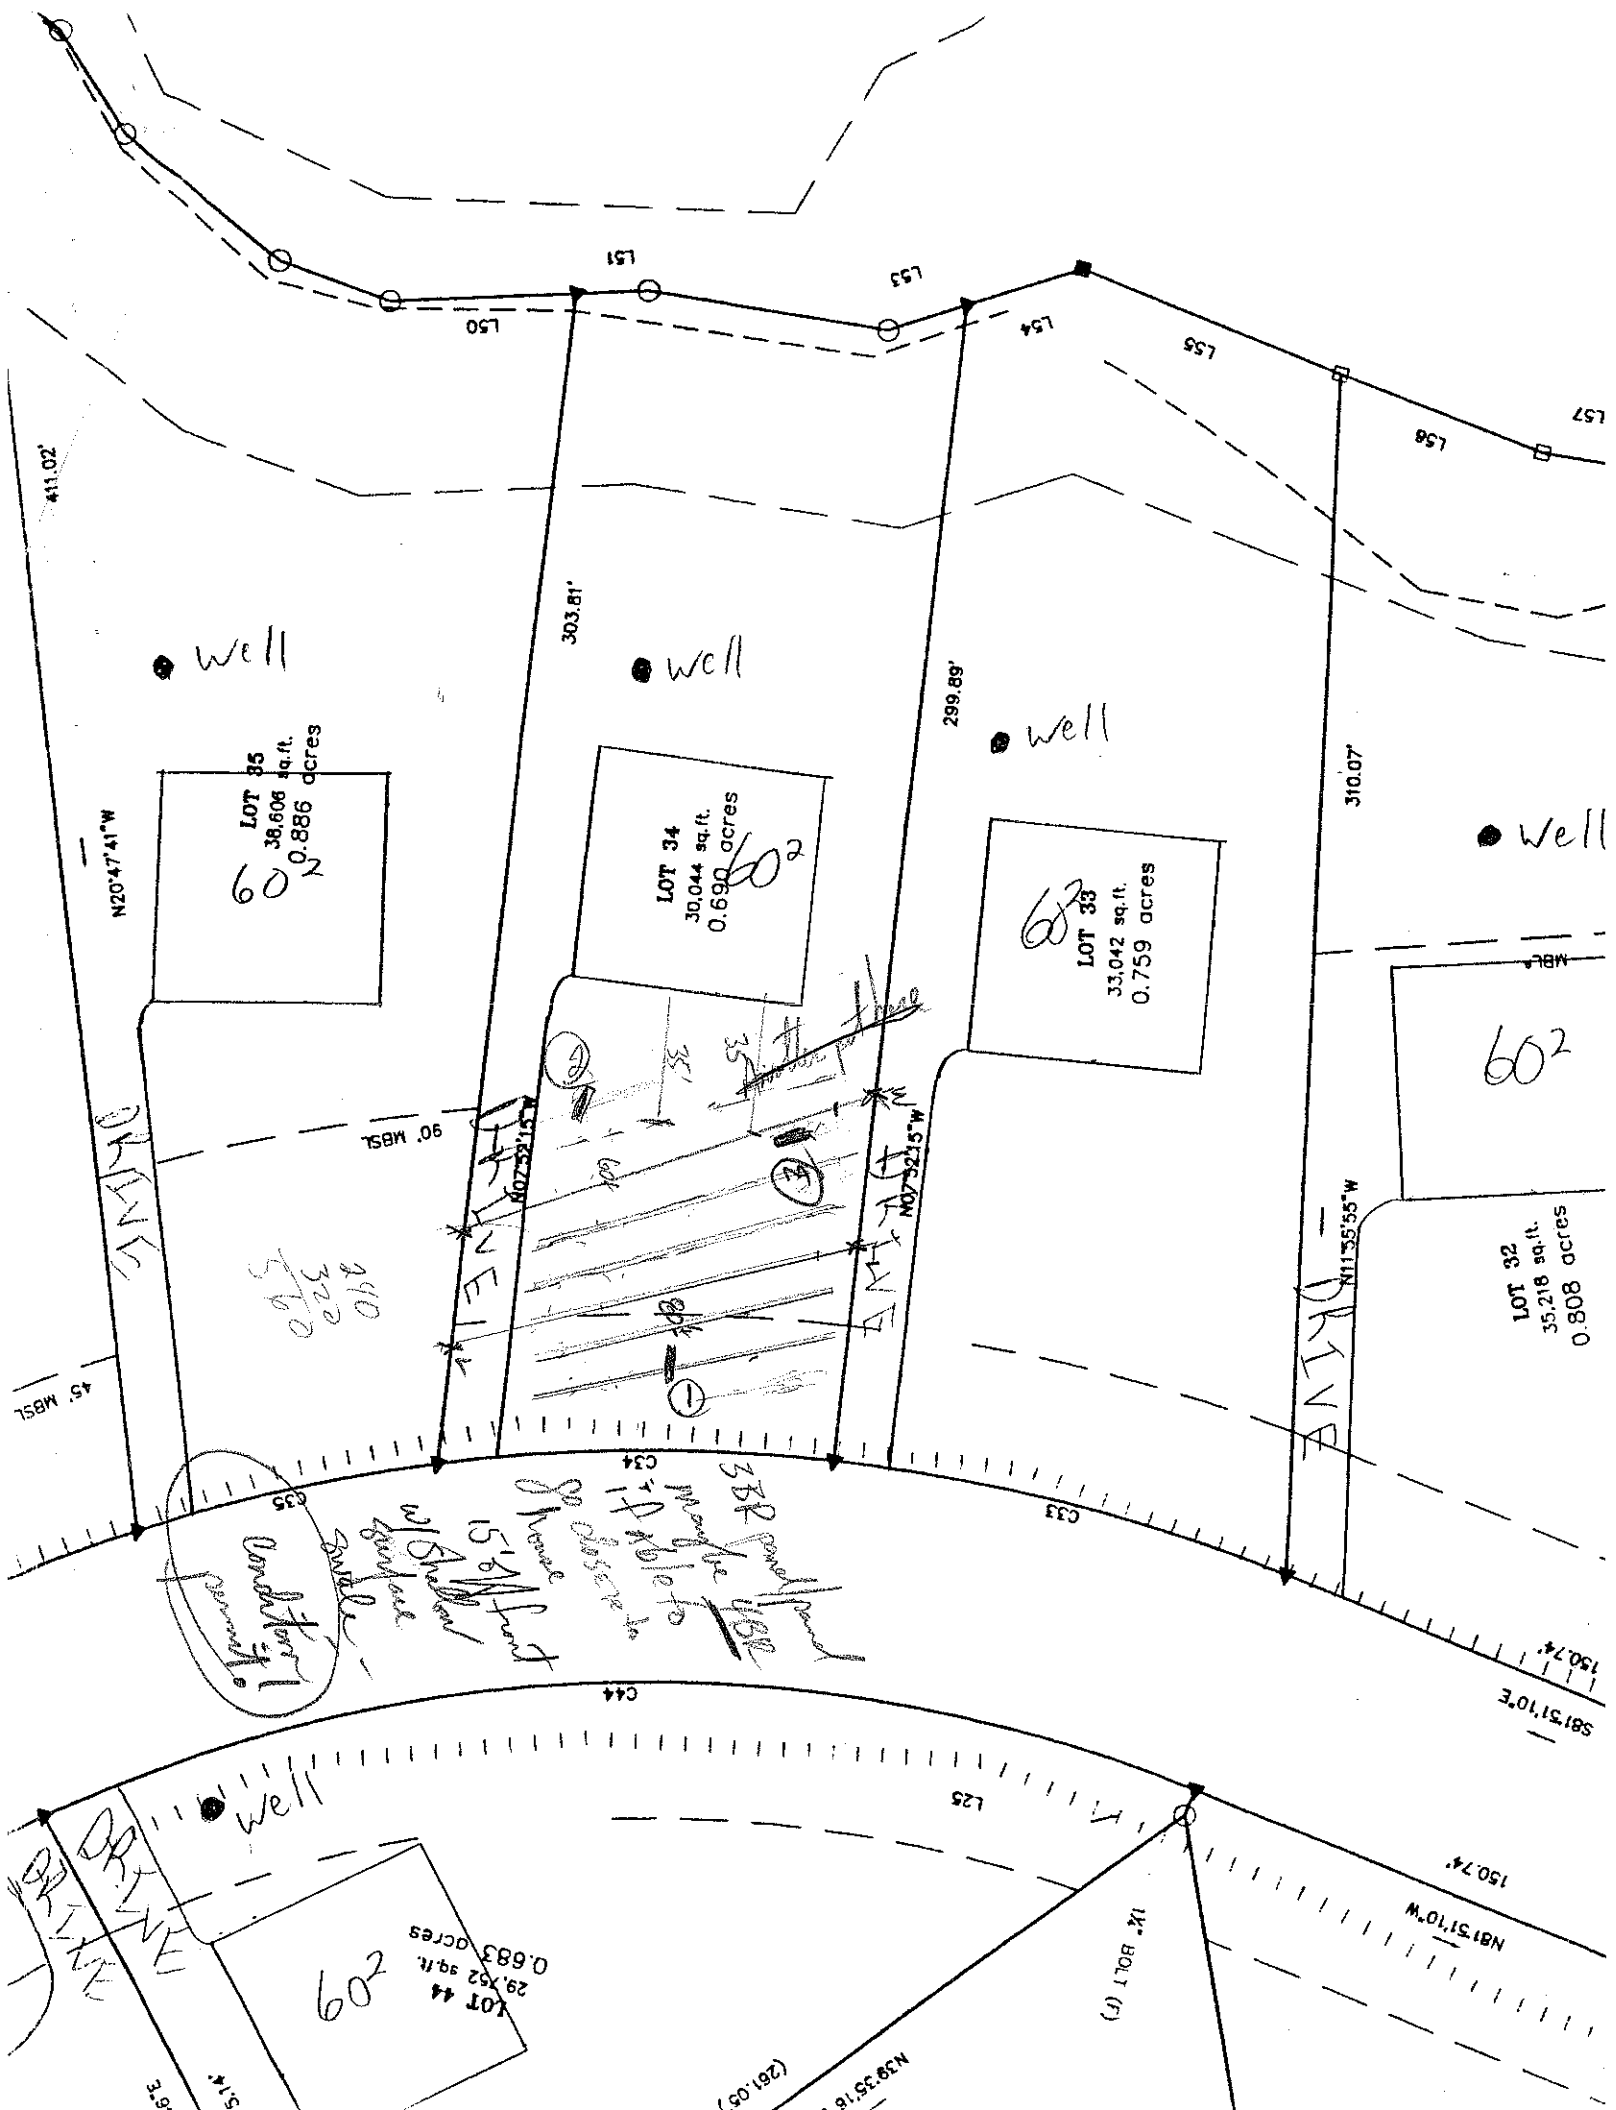
SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: Shaconda Dav Coop APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: 1-8-04
PROPOSED FACILITY: SFR PROPOSED DESIGN FLOW (.1949): 480gpd PROPERTY SIZE: _____
LOCATION OF SITE: Lot 34 Northington Woods PROPERTY RECORDED: _____
WATER SUPPLY: ☒ Private ☐ Public ☒ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☒ Pit ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	OTHER PROFILE FACTORS .1943 SOIL DEPTH	OTHER PROFILE FACTORS .1956 SAPRO CLASS	OTHER PROFILE FACTORS .1944 RESTR HORIZ	PROFIL CLASS & LTAI
1	10% L	0-3	gr sl	fr					.3
		3-24	gr sbk rc cl/l	fr sss sp	few mod sap				
		24-60	massive	fr sl sp					
2		0-7	wk sbk brn sl	fr sss sp					.3
		7-38	wk sbk rc	fr sss sp					
		38-58	wk sbk rc cl	fr sss sp	few-common mod sap				
3		0-2	gr brn sl	fr					.34
		2-25	mk sbk rc	fr sp sl sth					
		25-59	(BC) mk sbk yel cl	fr sss sp	common mod sap				
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	PS
System Type(s)	LPPPBPS	LPPPBPS
Site LTAR	.3	.3

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): BS
EVALUATED BY: _____
OTHER(S) PRESENT: _____


well
well
well
well
LOT 35
38,606 sq.ft.
0.886 acres
LOT 34
30,044 sq.ft.
0.690 acres
LOT 33
33,042 sq.ft.
0.759 acres
LOT 32
35,218 sq.ft.
0.808 acres
LOT 44
29,752 sq.ft.
0.683 acres
60'
60²
303.81'
299.89'
310.07'
411.02'
N20°47'41"W
N11°35'55"W
N07°52'15"W
S81°51'10"E
N81°51'10"W
150.74'
90' MBSL
45' MBSL
L50
L51
L53
L54
L55
L56
L57
C33
C34
C35
C44
L25
(261.05')
N39°35'18"E
14' BOLT (F)
PRIVATE DRIVE
well