DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

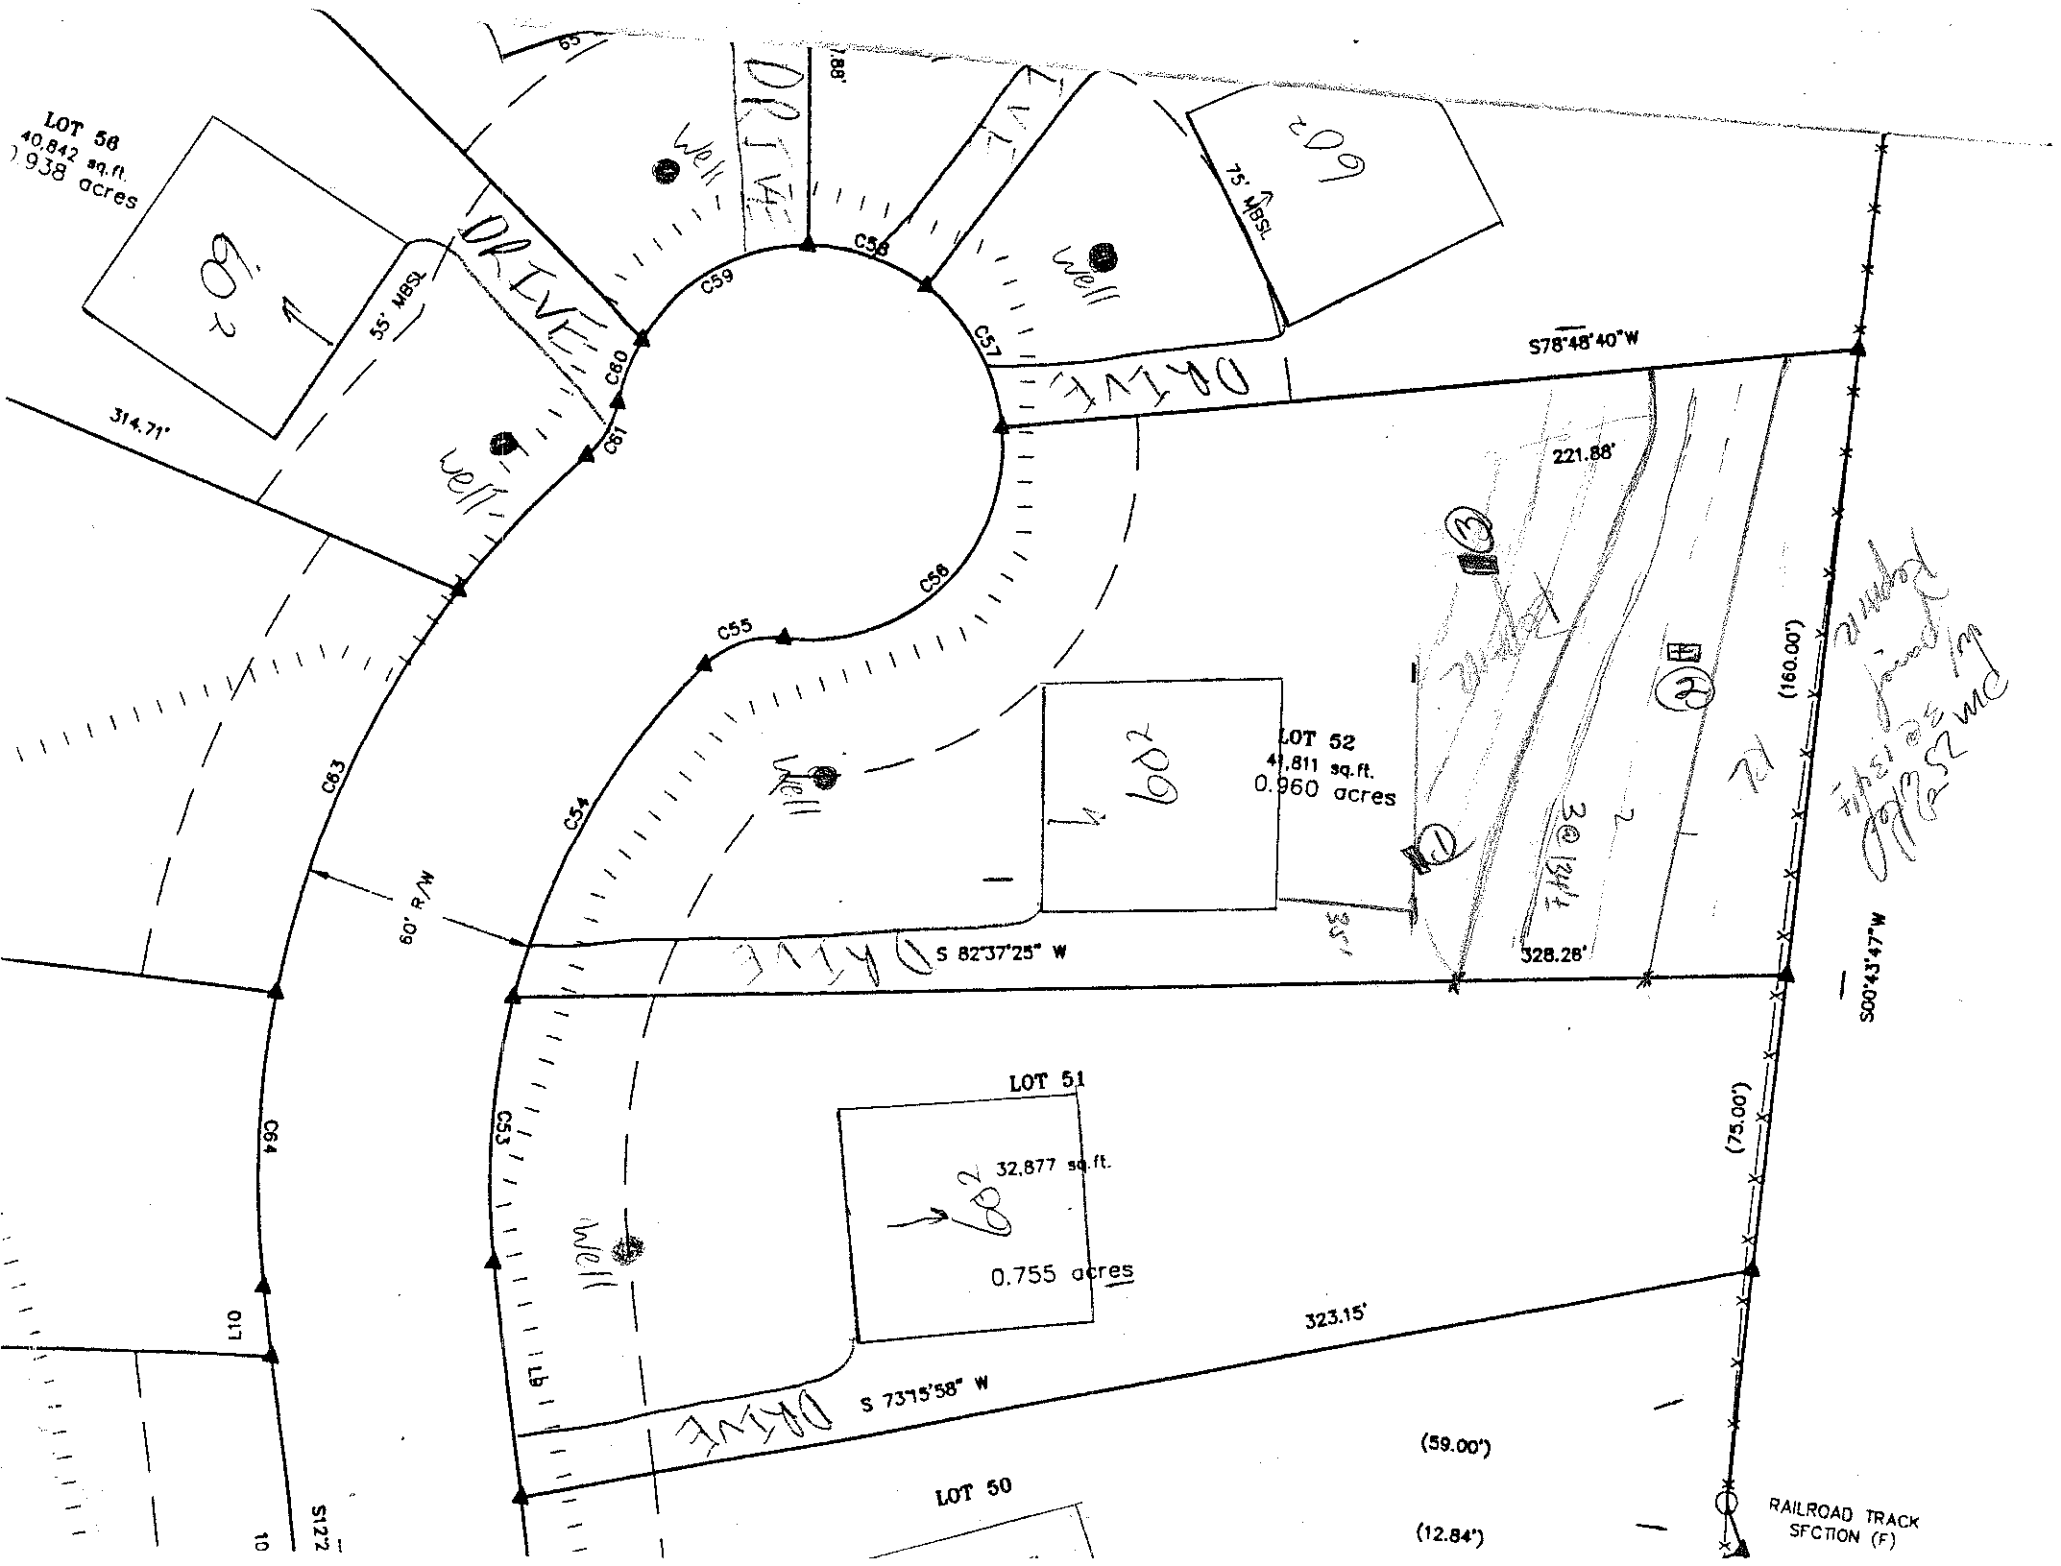
SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: Stevenson Dev Corp. APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: 11-17-04
PROPOSED FACILITY: SFR PROPOSED DESIGN FLOW (.1949): 480gpd PROPERTY SIZE: _____
LOCATION OF SITE: Lot 52 Nottingham Woods PROPERTY RECORDED: _____
WATER SUPPLY: ☒ Private ☐ Public ☒ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☒ Pit ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LAND-SCAPE POSITION/ SLOPE %	HORI-ZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-4	gr brwsl	fr					.3
		4-20	mSBK RC	frssspSAP					
		20-34	wkSBK red	mesp					
		34-54	mwk L/SBK	frssp					
2	11%	0-9	gr brwsl	frssp					.3
		9-30	mSBK RC	frssp SAP					
		30-52	wkSBK R-yrd	frssp Lfeminalsap					
3		0-4	gr brwsl	frssp					.3
		4-26	mSBK RC/C	frssp SAP					
		26-49 (B-C)	wkSBK YRL	frssp commonmineralsap					
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	PS
System Type(s)	gen 25% Red.	LPPPBPS
Site LTAR	.3	.3

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): PS
EVALUATED BY: [signature] RS
OTHER(S) PRESENT: Paul Pennington


LOT 56
40,842 sq.ft.
0.938 acres
602
DRIVE
well
55' MBSL
314.71'
C80
C61
C59
C58
C57
C56
C55
C54
C53
C63
C64
L10
L11
602
75' MBSL
S78°48'40"W
221.88'
(160.00')
S00°43'47"W
LOT 52
41,811 sq.ft.
0.960 acres
602
60' R/W
S 82°37'25" W
328.28'
LOT 51
32,877 sq.ft.
602
0.755 acres
323.15'
S 73°15'58" W
(75.00')
(59.00')
(12.84')
LOT 50
RAILROAD TRACK
SFCTION (F)
S12°2
10
3@1ft
2
1