IREDELL C[illegible]Y HEALTH DEPARTMENT

Lewis Taylor
STATESVILLE 704-878-5305

A-1 Backhoe
MOORESVILLE 704-[illegible]

IMPROVEMENT PERMIT / AUTHORIZATION TO CONSTRUCT / OPERATION PERMIT / EXISTING SYSTEM INSPECTION

PERMIT# 12502 PIN# 4639 61 5556.122 (4639 70 5485) DATE 11/14/06

OWNER OR CONTRACTOR HEIGHT PROPERTIES INC / Castleview PHONE: Business 453-3651 Home

ADDRESS 855 (N) HWY 16 DENVER NC 28037

LOCATION PERTH (N) - TL LFWA LW - TR BAYCROSSING - TR SUMMERWIND - ON RT

SUBDIVISION BAYCROSSING BLOCK / SECTION [illegible] LOT 122 LOT AREA 1.93AC SITE CLASS. PS DESIGN FLOW 480GPD L.T.A.R. .3600/Ft

Septic Tank: 1000/1500 Gallons; STB 528 Date 8-6-06
Pump Tank: 1000 Gallons; PT 17 Date 7-31-06
Pump Make: Goulds Model WE07 1/2 HP Serial No.
Nitrification Field: No Fields 1 Square Feet 800 Linear Feet 400
No Lines 4@100' Trench Width 36" Max Trench Bottom Depth 36" Gravel Depth N/A


☑ New System ☐ Repair System Type: I, II, III, IV, V, VI
System Description: Pump 25% REDUCTION
Repair System Description: SAME
Maintenance Agreement Required: ☐ Yes ☑ No

☑ House/Mod. Home No. Bedrooms 4
☐ Mobile Home No. Bathrooms 4
☐ Business No. Employees
☐ Other

☐ Slab ☑ Crawl Space ☐ Basement w/plumbing ☐ Basement wo/plumbing

Water Supply: ☑ Individual ☐ Public ☐ Community


Comments:/Conditions:

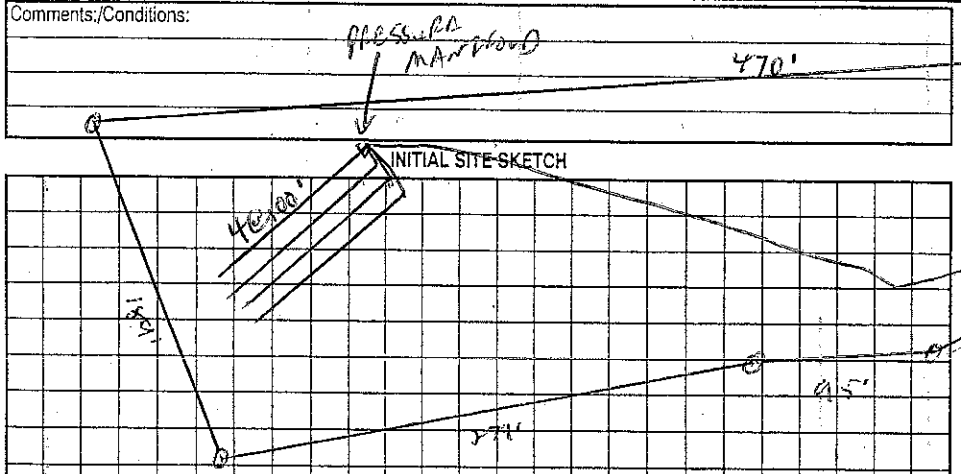

The proposed / existing Stairway to Deck addition does not appear to impact the existing septic system.
**NOTE: Must keep footer at least 5Ft from tanks Maria Dotson REHS
Date: 11/21/2011
ICHD-Environmental Health Division

Comments:/Conditions: CROSS SPRING PROPERLY WITH SUPPLY LINE. CONTACT HEALTH DEPARTMENT BEFORE INSTALLATION

Reviewed plans, in Compliance with I.P.

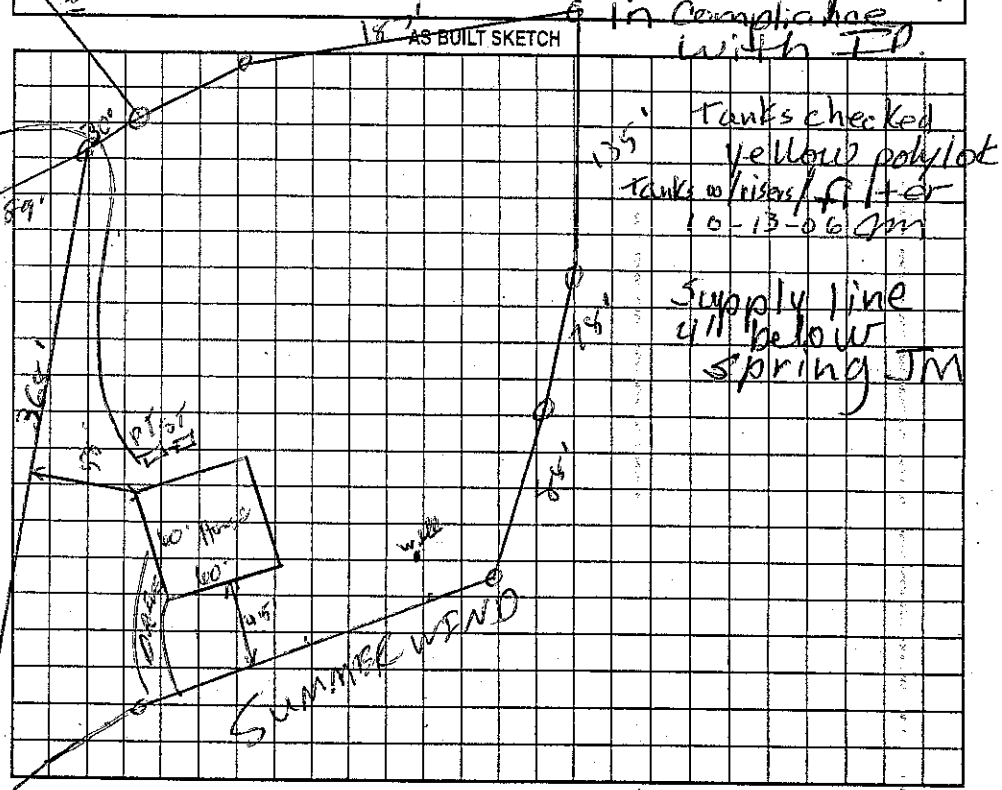

Tanks checked yellow poly lot Tanks no risers/filter 10-13-06 JM

Supply line all below spring JM

Permit can be suspended or revoked if any false information is supplied toward securing the permit/any unauthorized changes are made to the site/any unauthorized changes are made in the installation of the system. Improvement Permit with plat valid without expiration. Improvement Permit with site plan valid for sixty months. Authorization to Construct is valid for a period equal to that of Improvement Permit – not to exceed sixty months.

Signed: [signature] date 11-22-06 Installed by: A-1 Backhoe R.S. 7/7/06

Improvement Permit by: [signature] R.S. date 11/13/06 Operation Permit by: [redacted] Maria Dotson date [redacted]

Authorization to Construct by: Maria H Dotson REHS date 11/20/06 Existing System Inspection by: date

HEALTH DEPT. COPY: WHITE OWNER COPY (FINAL): YELLOW OWNER COPY (INITIAL): PINK