DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #:
COUNTY:

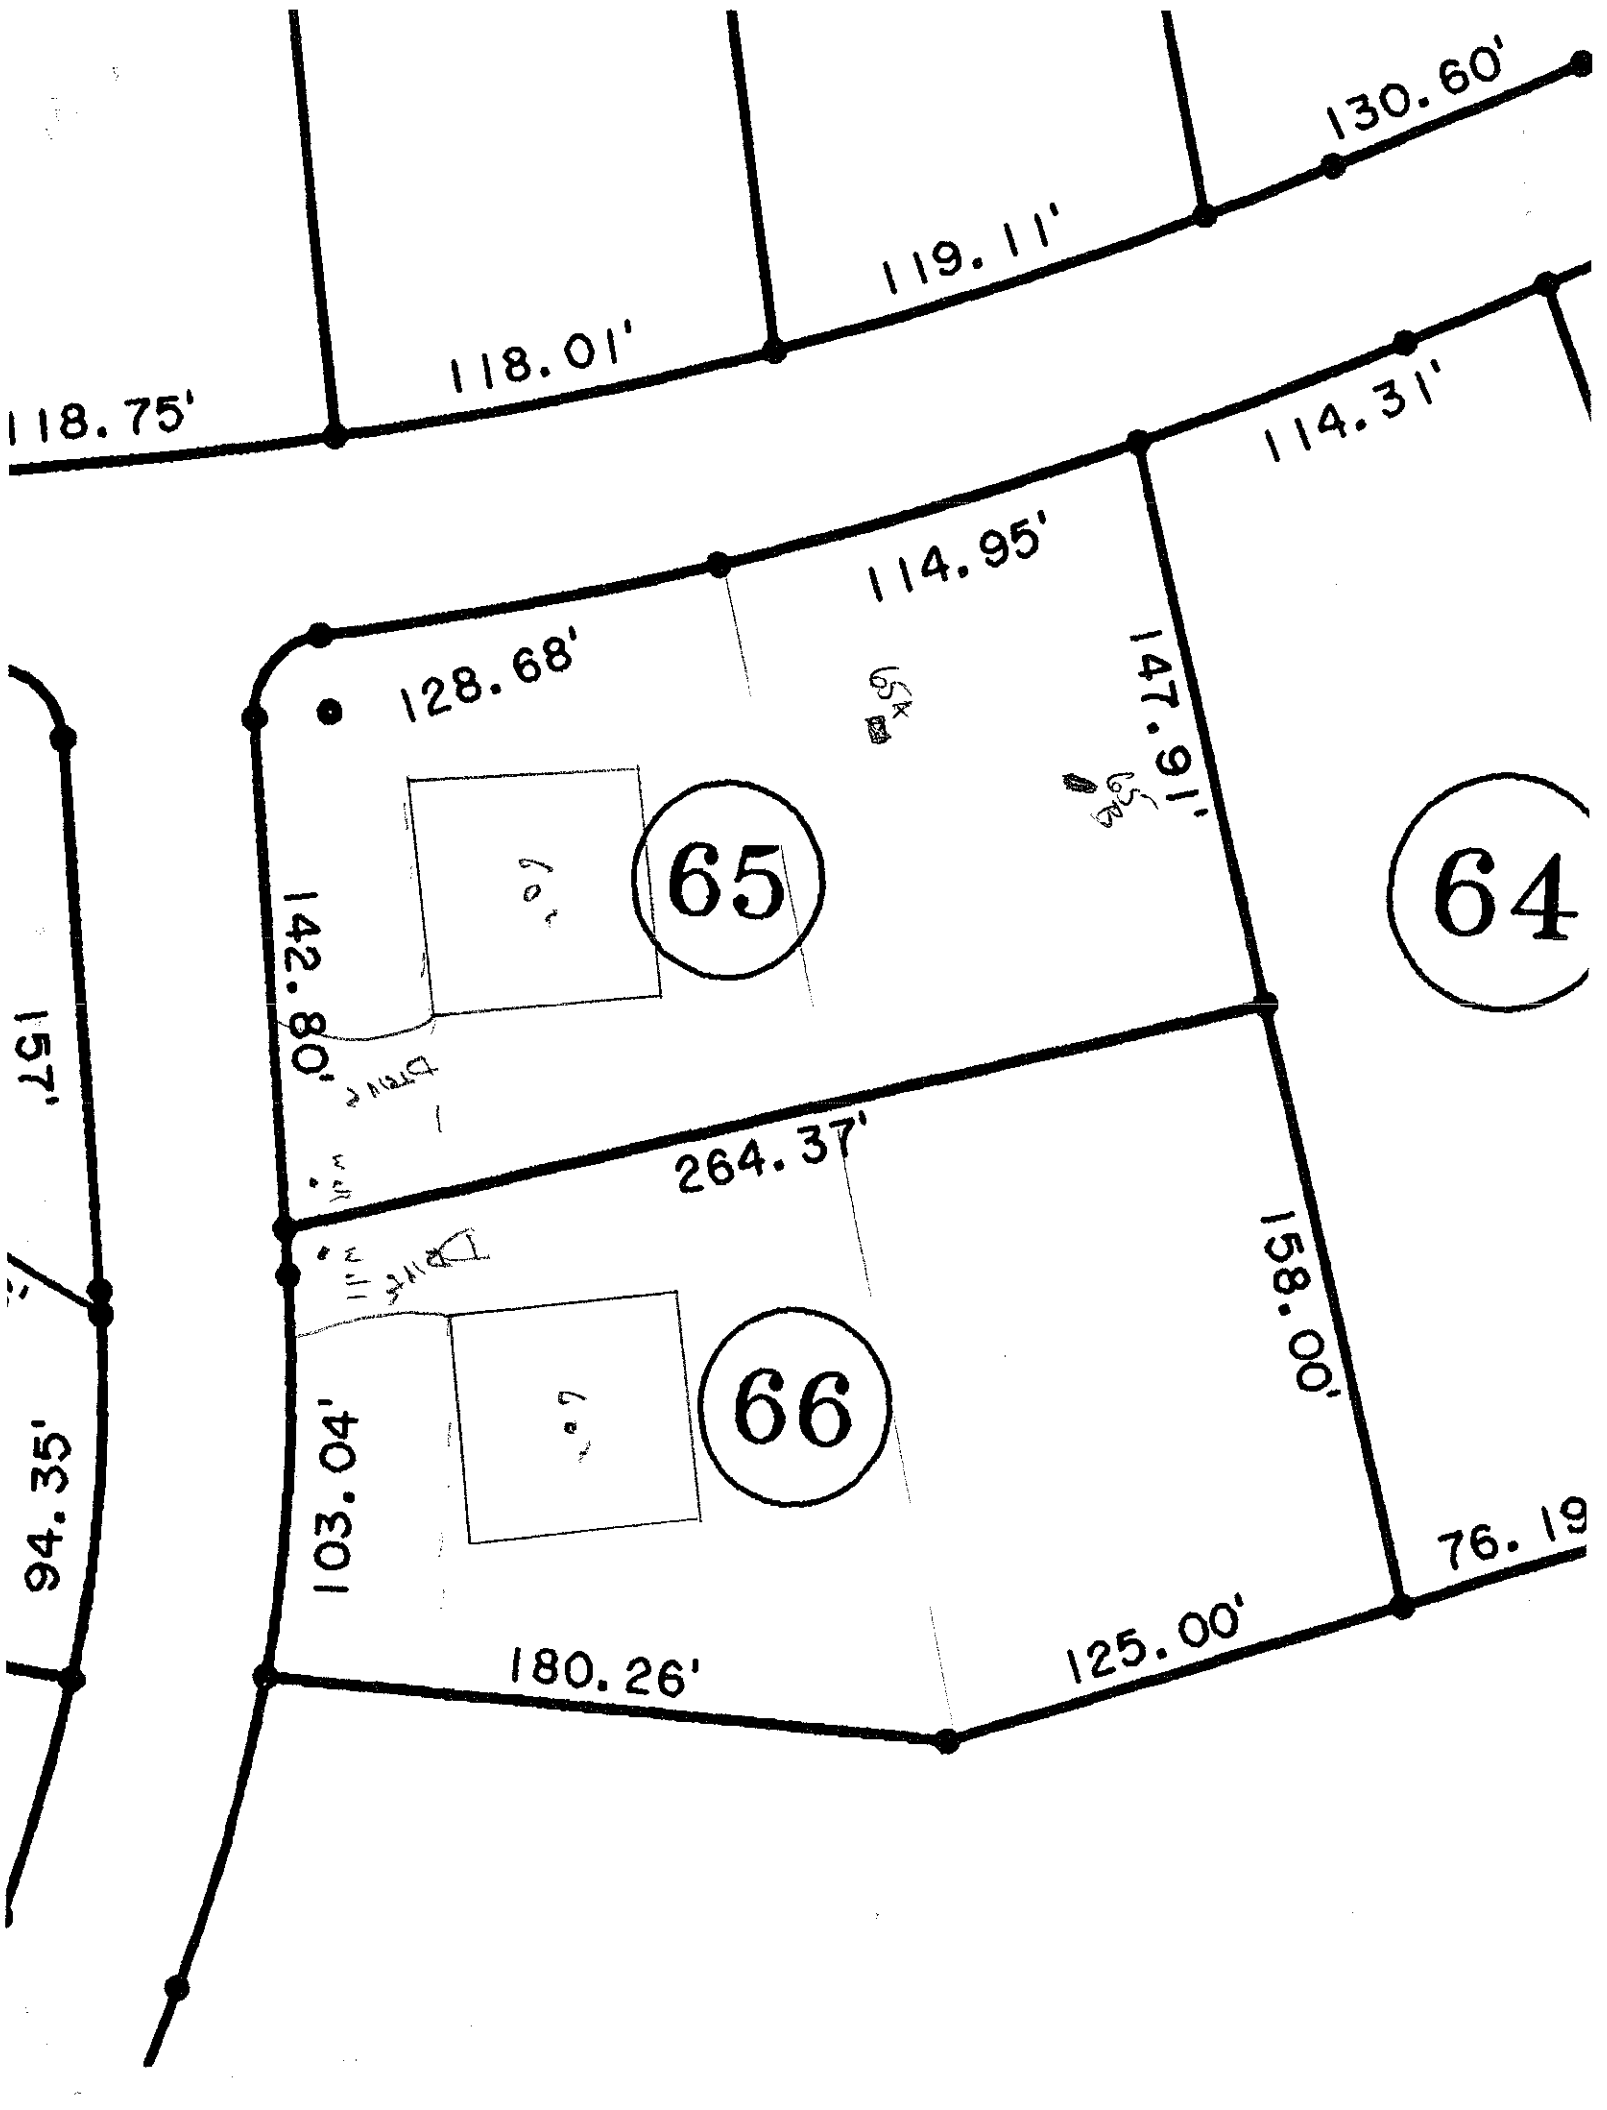
SOIL/SITE EVALUATION for ON-SITE WASTEWATER SYSTEM

OWNER: APPLICANT:
ADDRESS: APPLICATION DATE: DATE EVALUATED: 4-18-05
PROPOSED FACILITY: PROPOSED DESIGN FLOW (.1949): PROPERTY SIZE:
LOCATION OF SITE: Misc Bay Crossing Lot 65 Rollse PROPERTY RECORDED:
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☑ Other
EVALUATION METHOD: ☐ Auger Boring ☒ Pit ☐ Cut
TYPE OF WASTEWATER: ☑ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	65K 9-10%	0-11	wkfsbk sl/scl	frssp					0.3
		11-38	wkfsbk scl	frssp					
		38-54	(B-C) wk fsbk/massive scl	frssp common med sap					
2	65B	0-3	gr/sbk sl	frssp					0.3
		3-27	wkfsbk scl	frssp sap					
		27-40	wk fsbk/massive cl	frssp common med sap					
		40-54	massive pgl sap	frssp	Perched W.T. 22" on Entire O				
3									
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR	0.3	0.3

OTHER FACTORS (.1946):
SITE CLASSIFICATION (.1948):
EVALUATED BY:
OTHER(S) PRESENT:


130.60'
119.11'
118.01'
118.75'
114.31'
114.95'
128.68'
147.91'
65
64
142.80'
264.37'
66
103.04'
158.00'
94.35'
157'
180.26'
125.00'
76.19