DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

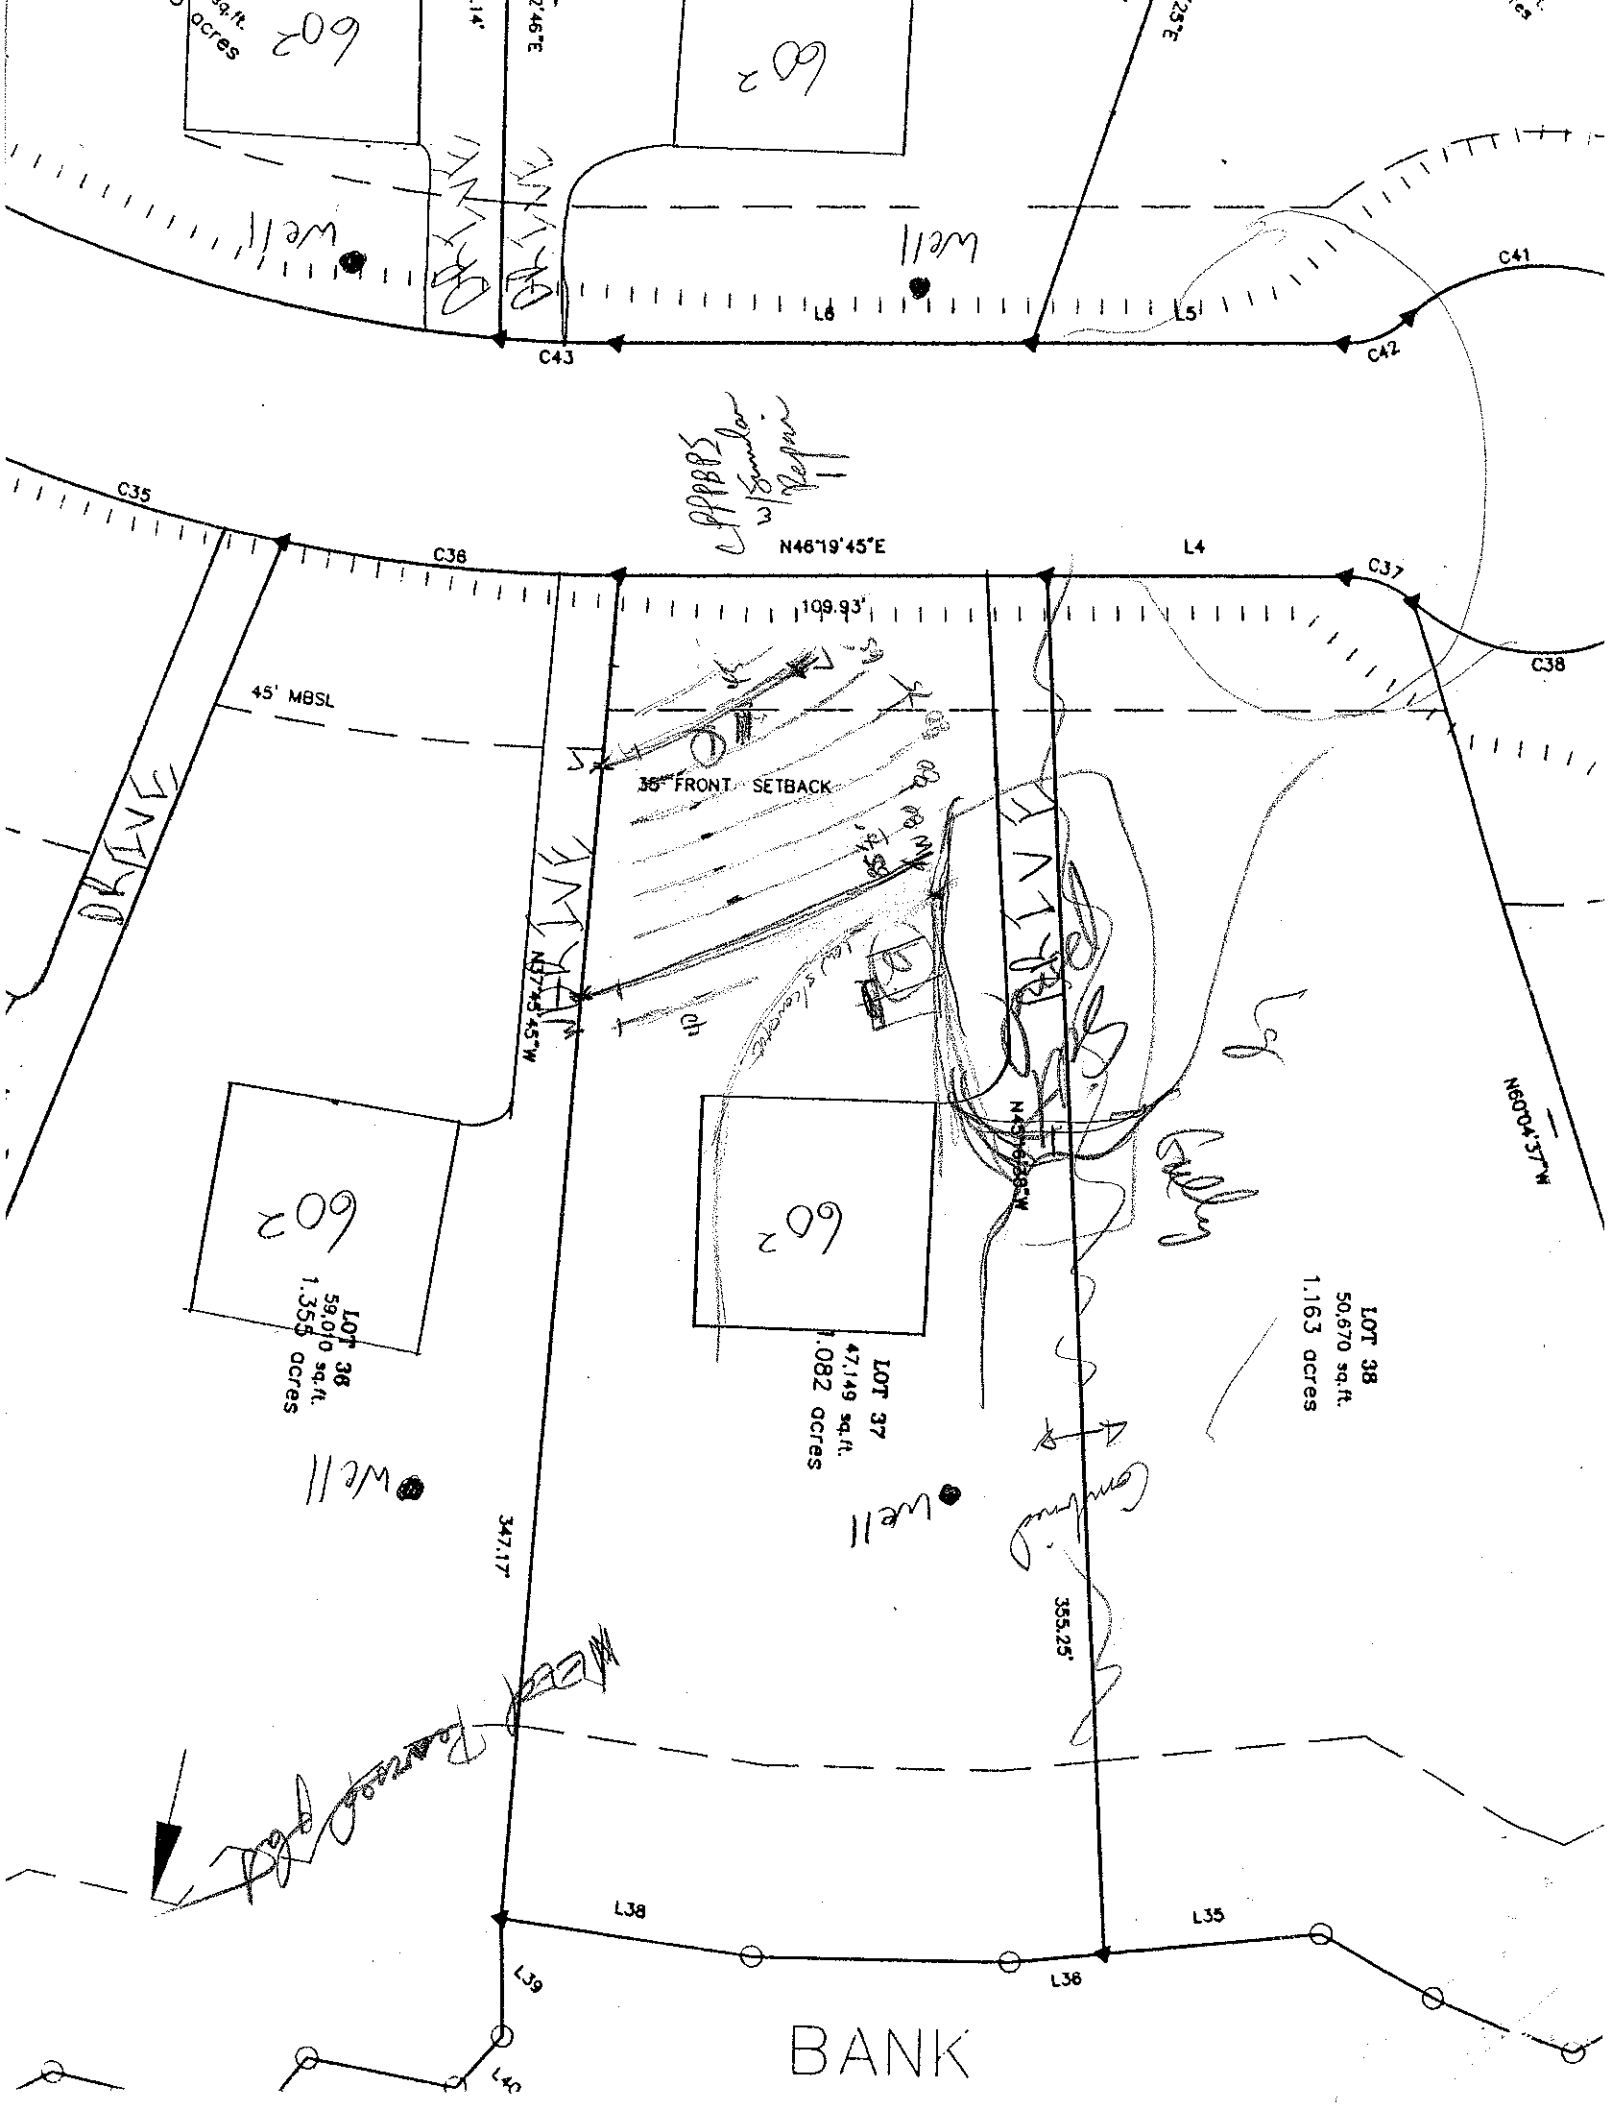
SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: Shoreside Dev. Corp LLC APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: 11-8-04
PROPOSED FACILITY: SFR PROPOSED DESIGN FLOW (.1949): 480 gpd PROPERTY SIZE: _____
LOCATION OF SITE: Lot 37 Northampton Woods PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFIL CLASS & LTA
1	5% ± ↓	0-12	mfsbk RC	fr sss sp so					0.3
		12-29	mfsbk RCl	fr sss sp so					
		29-58	coarse lay dyb sl sap	fr sss sp					
2		0-20	mfsbk RC	fr sp-sss sp so					0.3
		20-48	mfsbk yp sal/cl	fr sss sp					
3									
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	PS
System Type(s)	LPPPBPS	LPPPBPS
Site LTAR	0.3	0.3

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): R
EVALUATED BY: DH Hunter
OTHER(S) PRESENT: Paul Pennington


C35
C36
C37
C38
C41
C42
C43
L4
L5
L6
L35
L36
L38
L39
L40
N46°19'45"E
109.93'
45' MBSL
35' FRONT SETBACK
N60°04'37"W
347.17'
355.25'
LOT 38
59,010 sq.ft.
1.355 acres
LOT 37
47,149 sq.ft.
1.082 acres
LOT 38
50,670 sq.ft.
1.163 acres
well
well
well
BANK