EPARTMENT OF ENVIRONMENT AND NATURAL RESOURCES
IVISION OF ENVIRONMENTAL HEALTH
N-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: ___
COUNTY: ___

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

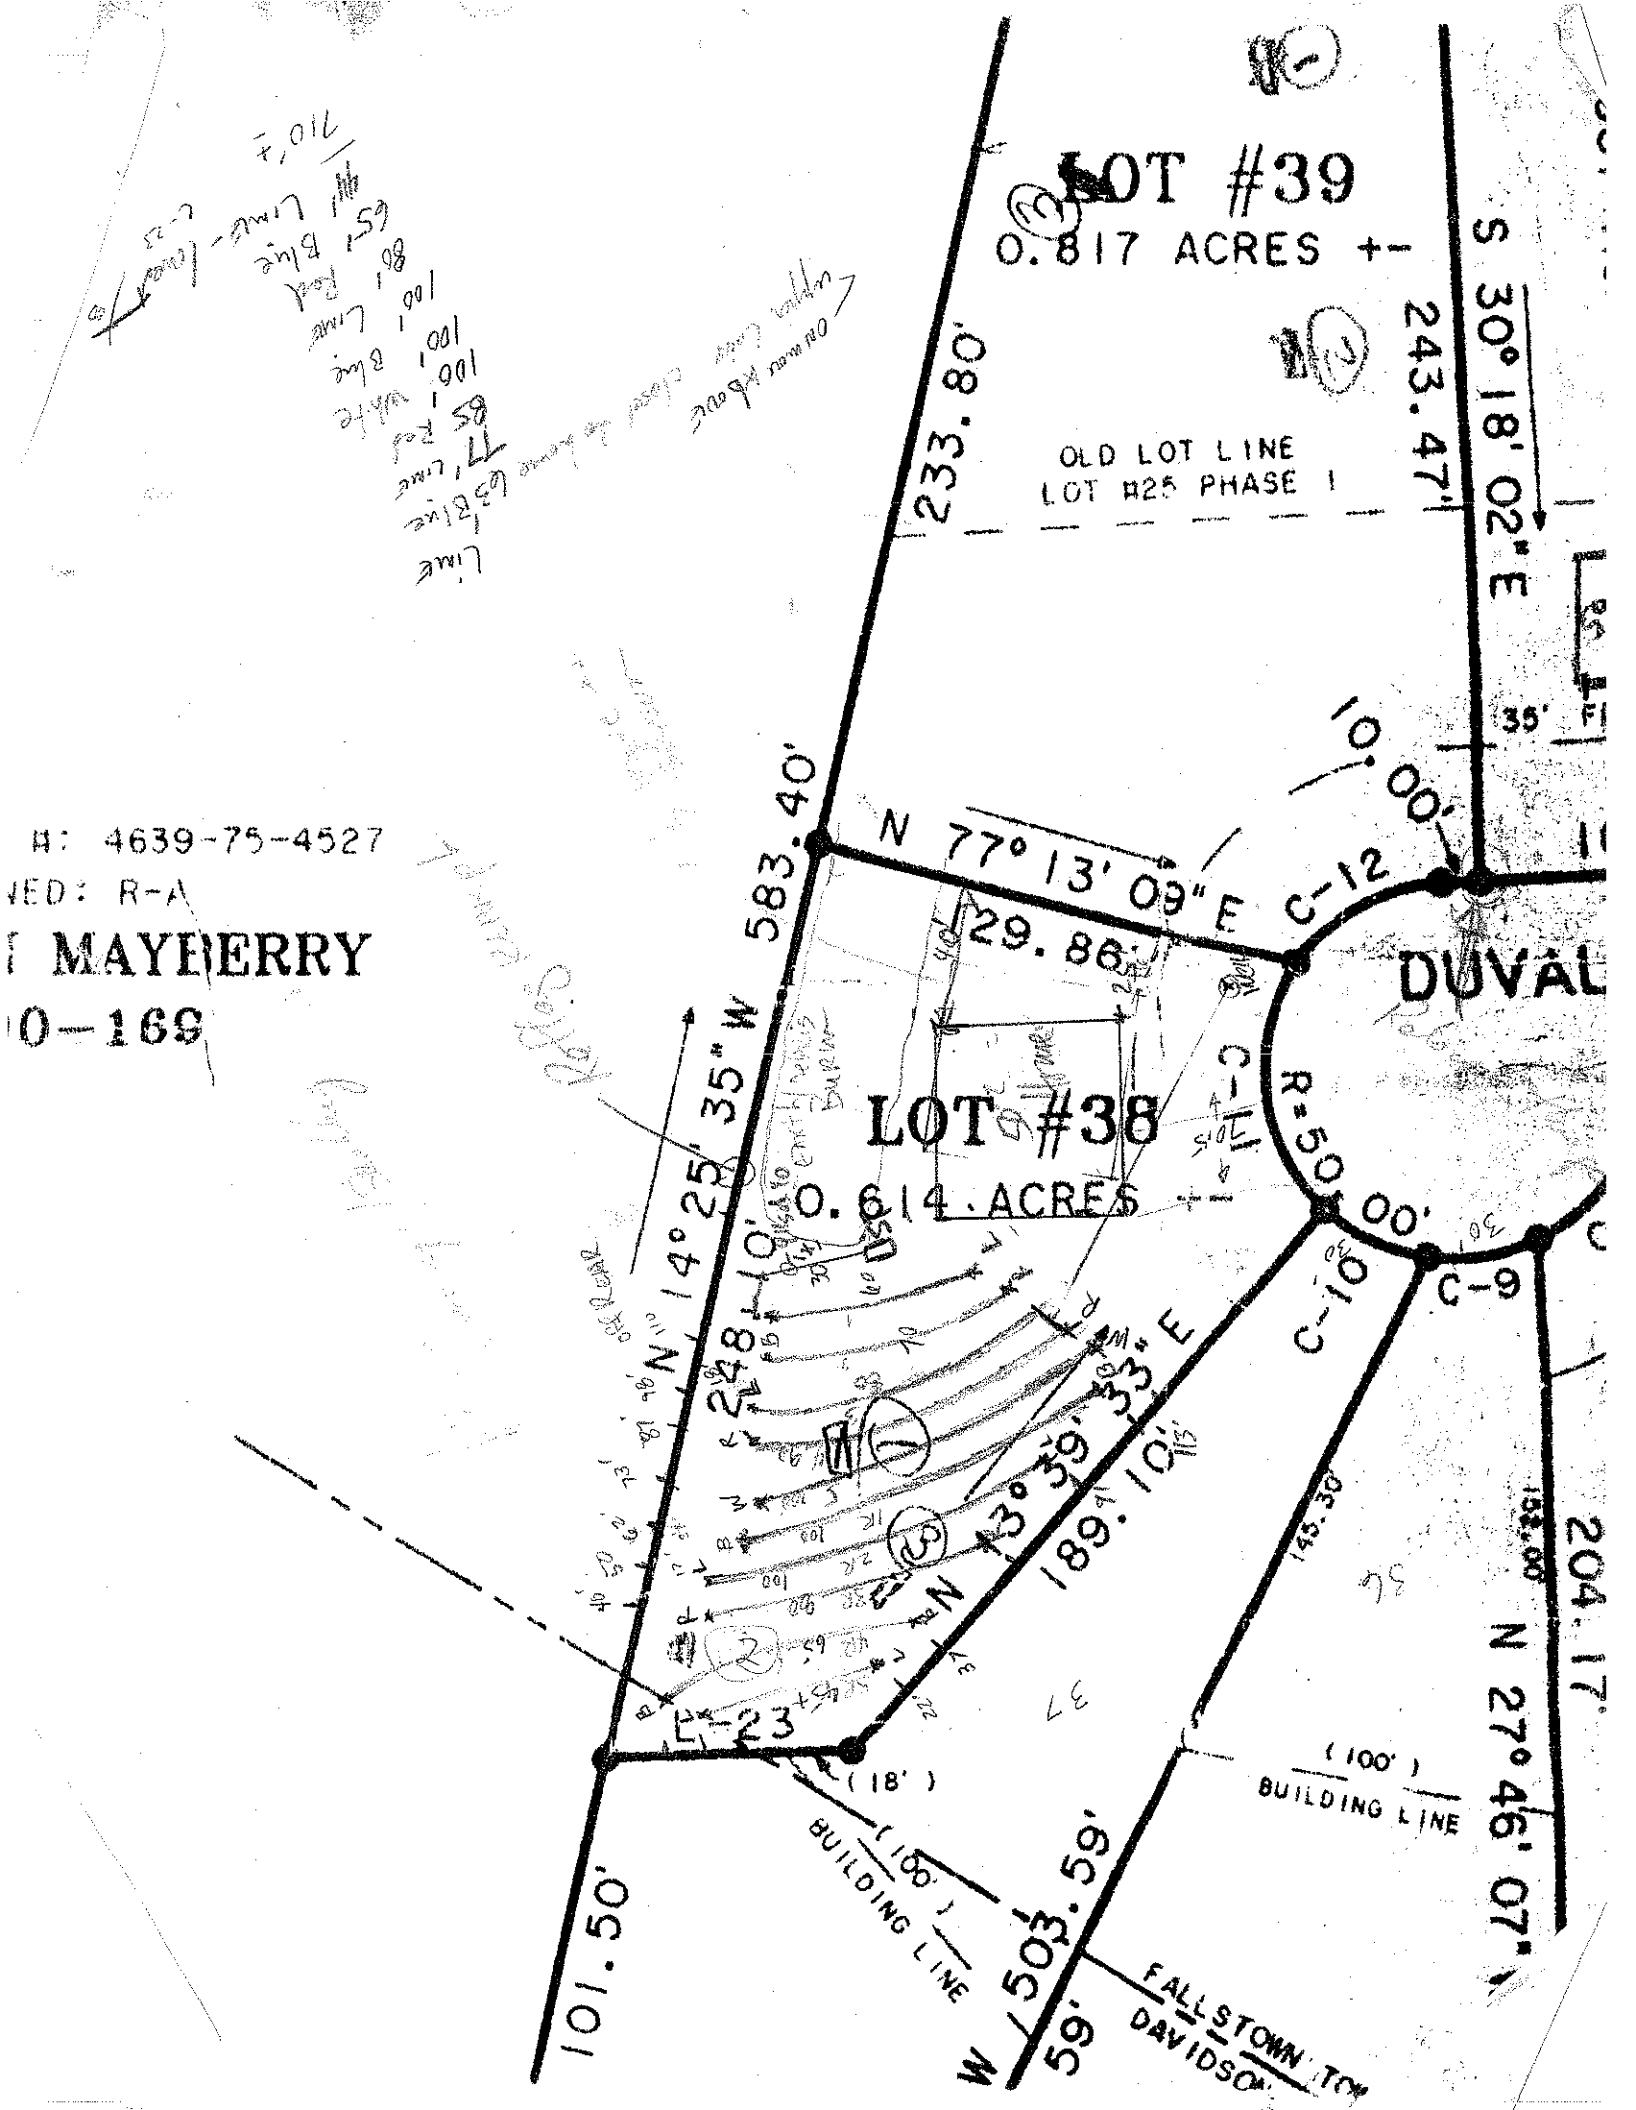
OWNER: Counthan Bldrs APPLICATION DATE ___
ADDRESS: ___ DATE EVALUATED: 12-27-02
PROPOSED FACILITY: ___ PROPOSED DESIGN FLOW (.1949): 360 gpd PROPERTY SIZE: ___
LOCATION OF SITE: lot 38 Creekwood PROPERTY RECORDED: ___
WATER SUPPLY: ☒ Private ☐ Public ☒ Well ☐ Spring ☐ Other ___
EVALUATION METHOD: ☐ Auger Boring ☒ Pit ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	SS 6%	0-32	RL ANR/sl fr:	SP	few / YB's				.25-.3
		32-50	RCL MBK fr:	SSSP					
2		0-8	WSBK BSCL	fr: SSSP	common mang @ low part				.225 @ 20" TB
		8-14	WSBK PBC	fr: SP	common YB - few				
		14-50	MBK PBC	fr: SP					
3		0-48	MF-MAB REMOULD	C FRSP		MAY NEED French Drain			.2-.25
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	PS
System Type(s)	Gravity 25% Red	Same
Site LTAR	.225-.3	.2-.25

OTHER FACTORS (.1946): PS
SITE CLASSIFICATION (.1948): PS
EVALUATED BY: DRH
OTHER(S) PRESENT: Brady Counthan

COMMENTS: Divert stormwater around system area in lieu of installing French drain


LOT #39
0.817 ACRES +-
OLD LOT LINE
LOT #25 PHASE I
S 30° 18' 02" E
243.47'
233.80'
583.40'
N 77° 13' 09" E
29.86'
C-12
10.00'
35'
DUVAL
LOT #38
0.614 ACRES +-
R=50.00'
C-9
C-10
N 14° 25' 35" W
248.10'
N 13° 39' 33" E
189.10'
204.17'
N 27° 46' 07"
145.30'
(100')
BUILDING LINE
(18')
(100')
BUILDING LINE
101.50'
503.59'
FALLSTOWN TO
DAVIDSO
MAYBERRY
0-169