N-SITE WASTEWATER SECTION

PROPERTY ID #: _____
COUNTY: Iredell

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

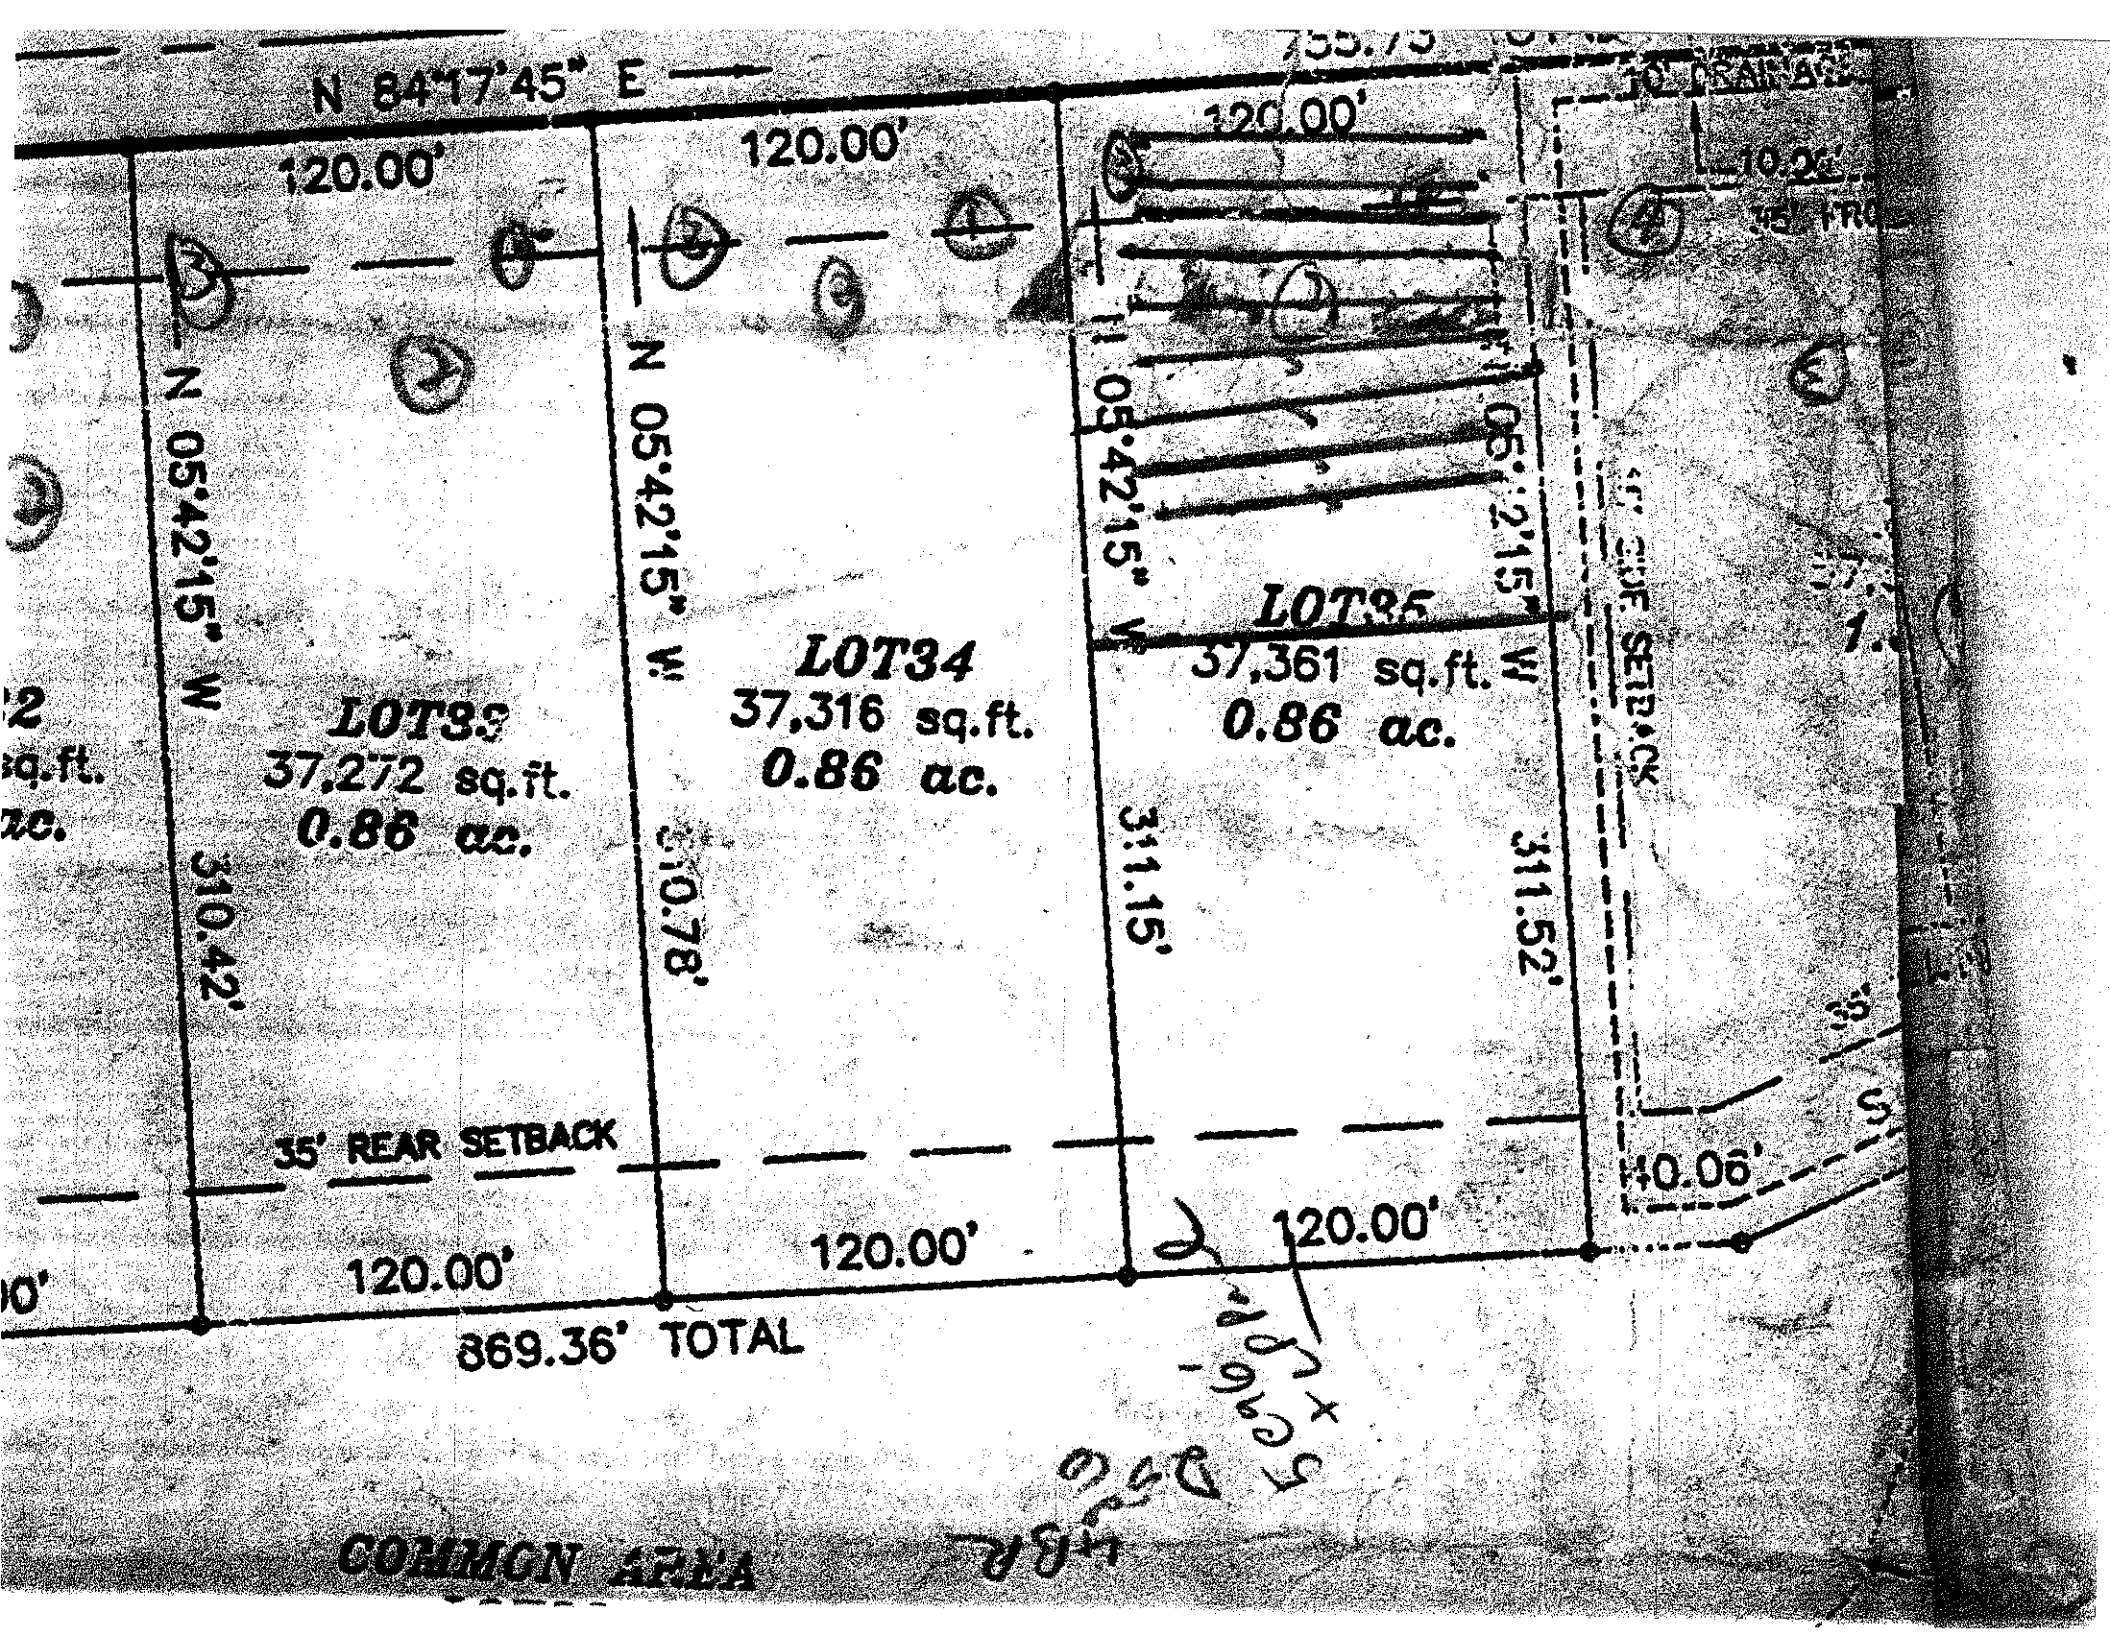
WNER: Honeysuckle Creek LLC APPLICATION DATE _____
DDRESS: _____
ROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ DATE EVALUATED: _____
OCATION OF SITE: Honeysuckle Creek Lot 55 PROPERTY SIZE: _____
ATER SUPPLY: ☒ Private ☐ Public ☒ Well ☐ Spring ☐ Other _____ PROPERTY RECORDED: _____
VALUATION METHOD: ☐ Auger Boring ☒ Pit ☐ Cut
YPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LAND-SCAPE POSITION/ SLOPE %	HORI-ZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	OTHER PROFILE FACTORS .1943 SOIL DEPTH	OTHER PROFILE FACTORS .1956 SAPRO CLASS	OTHER PROFILE FACTORS .1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	LS 10-12%	0-10 10-54	BRcL gran RCL m/sbk	fr ss/sp-fw fr ss/sp	10YR 5/4	54			I-S- .3
2		0-6 6-40 40-66	BRcL gr RC m/sbk RL sbk	fr ss/sp-fw fr ss/sp-fw	10YR 5/6 Saprolite				.25 @ < 66"
3		0-24 24-53	RC BMsbk RCL m/sbk	fr sl se-o fr sss/sp-common	5YR 5/8				.25- .3
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____
EVALUATED BY: _____
OTHER(S) PRESENT: _____

OMMENTS: _____


N 84°17'45" E
120.00'
120.00'
120.00'
N 05°42'15" W
310.42'
N 05°42'15" W
310.78'
S 05°42'15" W
311.15'
S 05°42'15" W
311.52'
LOT33
37,272 sq.ft.
0.86 ac.
LOT34
37,316 sq.ft.
0.86 ac.
LOT35
37,361 sq.ft.
0.86 ac.
35' REAR SETBACK
35' REAR SETBACK
120.00'
120.00'
120.00'
869.36' TOTAL
10.24'
10.06'
COMMON AREA