IREDELL COUNTY HEALTH DEPARTMENT

STATESVILLE 704-878-5305 M

IMPROVEMENT PERMIT / AUTHORIZATION TO CONSTRUCT / OPERATION PERMIT / E

Any part of supply line closer than 50' to well must be ductile iron sleeved

PERMIT# 143944 PIN# 4644388375.000

OWNER OR APPLICANT James & Julia Perryman PHONE: Business 704 892-4730

ADDRESS 135 Royal Pointe Way Mooresville NC 28117

LOCATION 215 T'L Alcove Rd. becomes Mecklynn Rd. At dead end TR into Westview TR Sea Hide St. 11 < sea Hide

SUBDIVISION Westview BLOCK / SECTION LOT 16 LOT AREA .995 SITE CLASS. PS DESIGN FLOW 600 gpd L.T.A.R. .3

Septic Tank: 1500 Gallons: STB 335 Date 5-20-08
Pump Tank: 1500 Gallons: PT 477 Date 6-9-08
Pump Make: MEYERS Model ME Serial No.
Nitrification Field: No. Fields 1 Square Feet 1500 Linear Feet 500'
No Lines 10@50' Trench Width 36" Max Trench Bottom Depth 36" Gravel Depth N/A ☐ Gravity ☑ Pressure

☑ New System ☐ Repair ☐ Expansion System Type: I II III IV V VI
System Description: Pump PM 25% Reduction
Repair System Description: Same.
Maintenance Agreement Required: ☐ Yes ☑ No

☑ House/Mod. Home No. Bedrooms 5
☐ Mobile Home No. Persons
☐ Business No. Employees
☐ Other
☐ Slab ☑ Crawl Space ☐ Basement w/in ent wo/plumbing

Water Supply: ☑ Individual ☐ Public ☐ Community

Comments:/Conditions: Pressure Manifold needs (10) 1/2 inch sch 40 taps 1/30/09 Check out tanks & ductile iron pipe


Comments:/Conditions: Tank location - neighboring lot

	Date	Initials
Drain Lines Checked	2/11/09	MD
Tanks Checked	1/30/09	MD
Pressure Manifold or Valve Box Checked	3/31/09	MD
Pressure Head Set		
Electrical Checked		
Floats Set	3/31/09	MD
Alarm Checked		
Maintenance Contract Y / N		

Sea Hide Dr.

Scale 1" = 40'

INITIAL SITE SKETCH

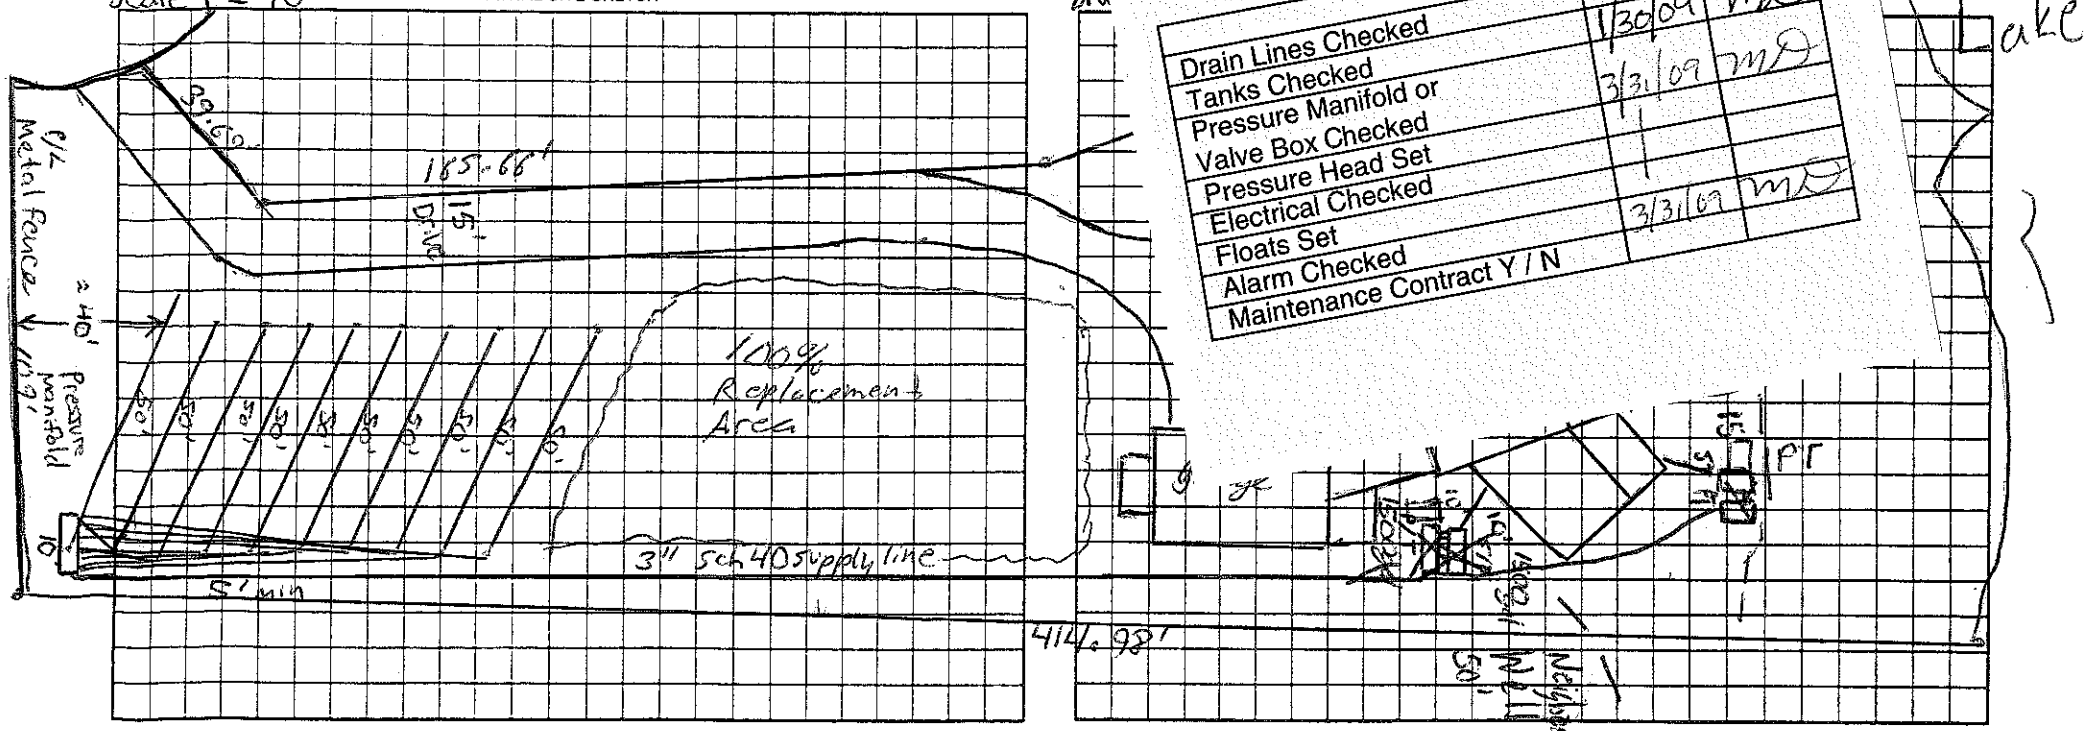

Permit can be suspended or revoked if any false information is supplied toward securing the permit/any unauthorized changes are made to the site/any unauthorized changes are made in the installation of the system. Improvement Permit with plat valid without expiration ☐ Improvement Permit with site plan valid for sixty months ☑ Authorization to Construct is valid for a period equal to that of Improvement Permit – not to exceed sixty months.

Signed: Ben Perryman date 9/13/07
Improvement Permit by: Anthony Coker Jr. date 9/13/07
Authorization to Construct by: Anthony Coker Jr. date 9/13/07

Installed by: K & H date
Operation Permit by: Marvin Hall Coker date 3/31/09
Existing System Inspection by: date

HEALTH DEPT. COPY: WHITE OWNER COPY (FINAL): YELLOW OWNER COPY (INITIAL): PINK