IREDELL COUNTY HEALTH DEPARTMENT

Statesville Office (704) 878-5305 Mooresville Office (704) 660-3625 PERMIT # 216486

IMPROVEMENT PERMIT / AUTHORIZATION TO CONSTRUCT / OPERATION PERMIT / EXISTING SYSTEM

PIN # 4645-18-8189

APPLICANT: MATT MCMULLEN APPLICANT ADDRESS: 555 DELBURG ST. DAVIDSON

SITE ADDRESS: 159 HENRY LN. - MOORESVILLE PHONE: 704-578-4951 ALT. PHONE:

SITE DIRECTIONS: ALCOVE, TR TEMPLETON, TR HENRY, 1ST ON R

SUBDIVISION: GRIMES PROPERTY SECTION: LOT # 1 LOT AREA: .71 AC DESIGN FLOW: 480 L.T.A.R.: .3

Septic Tank 1000 (gal) STB 794 Date 3-18-16

Pump Tank 1000 (gal) PT 283 Date 5-16-16

Pump Make LIBERTY Model 290 Serial #

Nitrification Fields 1 # Lines 6 Linear Ft: 400'

Trench Width 36" Max. Trench Bottom Depth 34" Gravel Depth —

☒ New System ☐ Repair ☐ Expansion System Type: I II (III)B IV V VI

System Description: PM - 25% REDUCTION

Repair System Description: PANEL BLOCK

Maintenance Agreement Required: ☐ YES ☒ NO

☐ GRAVITY ☒ PRESSURE

☒ Residence ☐ Business ☐ Other ☐ Slab ☐ Basement w/plumbing

No. Bedrooms 4 No. Persons No. Employees ☒ Crawl Space

Water Supply: ☒ Private ☐ Public ☐ Community

☐ Basement w/o plumbing

Comments / Conditions:

INITIAL SITE SKETCH

SEE PLAN FROM THE OAKS GROUP

	Date	Initials
Drain Lines Checked	6/21	AWS
Tanks Checked	6/21	AWS
Pressure Manifold or Valve Box Checked	6/21	AWS
Pressure Head Set	6/21	AWS
Electrical Checked	8/12	SZ
Floats Set	8/12	SZ
Alarm Checked	8/12	SZ
Maintenance Contract Y (N)		
Comments:		

8-11-16: Couldn't inspect (no power)
8-12-16: 7" Tee Hier - Alarm functional - Breakers ok Cabinet inside garage + pump power outside

Permit can be suspended or revoked if any false information is supplied toward securing the permit / any unauthorized changes are made to the site / any unauthorized changes are made in the installation of the system. **CONTACT A LOCATOR SERVICE PRIOR TO ANY EXCAVATION**

☐ **IMPROVEMENT PERMIT** *with plat valid without expiration.* ☐ **IMPROVEMENT PERMIT** *with site plan valid for 60 mos.* ☒ **AUTHORIZATION TO CONSTRUCT** *valid for period equal to IMPROVEMENT PERMIT--not to exceed 60 mo.*

Owner / Applicant Signature: Kathleen Saunders Date: 2-15-16

IMPROVEMENT PERMIT by: APPROVED FEB 11 2016 Date:

AUTHORIZATION TO CONSTRUCT by: APPROVED FEB 11 2016 Date:

Installed by: Wilkie Christenbury


OPERATION PERMIT by: Date: 8-12-16

Existing System Inspected by: Date:

Health Dept. Copy - WHITE Applicant (Final Approval) - YELLOW Applicant (Conditional Approval) - PINK

Henry Lane

APPROVED FEB 15 2016

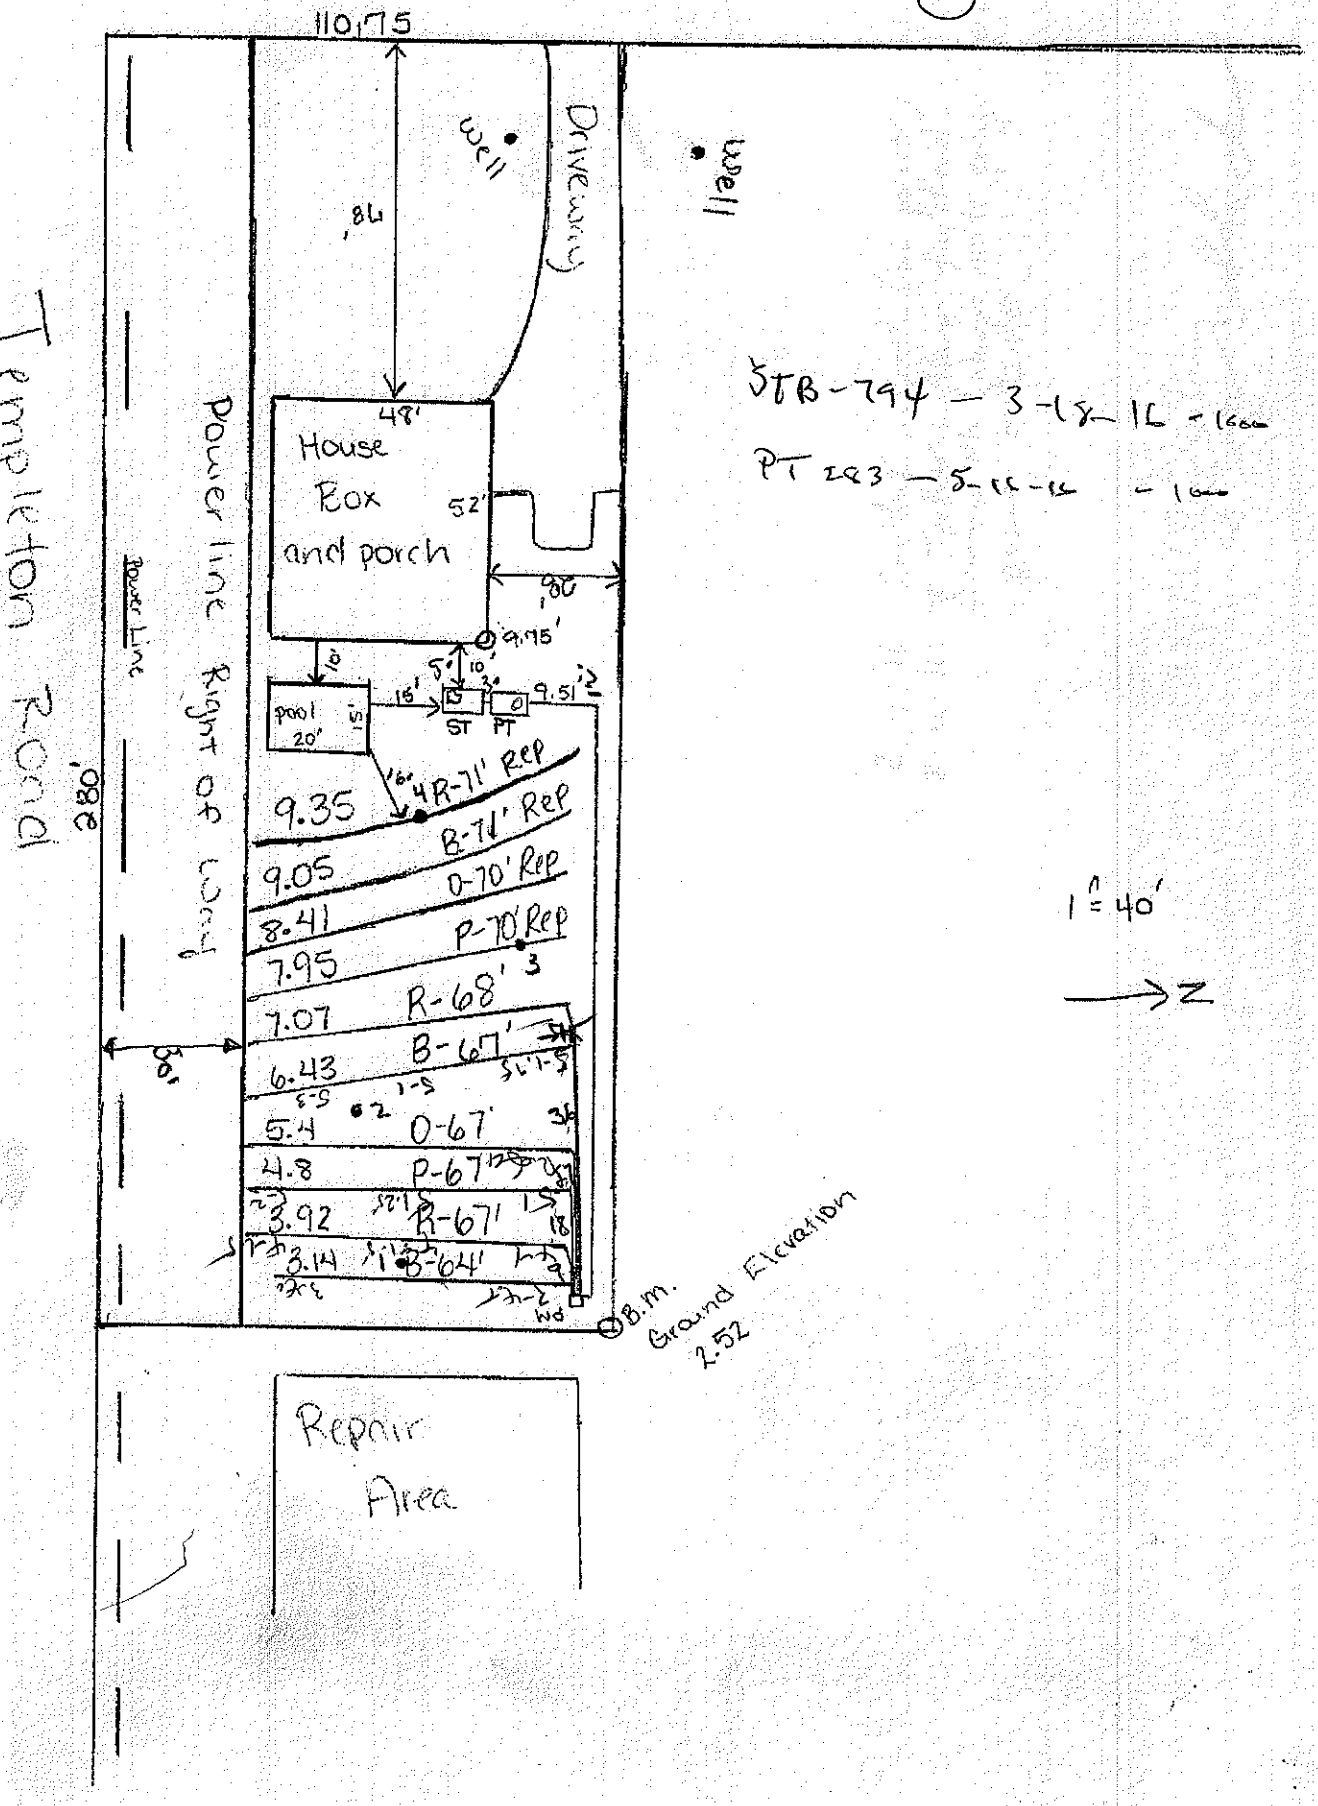

STB-794 – 3-18-16 – 16m

PT 293 – 5-11-16 – 16m