07049

IREDELL COUNTY HEALTH DEPARTMENT

4645-35-2302

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Herbert Todd DATE 7-13-87 PERMIT NO.

PHONE: Business Home

LOCATION 1108 Rt 1st entrance into Queen's Cove Bear Rt. near water 1st house on Rt.

SUBDIVISION NAME Queens Cove LOT NO. 29 SECTION OR BLOCK NO. S. R. No.

House (✓) Mobile Home ( ) Business ( ) Other Pool Addition


No. Bedrooms 3 No. Bathrooms 3

Garbage Disposal Unit	Yes (✓)	No ( )
Auto. Dishwasher	Yes (✓)	No ( )
Auto. Wash. Machine	Yes (✓)	No ( )
Site Suitable	Yes (✓)	No ( )

Lot Area 2.3 Ac Owell

Character & Porosity of Soil clay
Percolation Rate 2.4
Topography 4-6%
Depth to Water Table 4ft
Rock or other impervious formations none obs.

_____ Basement with Plumbing ✓ Basement without Plumbing _____ No Basement

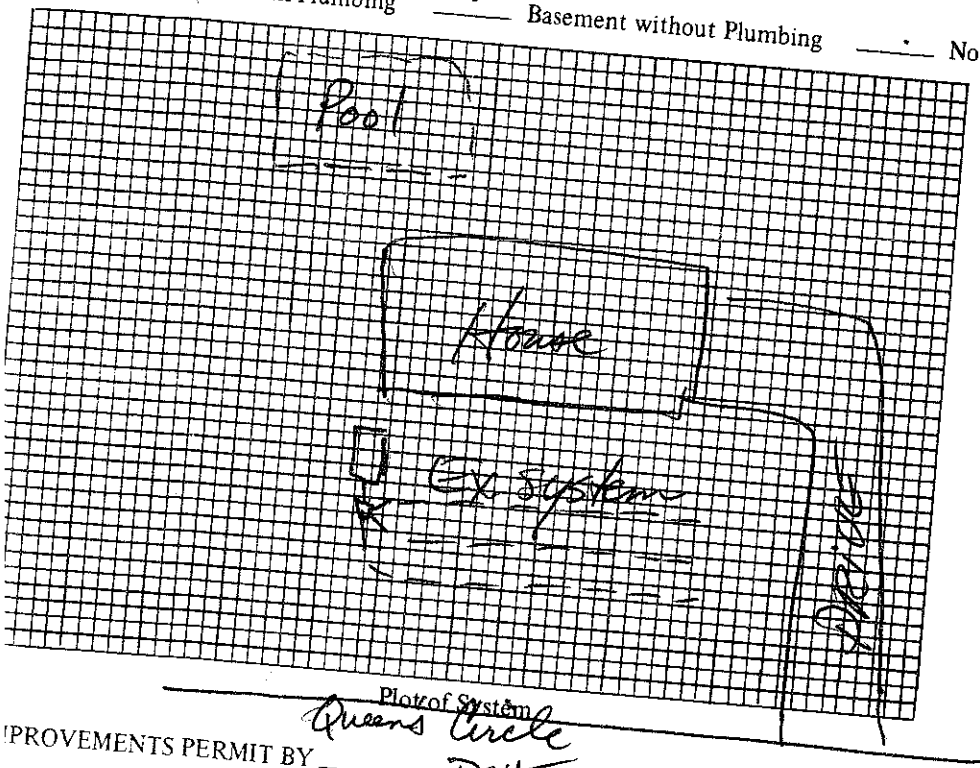

Plot of System

Size of Tank 1250 Gals.
Nitrification Field:
No. of Lines 3
Sq. Ft. 900 Linear Ft. 300
Depth of Stone in Lines 12"
Water Supply: Individual (✓)
Public ( )

Installed by Orbison

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IPROVEMENTS PERMIT BY DRK

MMENTS: Existing system OK at time of inspection.

TIFICATE OF COMPLETION BY _____

STING SYSTEM CHECKED BY: D. R. Johnson R.S. DATE _____

CONSTRUCTION MUST COMPLY WITH ALL C... STATE AND LOCAL REGULATIONS. DATE 7-13-87

it is VOID if any unauthorized changes are made in installa... The proposed / existing BUILDING addition does not appear to impact the existing septic system.

ovements Permit.

**NOTE: _____

Health Dept. Copy: White Inspection Dept. Co:

Date: 7-16-08 R.S.

ICHD-Environmental Health Division

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Herbert Todd

PHONE: Business _____ Home _____ DATE 6-9-87 PERMIT NO. _____

LOCATION 1108 T.L. first entrance Queens Cove. bear right at water. 200ft on right

SUBDIVISION NAME Queens Cove LOT NO. 29 SECTION OR BLOCK NO. 1 S. R. No. _____

House (✓) Mobile Home ( ) Business ( ) Other _____

No. Bedrooms 3 No. Bathrooms 3

Garbage Disposal Unit	Yes (✓)	No ( )
Auto. Dishwasher	Yes (✓)	No ( )
Auto. Wash. Machine	Yes (✓)	No ( )
Site Suitable	Yes (✓)	No ( )

Lot Area ~3 Acre

Character & Porosity of Soil Clay


Percolation Rate .4

Topography 4-6%

Depth to Water Table 4'+

Rock or other impervious formations none observed

_____ Basement with Plumbing ✓ Basement without Plumbing _____ No Basement

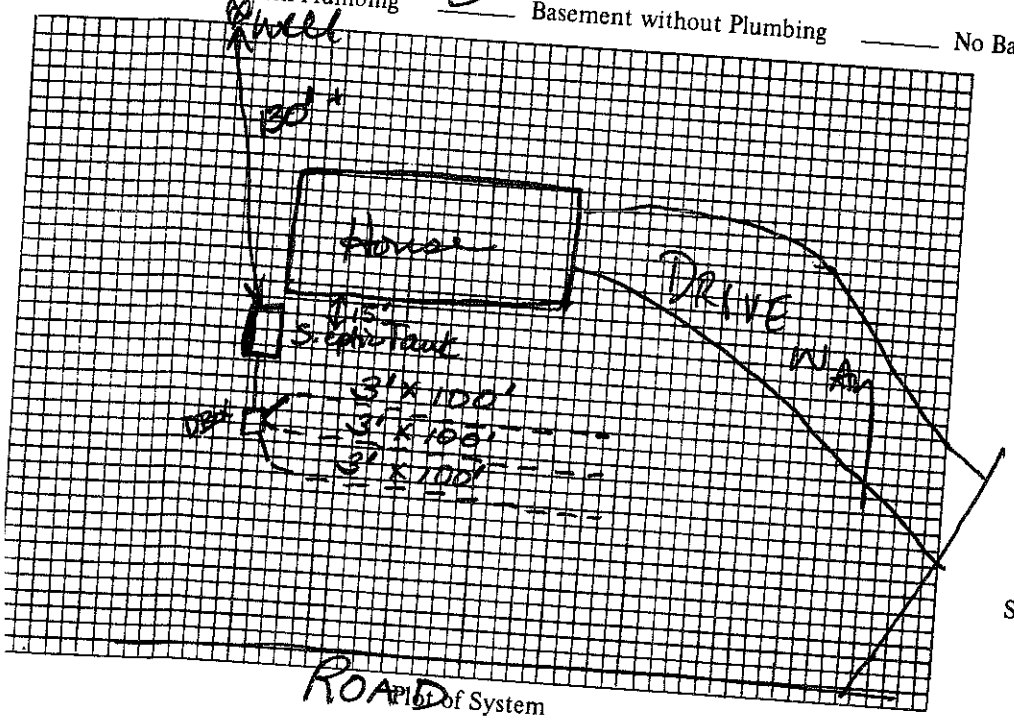

Plot of System

Size of Tank [redacted] 1250 Gals.

Nitrification Field:

No. of Lines 3

Sq. Ft. 900 Linear Ft. 300

Depth of Stone in Lines 12"

Water Supply: Individual (✓)

Public ( )

Installed by Wayne Dickerson

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY D.R.H.

COMMENTS: _____

CERTIFICATE OF COMPLETION BY Andrew C Pierce, D. R. Hinson, R.S. DATE 6-9-87

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold