IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

4645-23-6809 (struck through)
4645-39-9623

OWNER OR CONTRACTOR George Dowdy DATE 5-13-86 PERMIT NO. 271

PHONE: Business ______ Home ______

LOCATION 1109 Lt on Alcove Rt on Templeton Rt across from Queens Cove Entrance into Quail Run lotatend on left

SUBDIVISION NAME ~~Quail Run~~ Quail Ridge S. R. No. ______

LOT NO. 8 SECTION OR BLOCK NO. [illegible]


House (✓) Mobile Home ( ) Business ( ) Other ______

No. Bedrooms 3 No. Bathrooms 3

Garbage Disposal Unit	Yes (✓)	No ( )	Character & Porosity of Soil: Clay loam
Auto. Dishwasher	Yes (✓)	No ( )	Percolation Rate: 0.5 gal/ft²/day
Auto. Wash. Machine	Yes (✓)	No ( )	Topography: 4-10%
Site Suitable	Yes (✓)	No ( )	Depth to Water Table: 44

Lot Area ½ acre

Rock or other impervious formations None obs

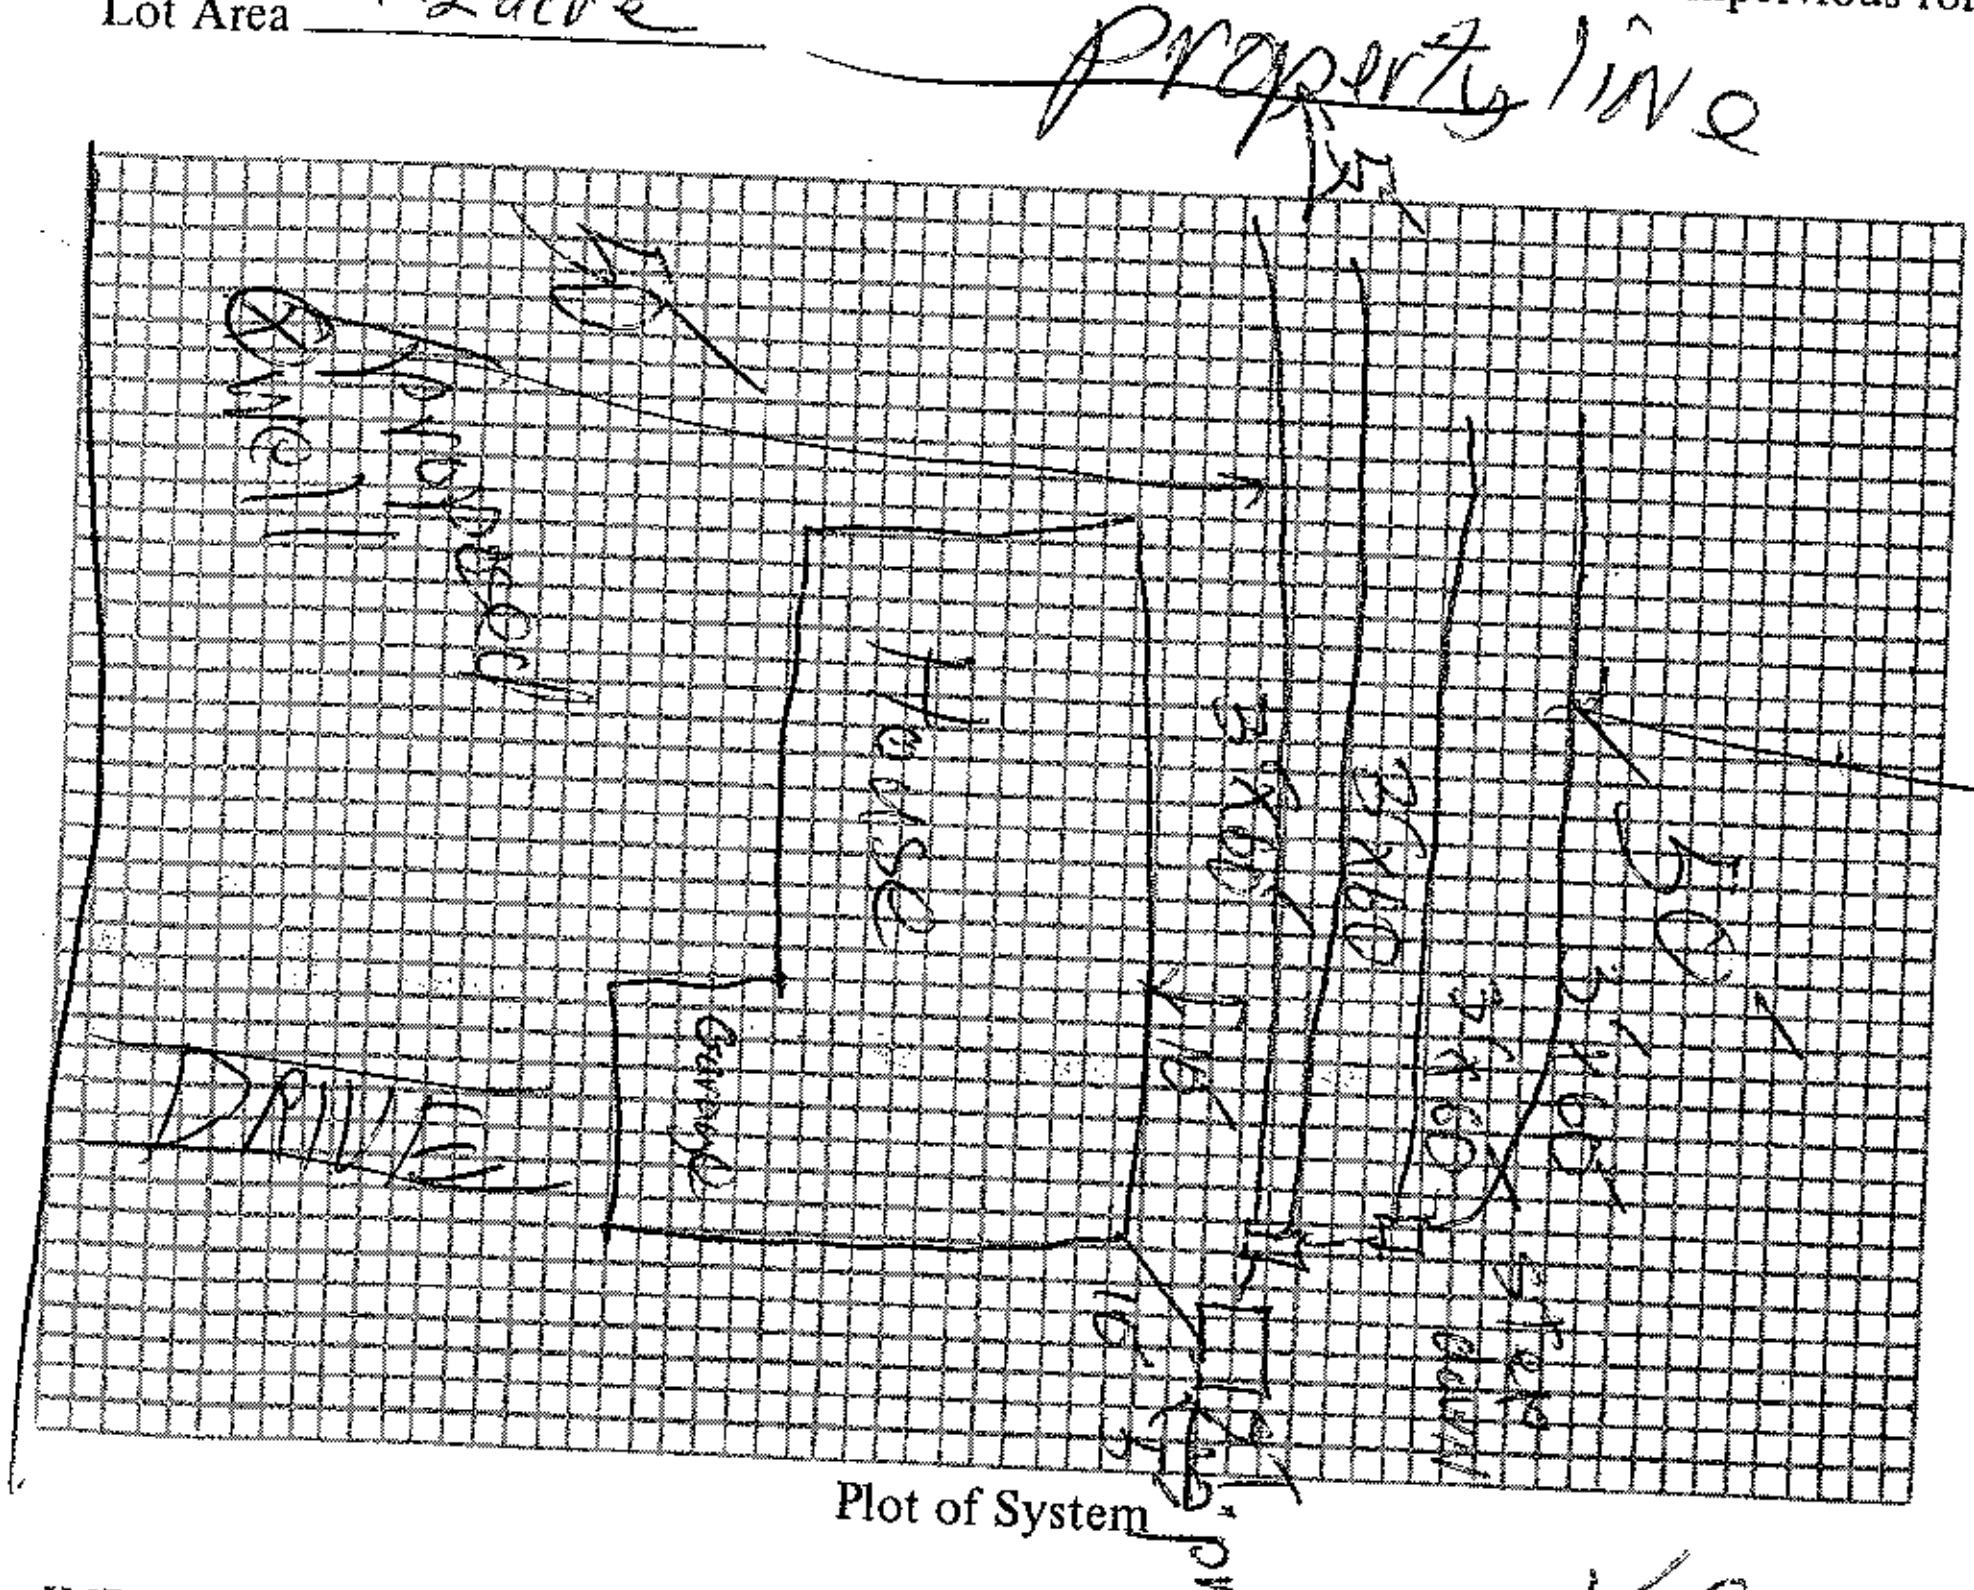

Plot of System

Size of Tank 1300 Gals.

Nitrification Field:

No. of Lines 4

Sq. Ft. 720 Linear Ft. 240

Depth of Stone in Lines 12"

Water Supply: Individual (✓)
Public ( )

Installed by Little Hawkins

IMPROVEMENTS PERMIT BY KS

COMMENTS: well not down yet need to be 50 from tank & lines

CERTIFICATE OF COMPLETION BY Charles K. Barnett DATE 5-13-86

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold