for ON-SITE WASTEWATER SYSTEM

..ER: _____ APPLICANT: _____

DRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: _____

OPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____

CATION OF SITE: Lot 6 Templeton Towne PROPERTY RECORDED: _____

..TER SUPPLY: ☐ Private ☐ Public / ☐ Well ☐ Spring ☐ Other _____

ALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut

PE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

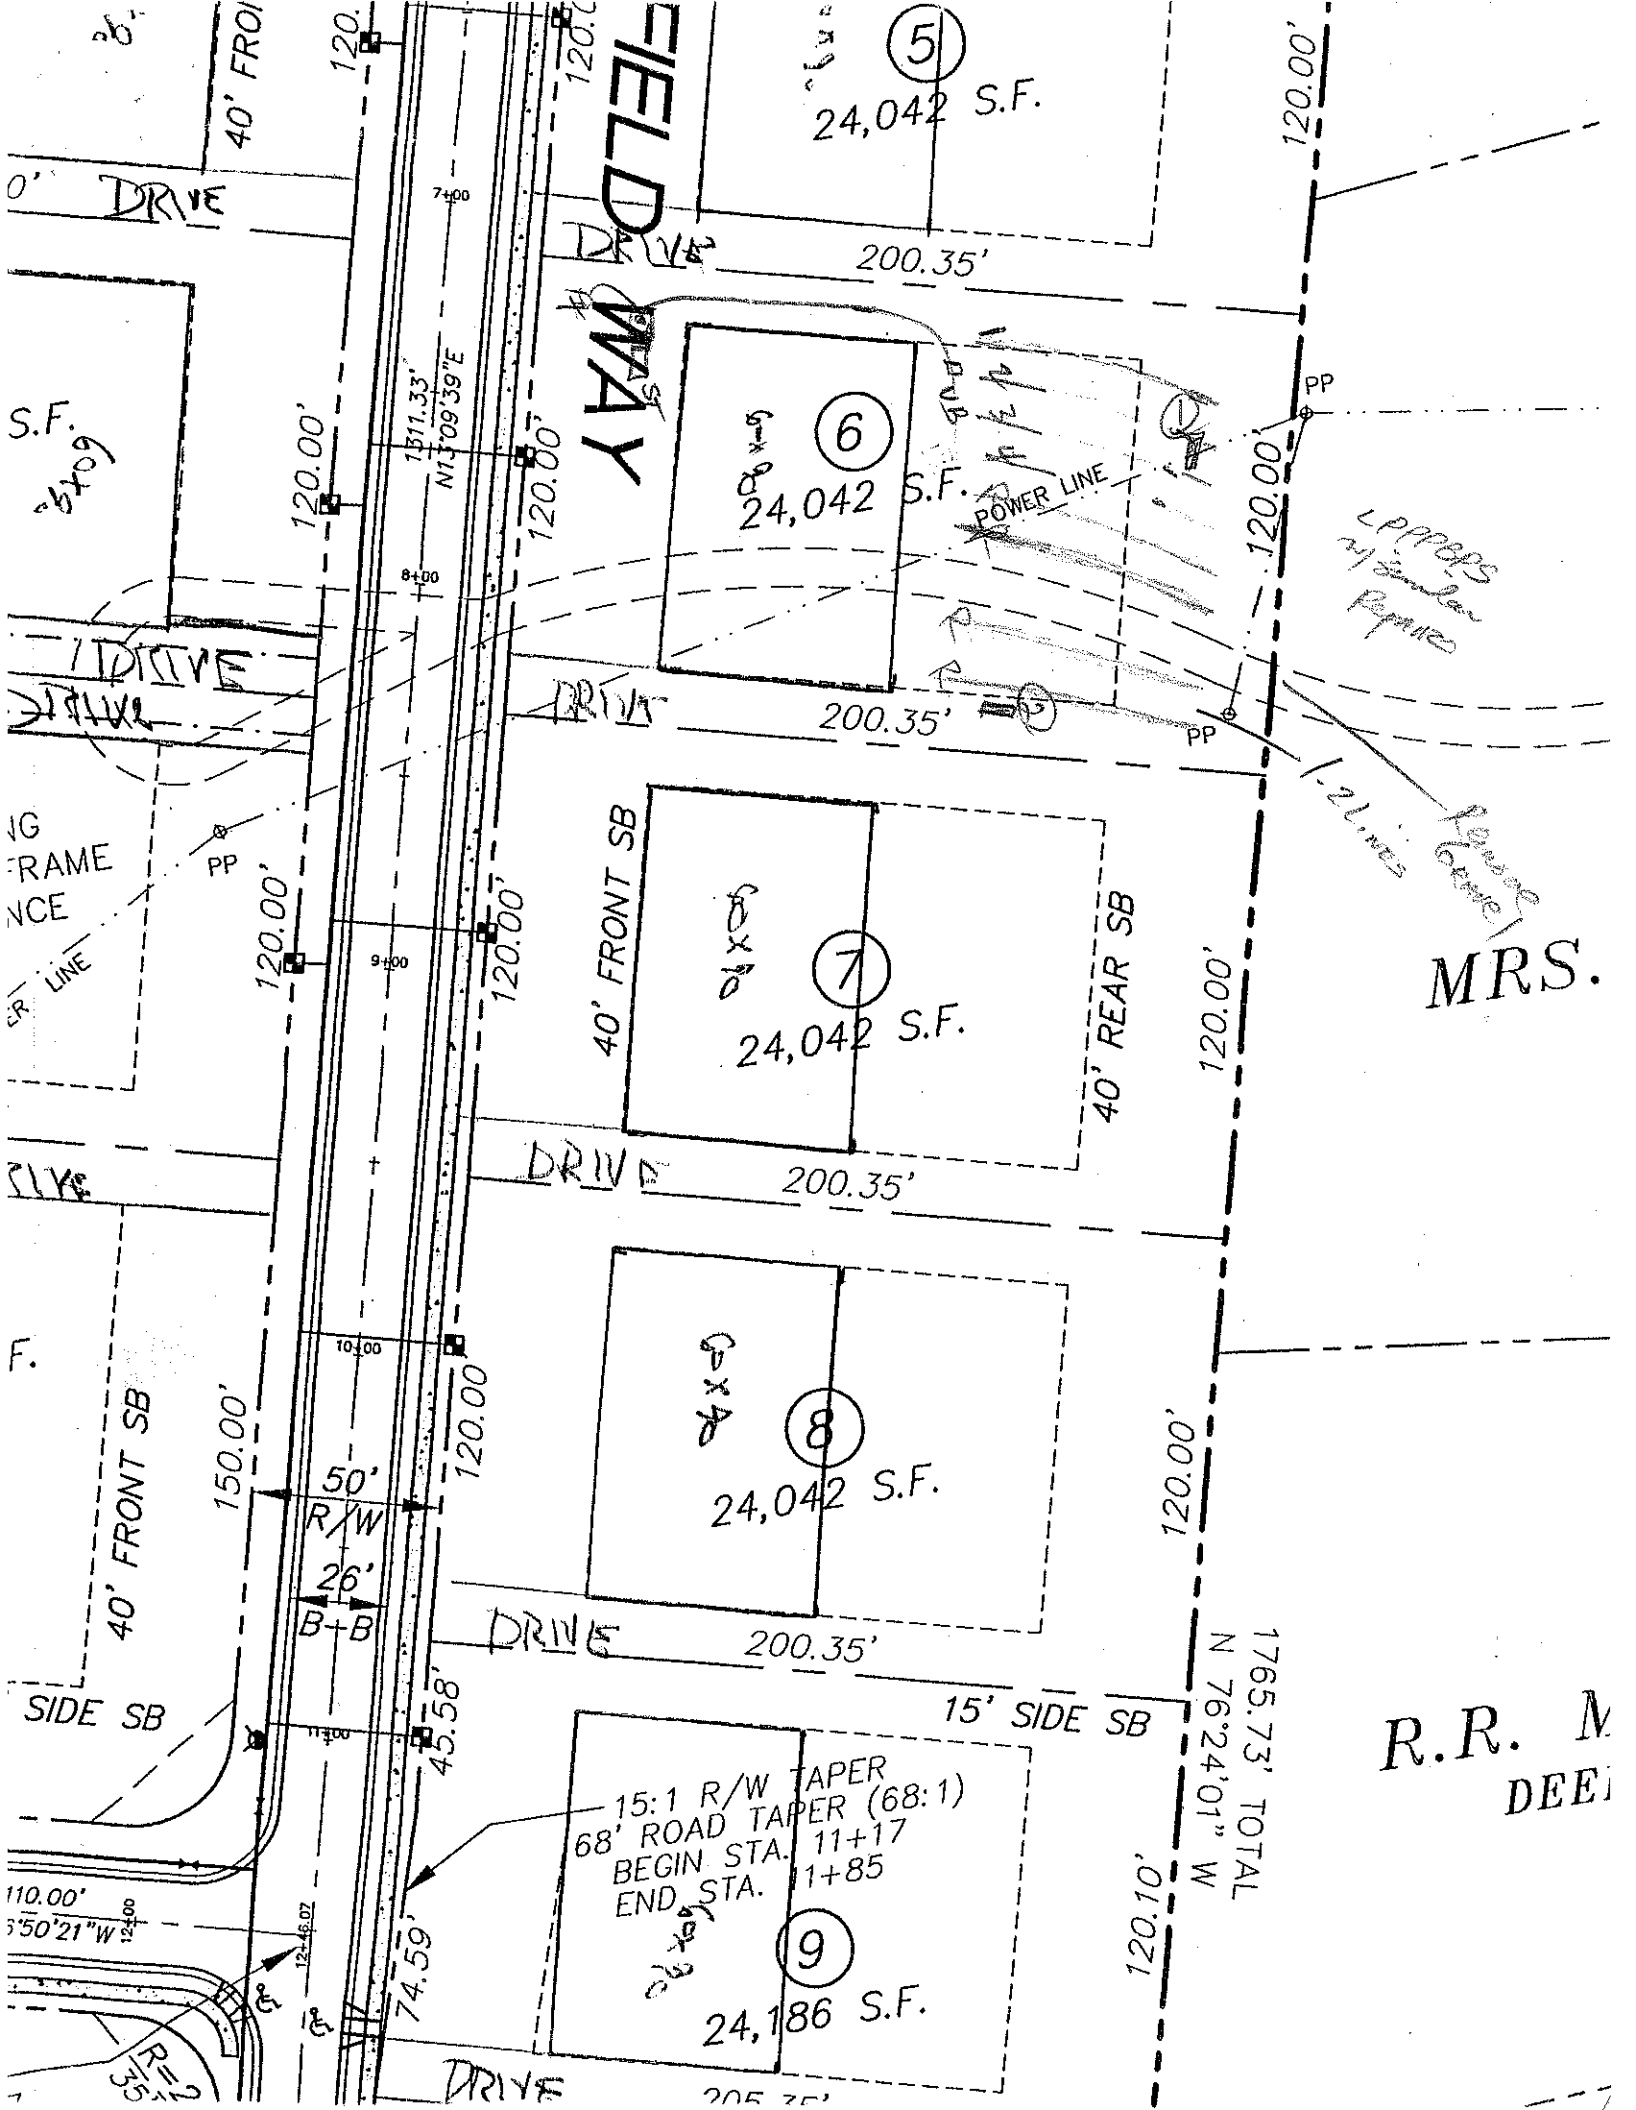
.1940 LAND-SCAPE POSITION/ SLOPE %	HORI-ZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
①	0-5	wkSnb bnwsdl	fr ssp					.3
	5-28	mb/sbp RC	fi sp					
	28-52	wkfSnb yrcl	common mi sap fssp sep					
②	0-6	wkSnb bnwsdl	fssssp					.3
	6-24	SNb/HRB RCdl	fi sp-ssssp sep					
	24-39	m-wkSnb RCdl	bnwmi sap fssssp					
	39-52	wkfSnb L smp	fssp					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
ilable Space (.1945)		

OTHER FACTORS (.1946): _____

SITE CLASSIFICATION (.1948): _____

EVALUATED BY: _____


5
24,042 S.F.
6
24,042 S.F.
7
24,042 S.F.
8
24,042 S.F.
9
24,186 S.F.
DRIVE
200.35'
120.00'
40' FRONT SB
40' REAR SB
15' SIDE SB
150.00'
50' R/W
26' B+B
45.58'
74.59'
15:1 R/W TAPER
68' ROAD TAPER (68:1)
BEGIN STA. 11+17
END STA. 11+85
POWER LINE
PP
MRS.
R.R.
1765.73' TOTAL
N 79°24'01" W
120.10'