for ON-SITE WASTEWATER SYSTEM

OWNER: _____ APPLICANT: _____

ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: 7-26-01

PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____

LOCATION OF SITE: lot 14 Templeton Farms PROPERTY RECORDED: _____

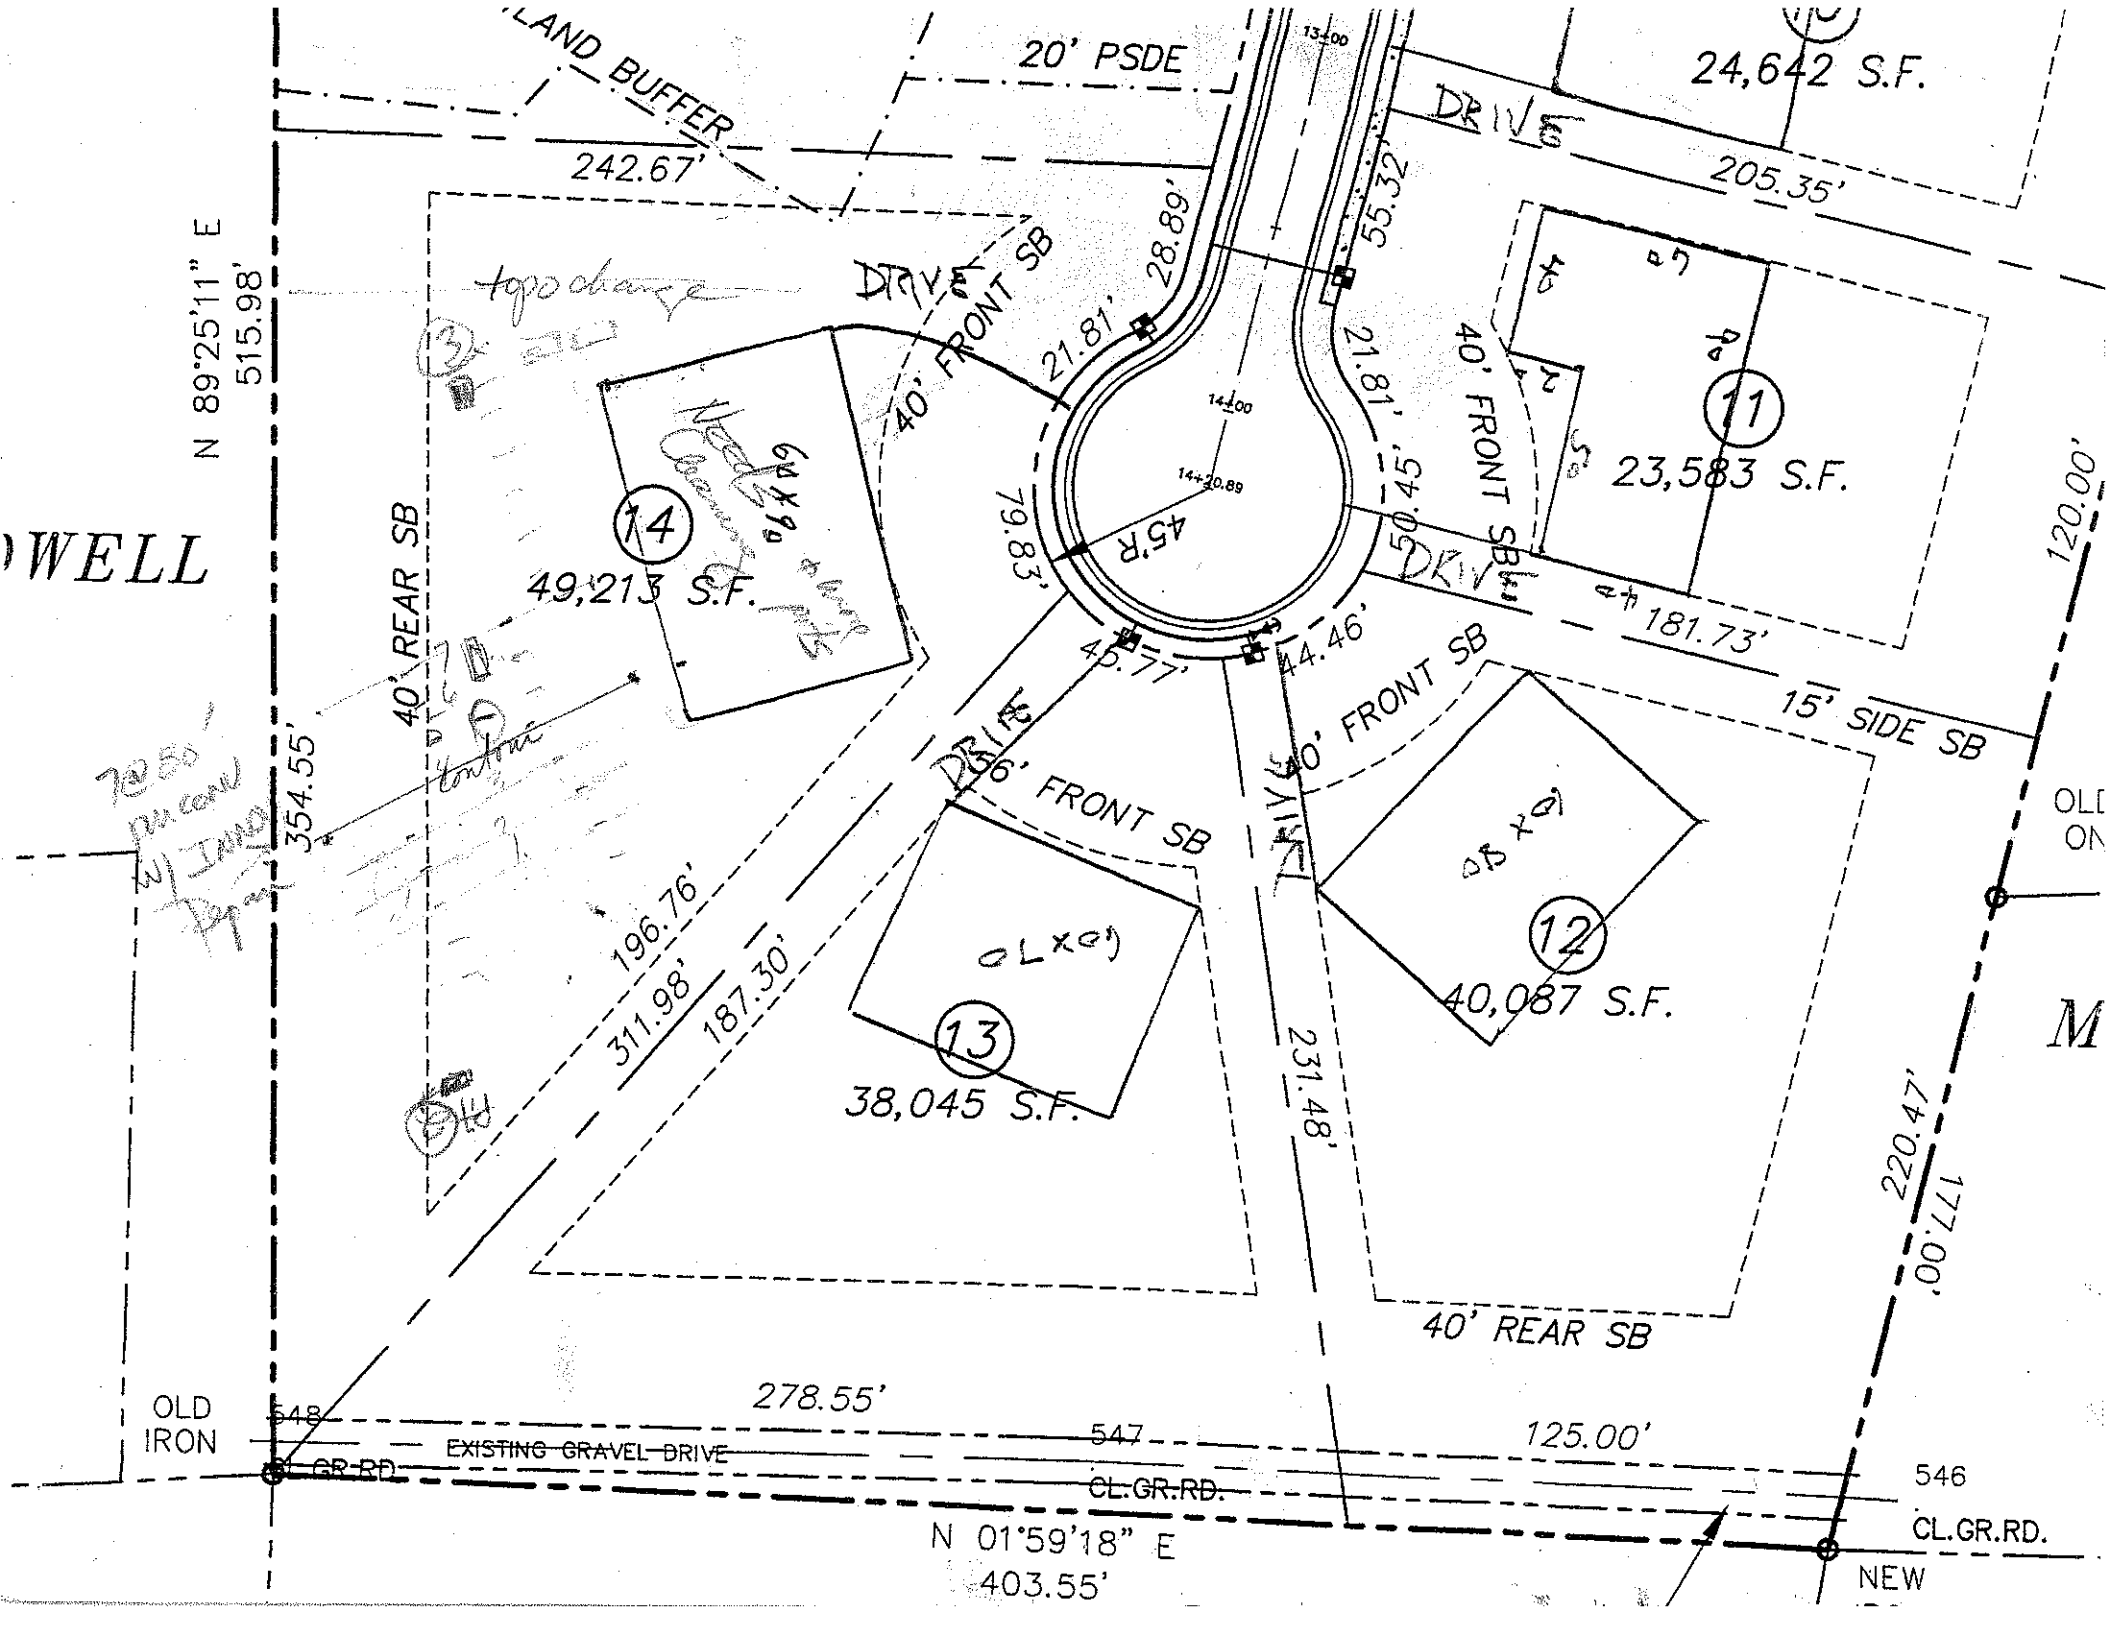
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____

EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut

TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
Pit ①	0-12	gr wksbk brn sl cl fr ss sp						3
	12-38	sbk rc cl fr ss sp						
	38-50	wk sbk (rc) lt yel brn common mi ss sp fr ss sp						
P-1 ②	0-48	wk sbk gr sl	fr ss sp few rang cnc.					3
③	0-6	wk sbk brn sl cl fr						3
	6-17	sbk brn rc fr ss sp						
	17-49	wk sbk yel br fr ss sp						

Suitable Space (.1945)


LAND BUFFER
242.67'
20' PSDE
24,642 S.F.
DRIVE
205.35'
N 89°25'11" E
515.98'
40' FRONT SB
21.81'
28.89'
55.32'
21.81'
40' FRONT SB
11
23,583 S.F.
120.00'
14
49,213 S.F.
40' REAR SB
354.55'
79.83'
45.77'
44.46'
50.45'
181.73'
15' SIDE SB
DRIVE
56' FRONT SB
40' FRONT SB
196.76'
311.98'
187.30'
13
38,045 S.F.
12
40,087 S.F.
231.48'
220.47'
177.00'
40' REAR SB
OLD IRON
278.55'
EXISTING GRAVEL DRIVE
CL.GR.RD.
125.00'
CL.GR.RD.
N 01°59'18" E
403.55'
NEW