4645563141

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Joseph Cudy DATE 7-21-80 PERMIT NO. 218

PHONE: Business ______ Home ______

LOCATION 215 X I-77 TL 1206 ~1 Mile TR into Perry Waters property

SUBDIVISION NAME Water's Cly ______ S. R. No. ______

LOT NO. 7A SECTION OR BLOCK NO. ______

House ( ) Mobile Home ( ) Business ( ) Other ______

No. Bedrooms 3 No. Bathrooms 2

Garbage Disposal Unit Yes ( ) No (X)

Auto. Dishwasher Yes (X) No ( )

Auto. Wash. Machine Yes (X) No ( )

Site Suitable Yes (X) No ( )

Lot Area ~1 Acre

Character & Porosity of Soil Clay loam


Percolation Rate 80 mpi ~120 mpi

Topography 6%

Depth to Water Table 3'+

Rock or other impervious formations None observed

___ Basement with Plumbing ___ Basement without Plumbing X No Basement

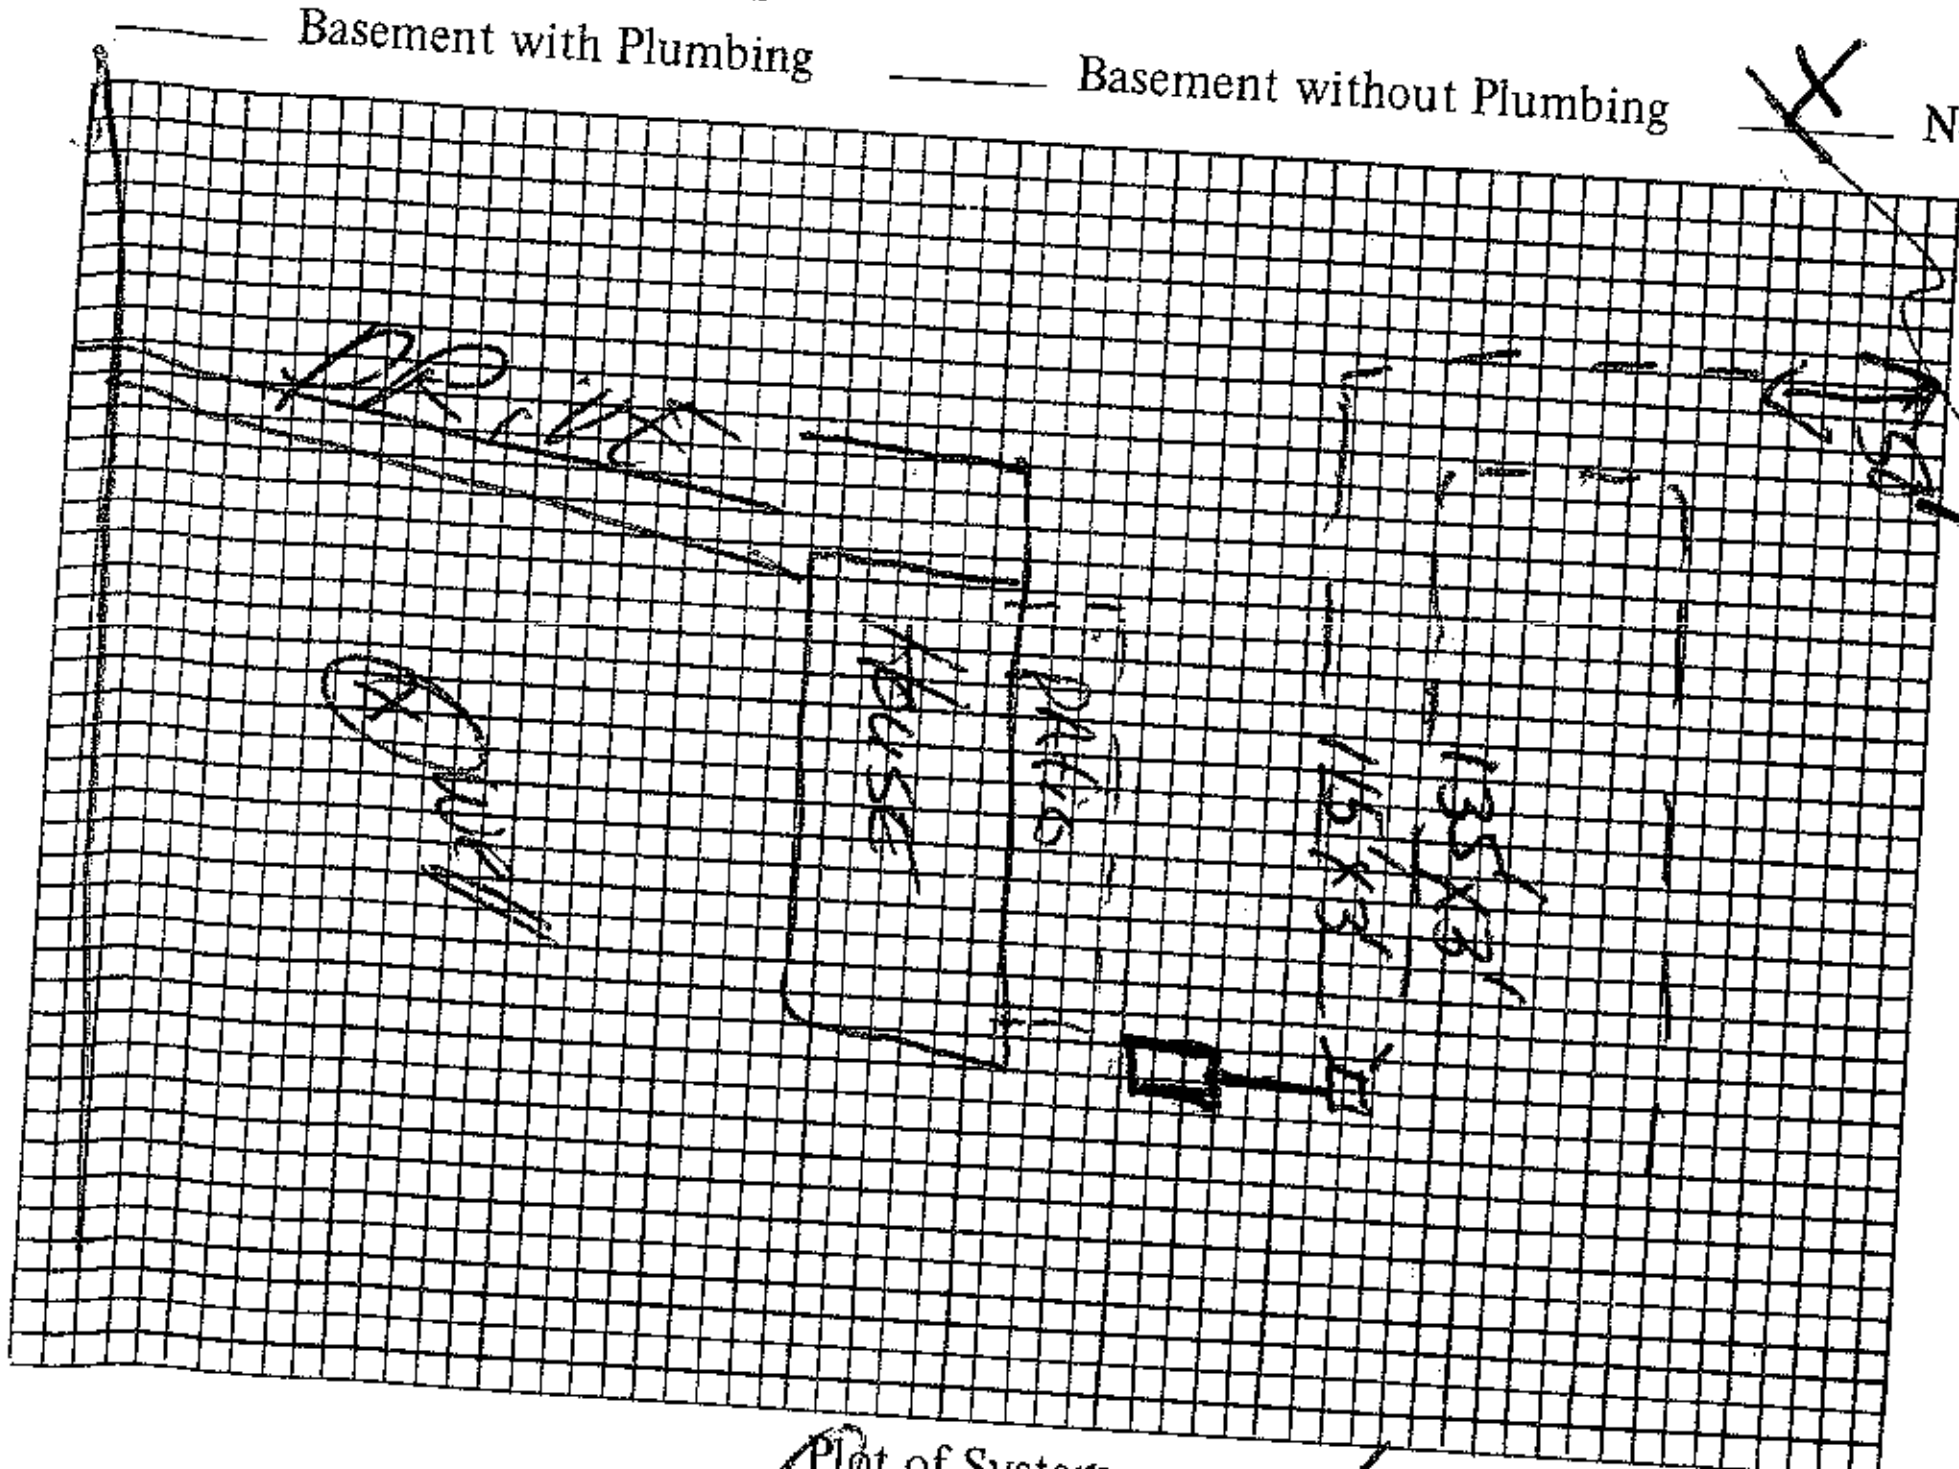

Plot of System

Size of Tank 1000 Gals.

Nitrification Field: 2

No. of Lines 2

Sq. Ft. 750 Linear Ft. 250

Depth of Stone in Lines 10"

Water Supply: Individual (X) Public ( )

Mt. Pleasant

Installed by C. M. Barnes

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: ______

IMPROVEMENTS PERMIT BY David R. Hinson

COMMENTS: ______

CERTIFICATE OF COMPLETION BY Fred Clemmer

EXISTING SYSTEM CHECKED BY: ______ DATE 7-21-80

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS. ______ DATE ______

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold